




Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/12/24	104,29	255	131
24/12/24	104,68	185	57
25/12/24	104,57	184	59

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
23/12/24	232	237
24/12/24	165	164
25/12/24	159	159

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/12/24	102,18	181	218
24/12/24	102,35	154	149
25/12/24	102,26	151	154

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
23/12/24	3.321
24/12/24	3.291
25/12/24	2.770
26/12/24	2.154
Atualizado em: 26/12/24 14:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
23/12/24	3.241	3.225
24/12/24	2.400	2.591
25/12/24	1.804	1.979

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
23/12/24	2.803	2.861
24/12/24	2.021	2.066
25/12/24	1.547	1.477

Data	Vazão Transferida (m³/s)
23/12/24	130
24/12/24	127
25/12/24	125


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
23/12/24	3.142	3.180
24/12/24	2.602	2.684
25/12/24	1.951	1.862

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/12/24	98,73	2.411	2.652
24/12/24	98,84	1.919	1.871
25/12/24	99,70	1.906	1.497

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/12/24	96,29	2.019	2.065
24/12/24	97,11	1.763	1.726
25/12/24	98,56	1.719	1.655

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
23/12/24	95,20	1.903	1.688
24/12/24	95,87	1.805	1.513
25/12/24	96,53	1.726	1.433

Estação Fluviométrica - Hotel Cataratas

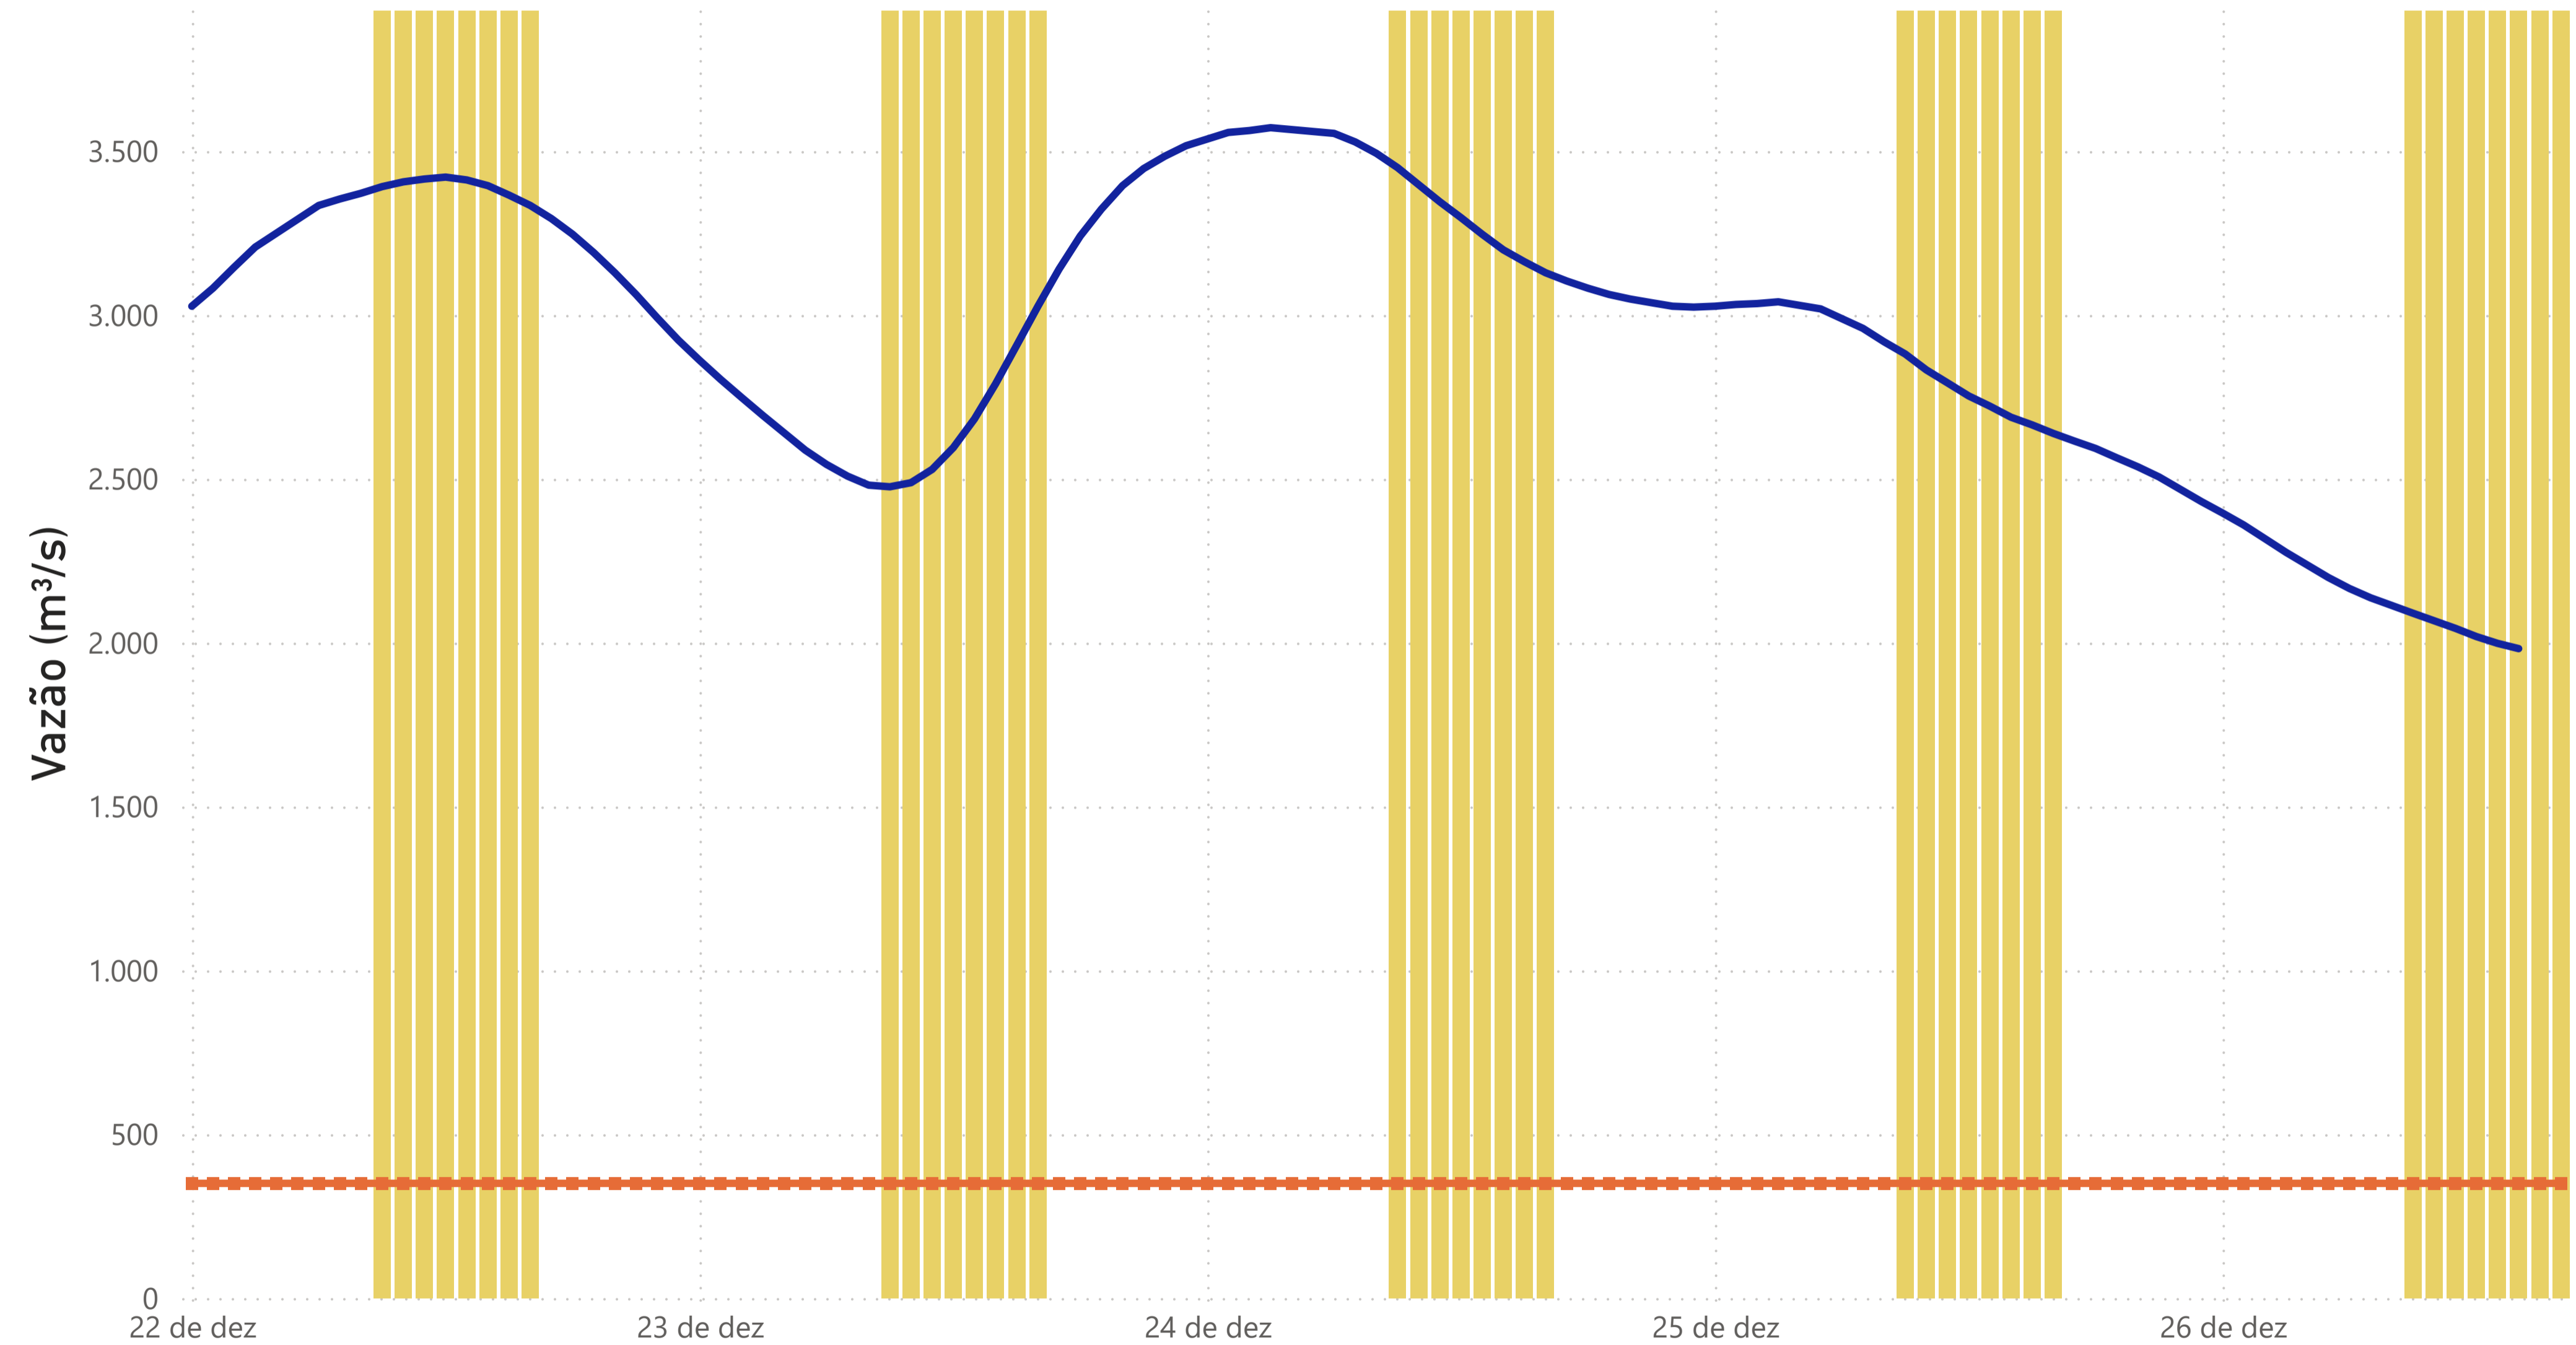

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m^3/s) ■ Vazão mínima para beleza cênica (350 m^3/s)

