

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/25	83,33	82	12
02/02/25	74,55	81	10
03/02/25	83,52	142	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
01/02/25	66	66
02/02/25	73	71
03/02/25	137	134

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/25	74,60	128	64
02/02/25	76,24	118	68
03/02/25	75,42	110	135

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
01/02/25	1.722
02/02/25	1.228
03/02/25	1.310
04/02/25	1.360
Atualizado em: 04/02/25 09:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
01/02/25	1.096	985
02/02/25	951	1.031
03/02/25	1.255	1.207

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
01/02/25	862	920
02/02/25	804	778
03/02/25	1.165	1.082

Data	Vazão Transferida (m³/s)
01/02/25	120
02/02/25	97
03/02/25	106


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
01/02/25	1.014	997
02/02/25	1.042	1.097
03/02/25	1.235	1.152

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/25	92,94	839	862
02/02/25	92,84	736	783
03/02/25	92,79	1.163	1.186

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/25	80,81	517	793
02/02/25	82,25	655	688
03/02/25	80,60	947	1.125

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/25	66,03	524	413
02/02/25	66,06	525	513
03/02/25	65,25	527	885

Estação Fluviométrica - Hotel Cataratas

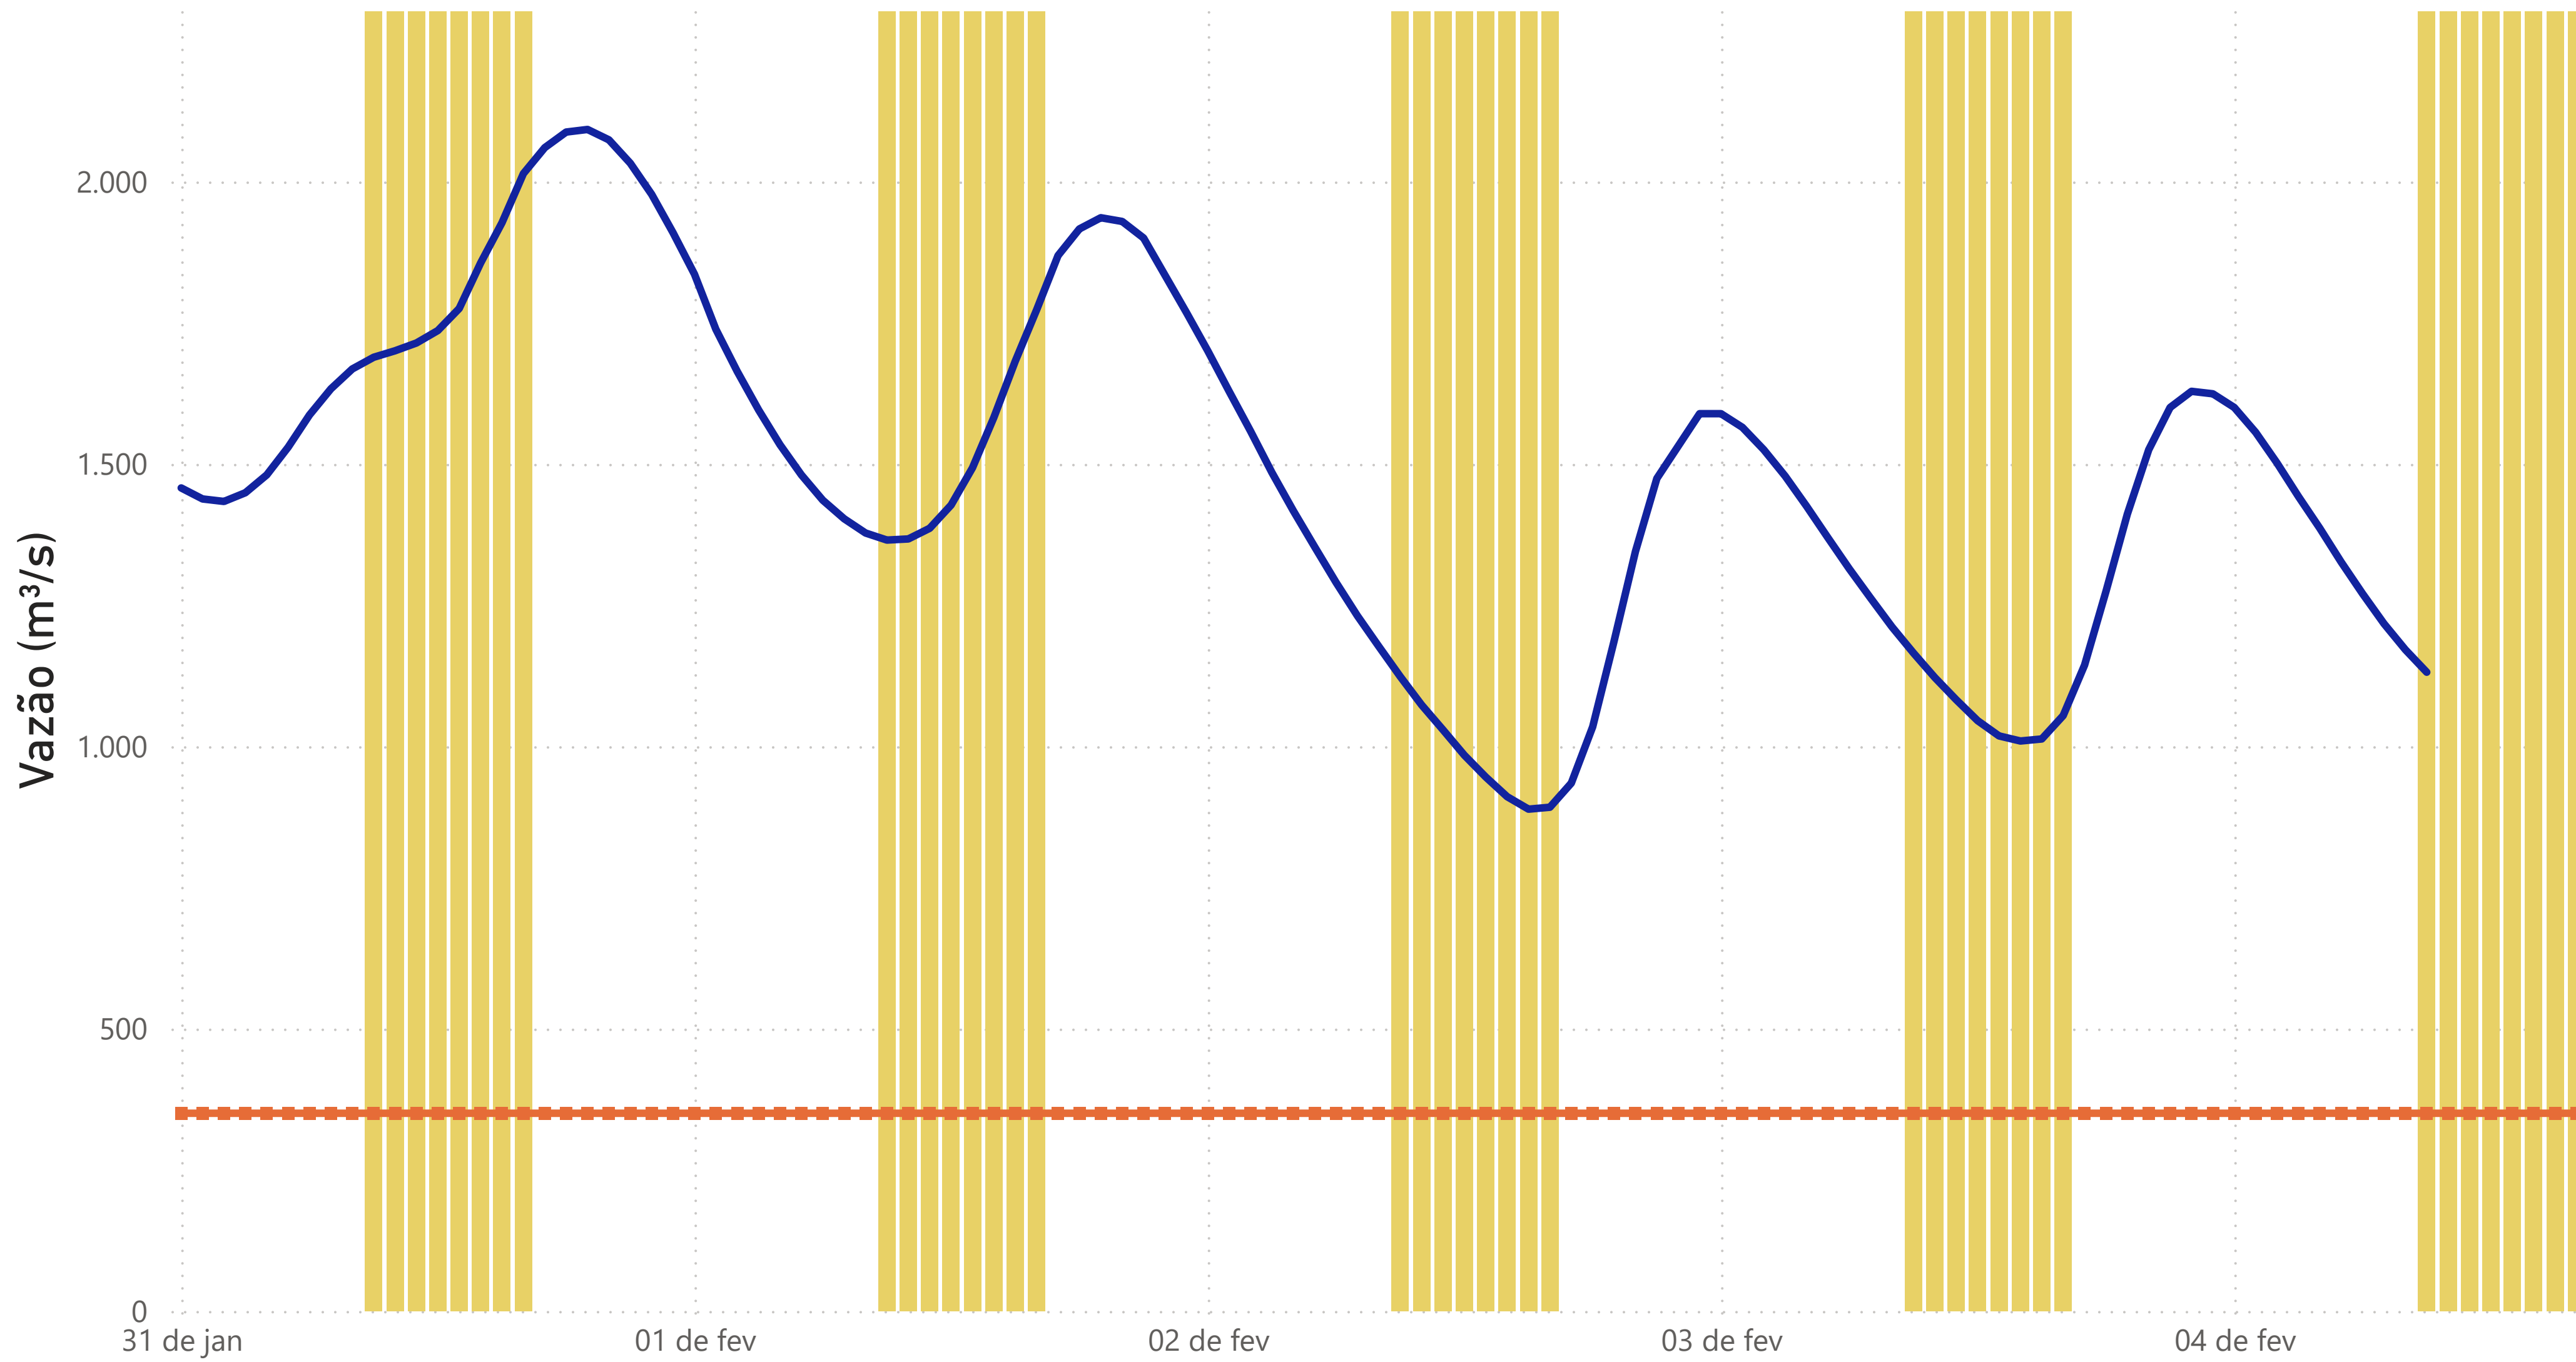

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

