

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/02/25	74,55	81	10
03/02/25	83,60	142	10
04/02/25	90,35	148	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
02/02/25	73	71
03/02/25	137	134
04/02/25	136	140

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/02/25	76,24	118	68
03/02/25	75,42	110	135
04/02/25	74,40	103	134

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
02/02/25	1.101
03/02/25	1.310
04/02/25	1.414
05/02/25	1.728
Atualizado em: 05/02/25 09:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
02/02/25	951	1.031
03/02/25	1.255	1.207
04/02/25	1.340	1.499

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
02/02/25	804	778
03/02/25	1.165	1.082
04/02/25	1.229	1.255

Data	Vazão Transferida (m³/s)
02/02/25	97
03/02/25	106
04/02/25	118


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
02/02/25	1.042	1.097
03/02/25	1.235	1.152
04/02/25	1.531	1.545

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/02/25	92,94	712	783
03/02/25	92,79	1.115	1.186
04/02/25	92,64	1.166	1.237

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/02/25	82,04	618	688
03/02/25	80,60	956	1.125
04/02/25	82,67	1.088	1.114

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/02/25	66,06	525	513
03/02/25	65,25	527	885
04/02/25	64,18	535	1.007

Estação Fluviométrica - Hotel Cataratas

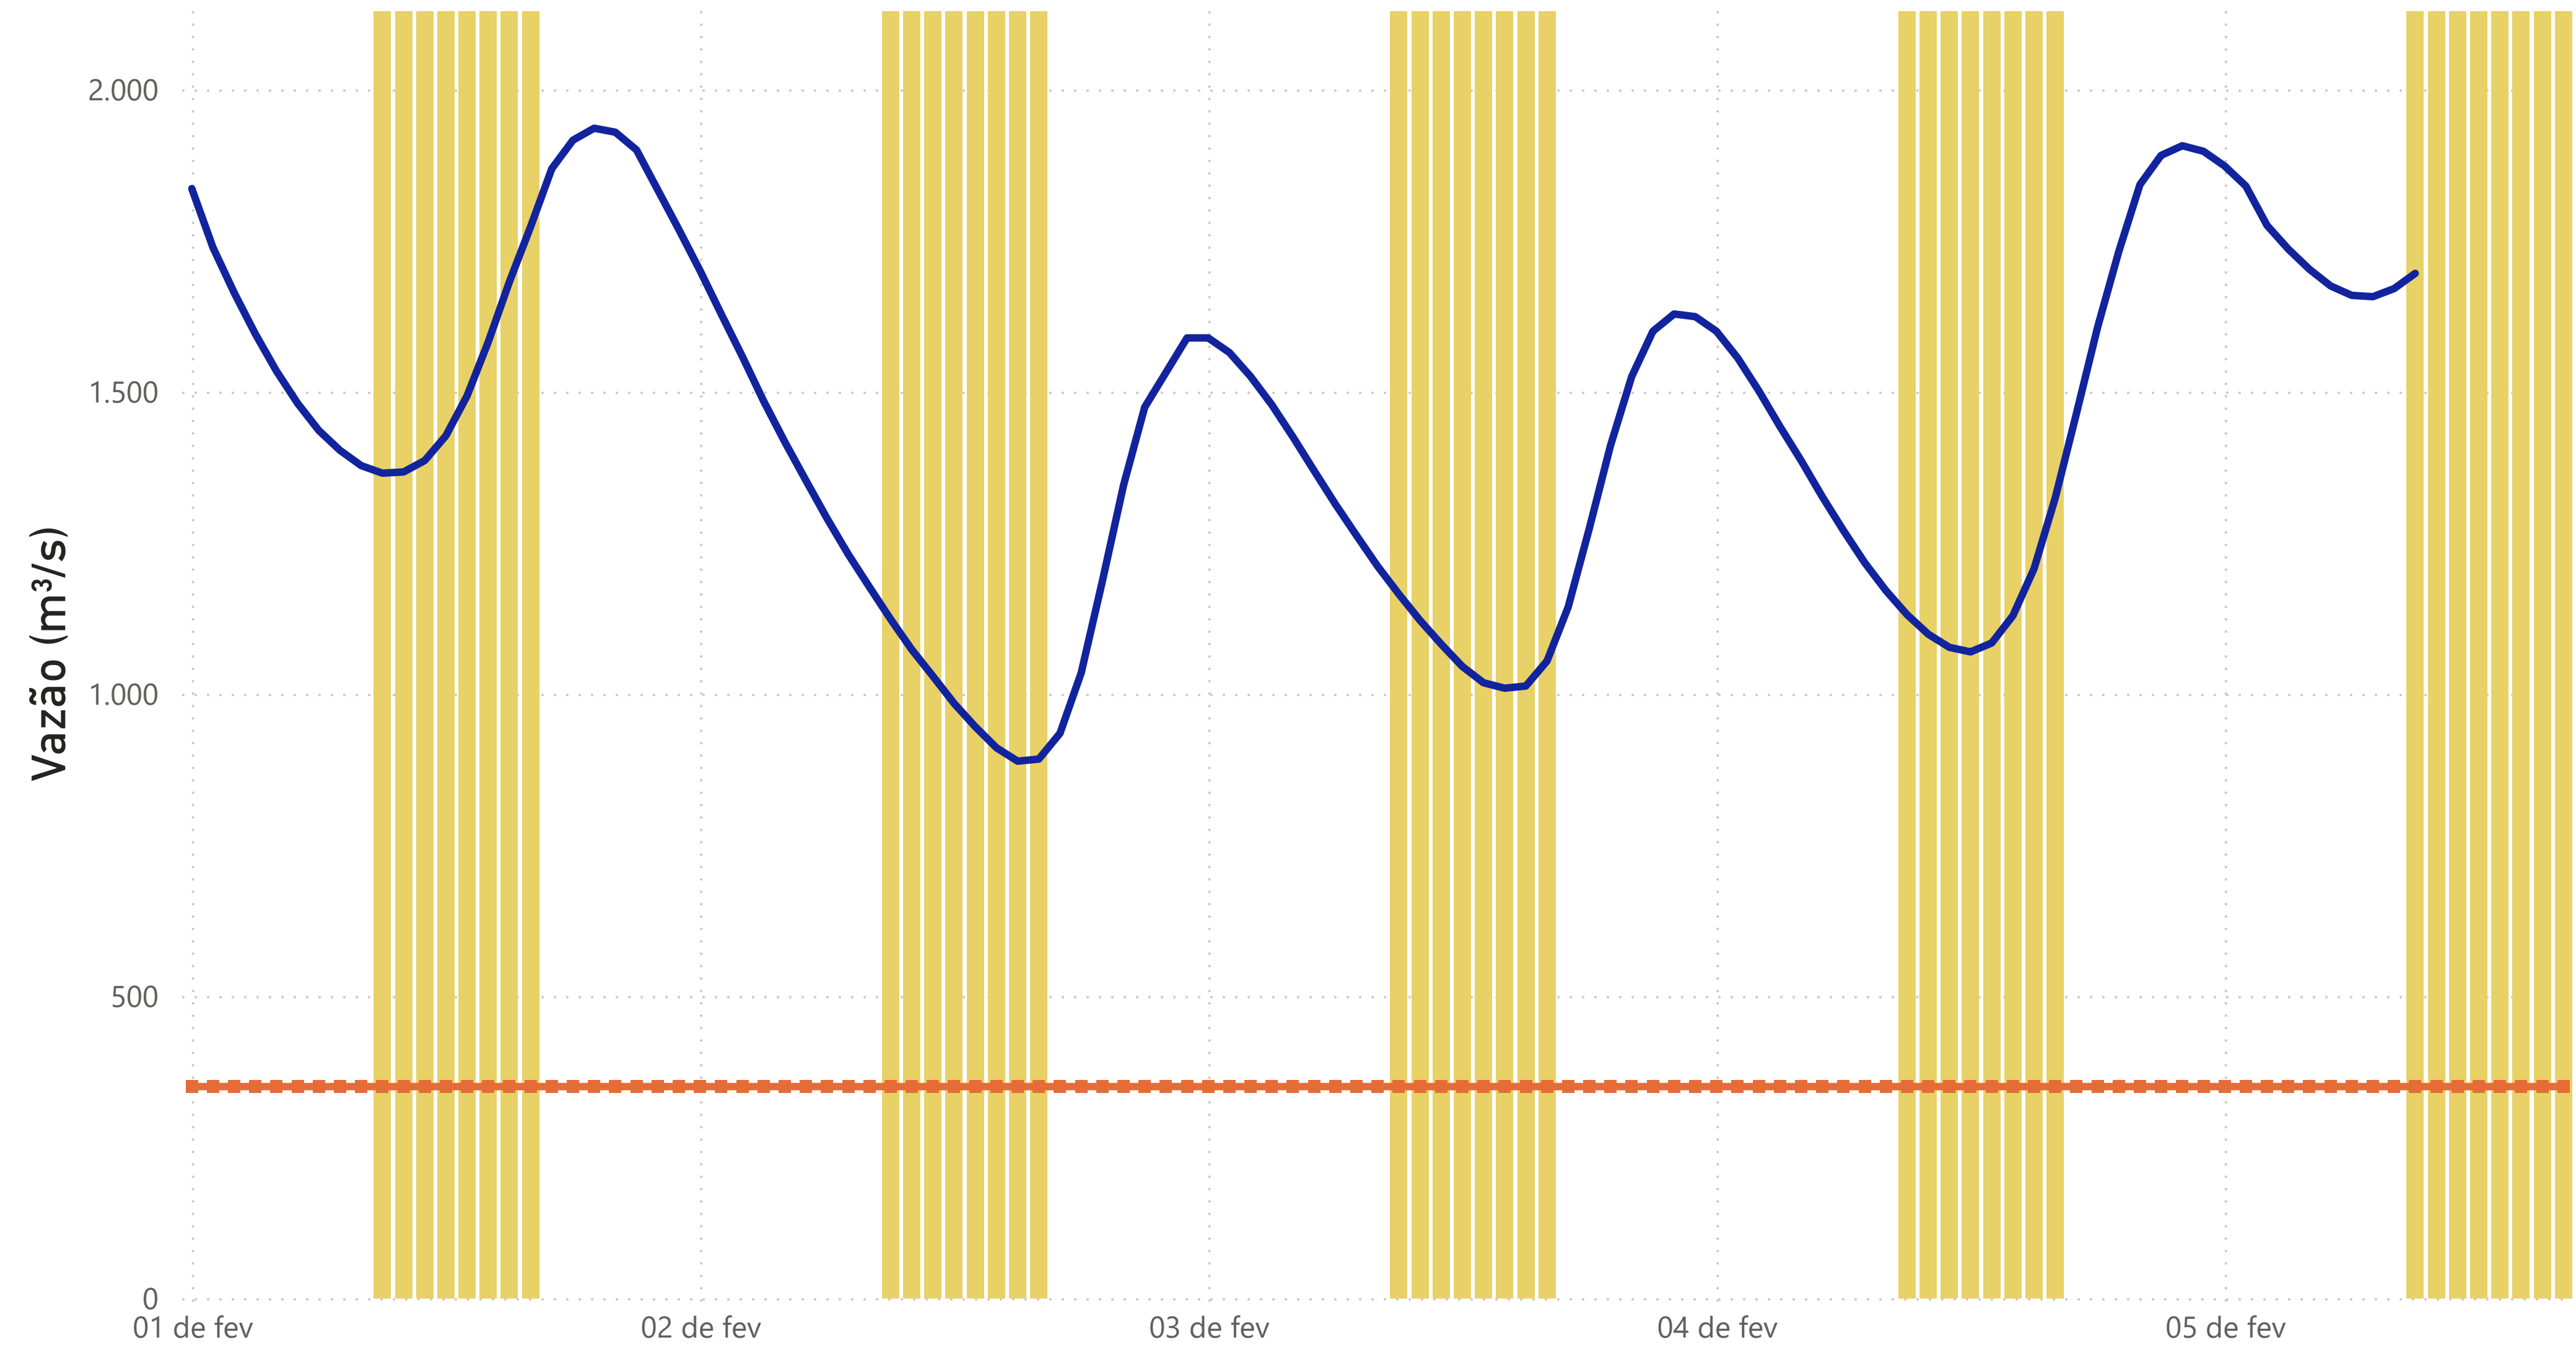

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m^3/s) ■ Vazão mínima para beleza cênica (350 m^3/s)

