

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
03/02/25	83,60	142	10
04/02/25	90,39	148	10
05/02/25	95,50	146	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
03/02/25	137	134
04/02/25	136	140
05/02/25	139	140

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
03/02/25	75,42	110	135
04/02/25	74,40	103	134
05/02/25	73,17	98	135

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
03/02/25	1.264
04/02/25	1.414
05/02/25	1.859
06/02/25	1.981
Atualizado em: 06/02/25 09:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
03/02/25	1.255	1.207
04/02/25	1.340	1.499
05/02/25	1.525	1.763

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
03/02/25	1.165	1.082
04/02/25	1.229	1.255
05/02/25	1.334	1.366


Data	Vazão Transferida (m³/s)
03/02/25	106
04/02/25	118
05/02/25	121

Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
03/02/25	1.235	1.152
04/02/25	1.531	1.545
05/02/25	1.727	1.744

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
03/02/25	92,79	1.115	1.186
04/02/25	92,64	1.166	1.237
05/02/25	92,10	1.102	1.360

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
03/02/25	80,60	956	1.125
04/02/25	82,67	1.088	1.114
05/02/25	90,09	1.285	1.075

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
03/02/25	65,25	527	885
04/02/25	64,18	535	1.007
05/02/25	62,80	596	1.201

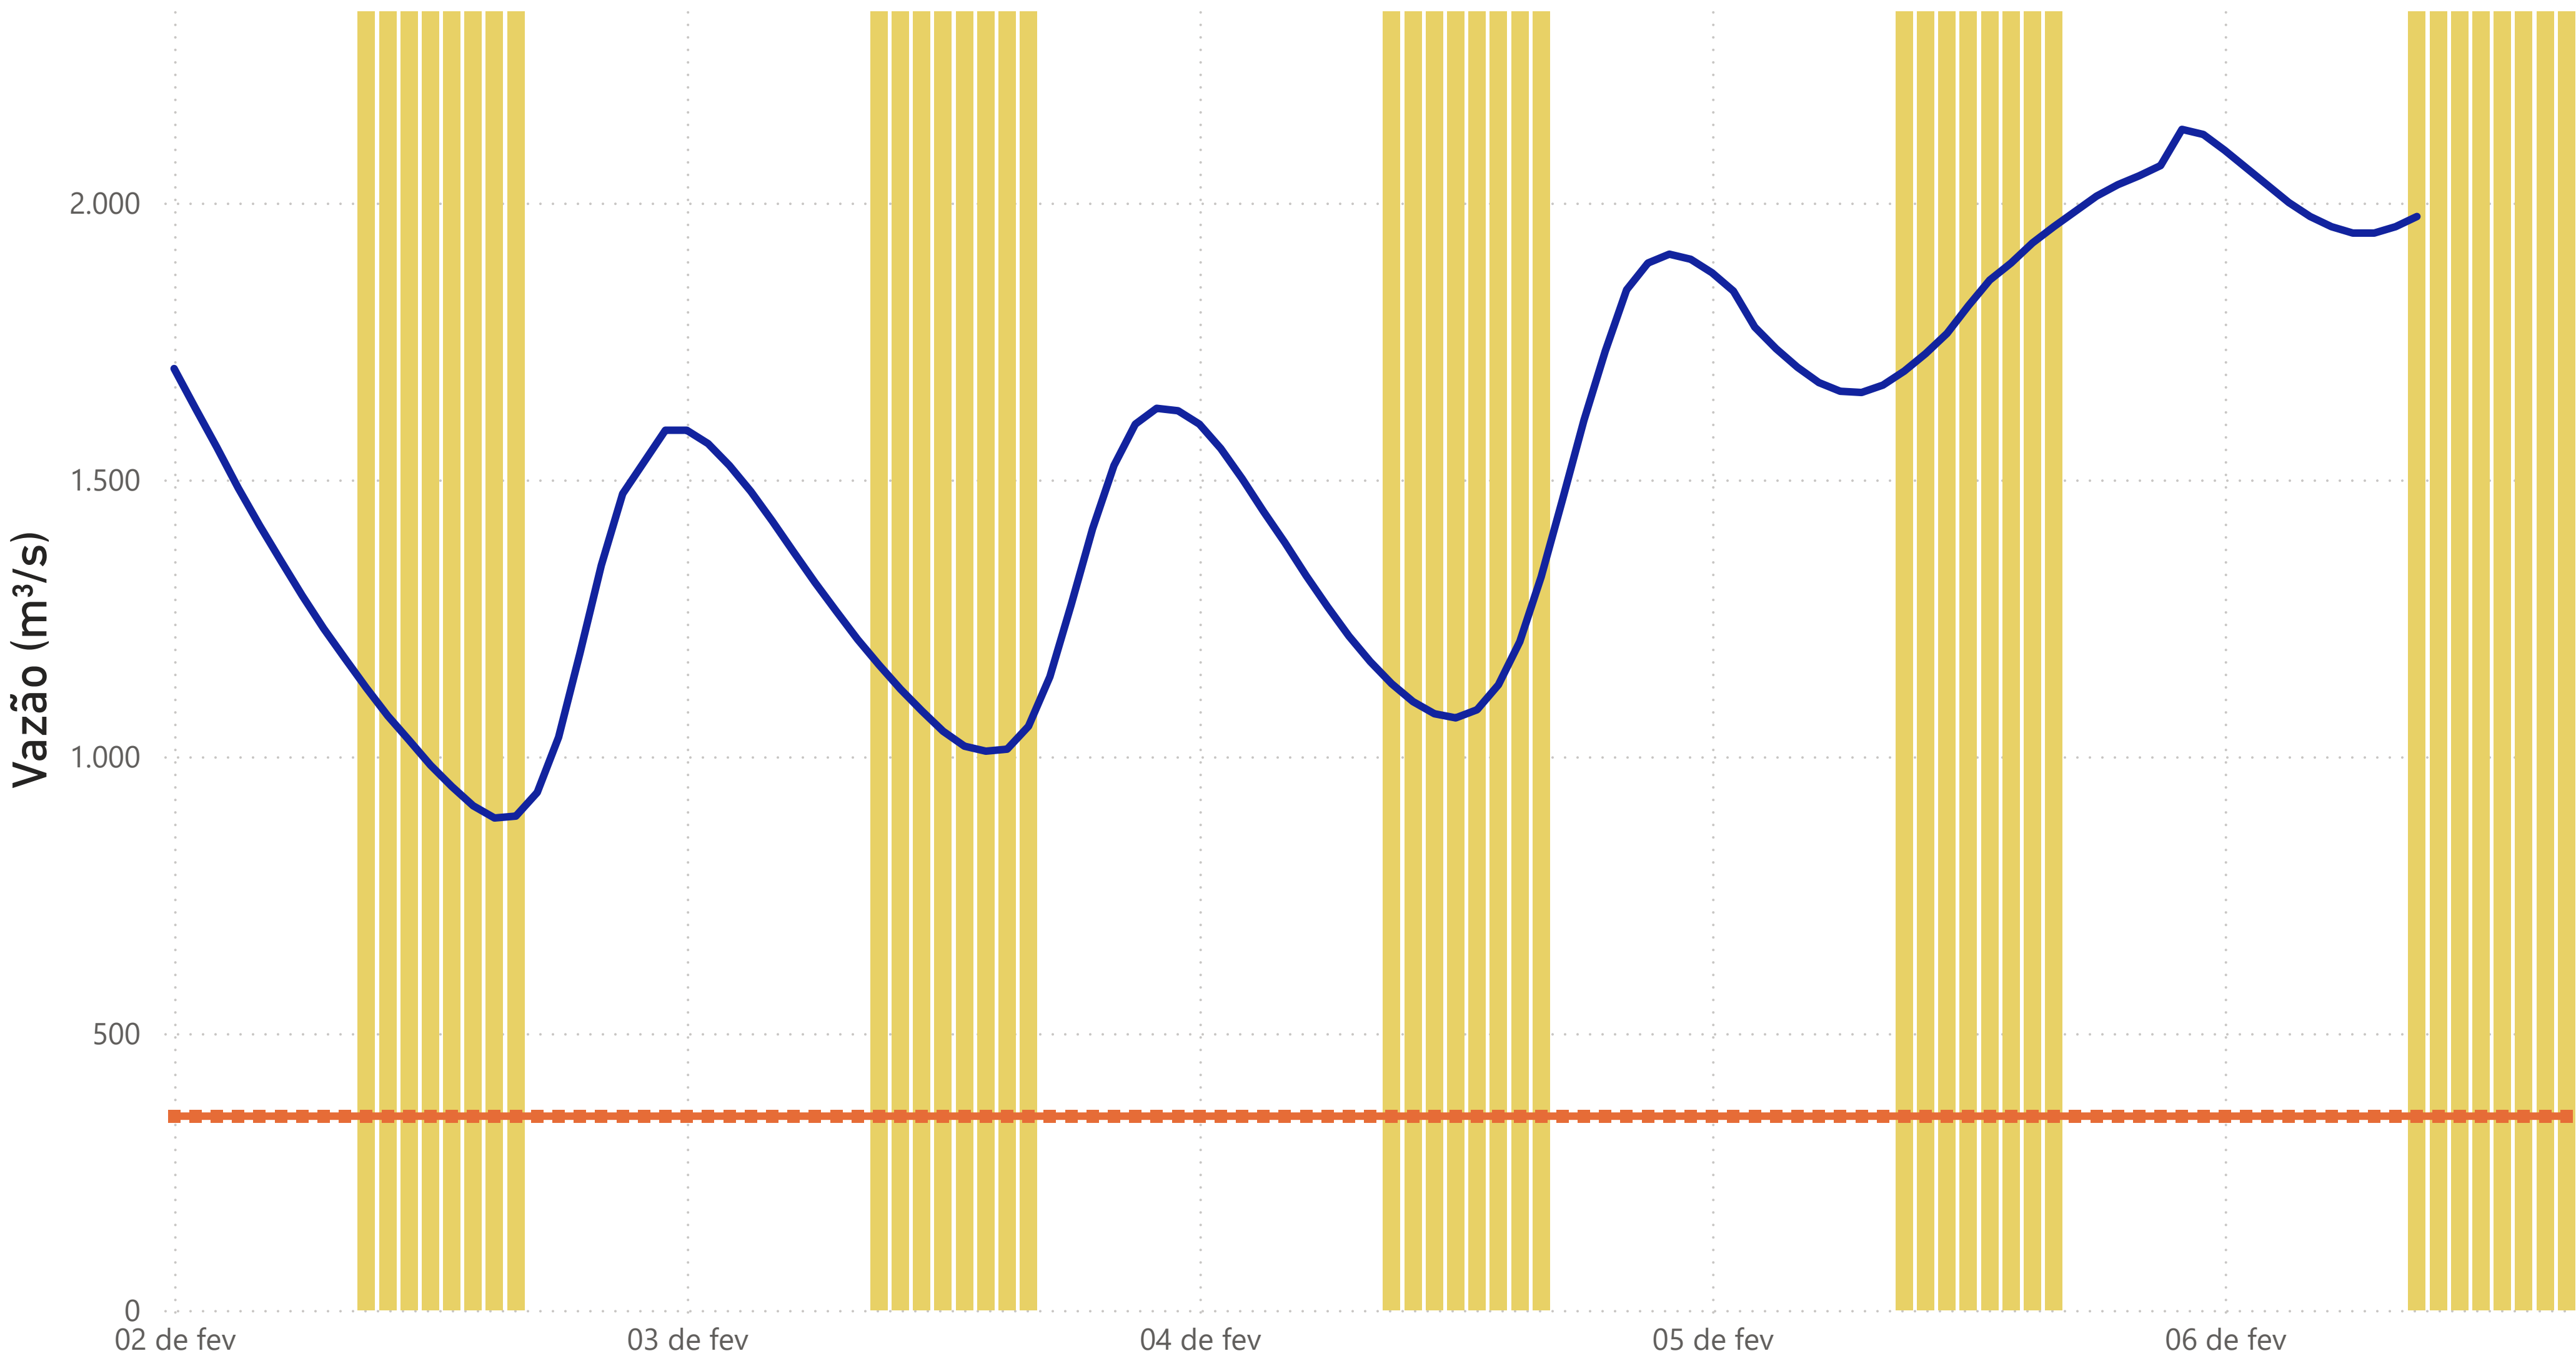

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

