

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
25/03/25	61,14	154	10
26/03/25	66,49	160	10
27/03/25	62,98	136	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
25/03/25	147	148
26/03/25	153	152
27/03/25	125	127

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
25/03/25	62,38	55	139
26/03/25	60,26	89	153
27/03/25	59,68	107	125

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
25/03/25	1.527
26/03/25	1.601
27/03/25	1.524
28/03/25	1.556
Atualizado em: 28/03/25 09:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
25/03/25	1.279	1.390
26/03/25	1.146	1.241
27/03/25	1.132	1.386

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
25/03/25	1.210	1.236
26/03/25	1.128	1.051
27/03/25	1.124	1.060

Data	Vazão Transferida (m³/s)
25/03/25	122
26/03/25	134
27/03/25	136


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
25/03/25	1.523	1.537
26/03/25	1.400	1.508
27/03/25	1.565	1.579

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
25/03/25	70,87	782	1.236
26/03/25	69,96	714	1.145
27/03/25	69,15	743	1.129

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
25/03/25	31,22	550	758
26/03/25	26,50	354	698
27/03/25	25,32	493	681

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
25/03/25	35,95	282	487
26/03/25	35,95	294	294
27/03/25	35,78	311	389

Estação Fluviométrica - Hotel Cataratas

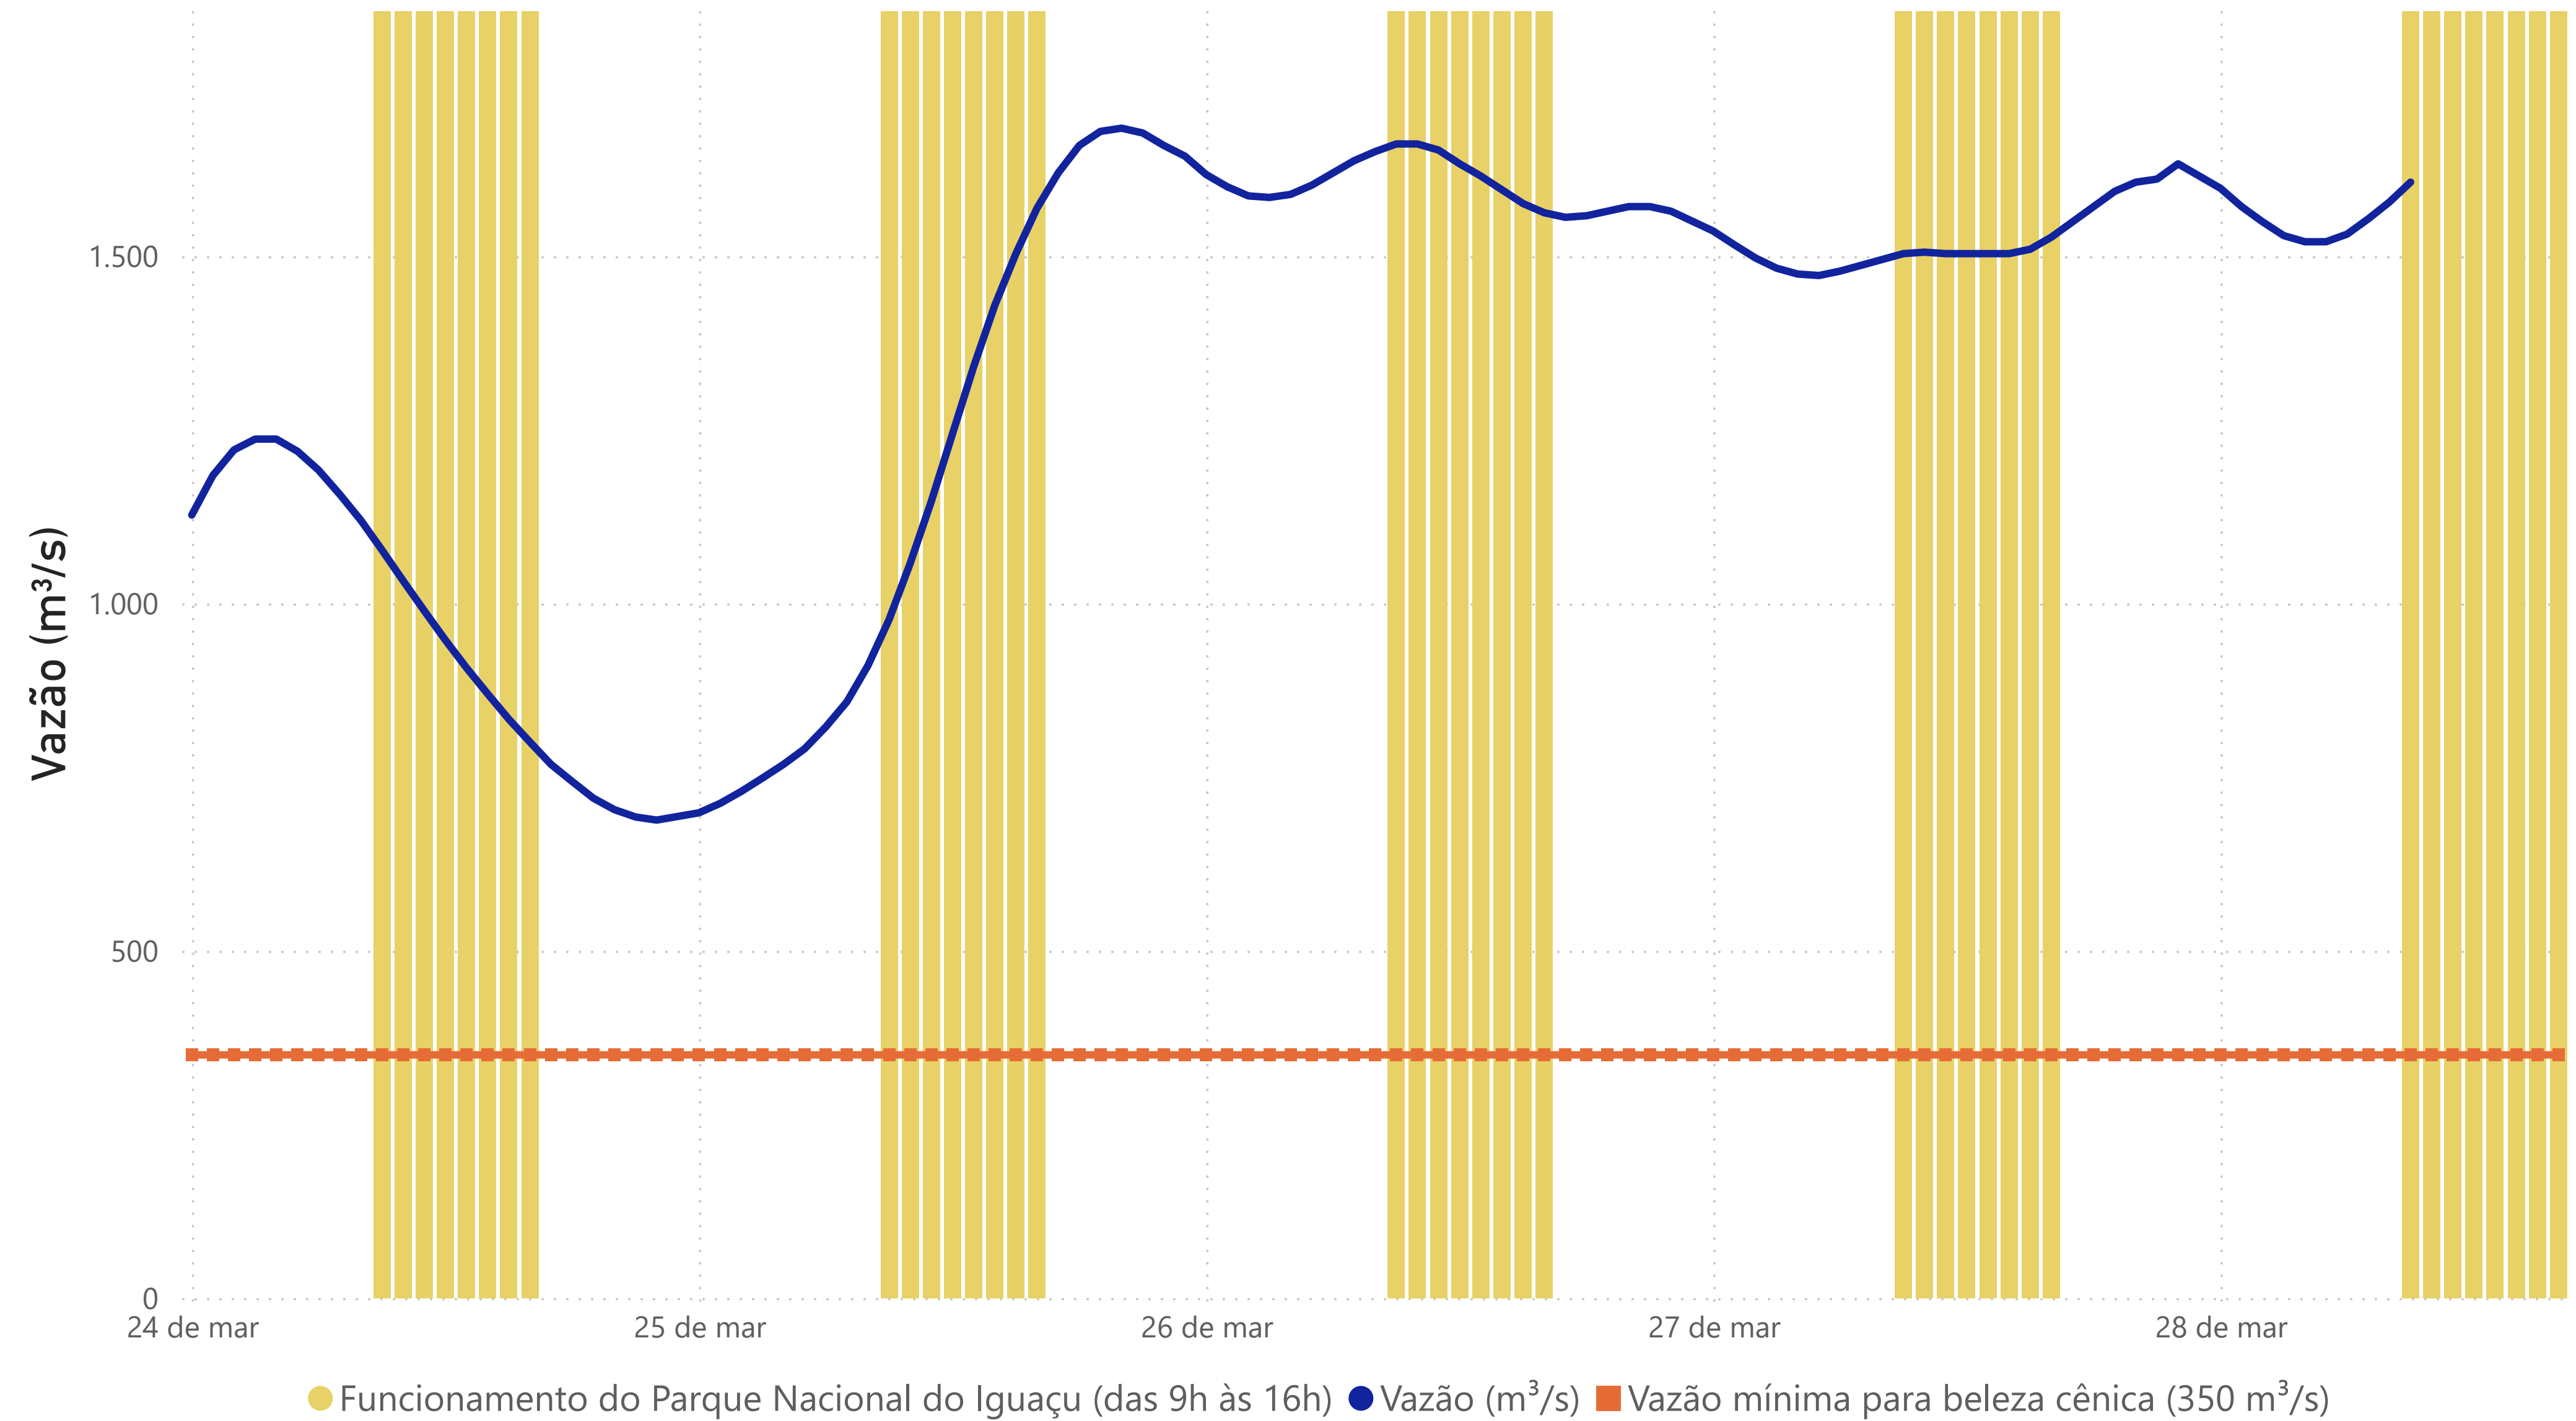

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m^3/s) ■ Vazão mínima para beleza cênica (350 m^3/s)

