

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/06/25	53,59	119	10
03/06/25	67,13	163	10
04/06/25	75,19	170	11

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
02/06/25	98	96
03/06/25	146	152
04/06/25	156	154

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/06/25	80,90	46	93
03/06/25	77,95	55	144
04/06/25	75,42	76	153

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
02/06/25	442
03/06/25	835
04/06/25	935
05/06/25	999
Atualizado em: 05/06/25 14:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
02/06/25	389	1.055
03/06/25	704	656
04/06/25	585	839

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
02/06/25	323	214
03/06/25	566	527
04/06/25	265	412

Data	Vazão Transferida (m³/s)
02/06/25	72
03/06/25	114
04/06/25	135


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
02/06/25	1.252	1.301
03/06/25	850	847
04/06/25	1.033	1.050

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/06/25	41,76	322	303
03/06/25	42,27	784	539
04/06/25	43,03	663	304

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/06/25	47,67	140	388
03/06/25	41,29	415	698
04/06/25	35,75	289	535

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
02/06/25	40,28	201	0
03/06/25	40,28	184	184
04/06/25	40,58	184	53

Estação Fluviométrica - Hotel Cataratas

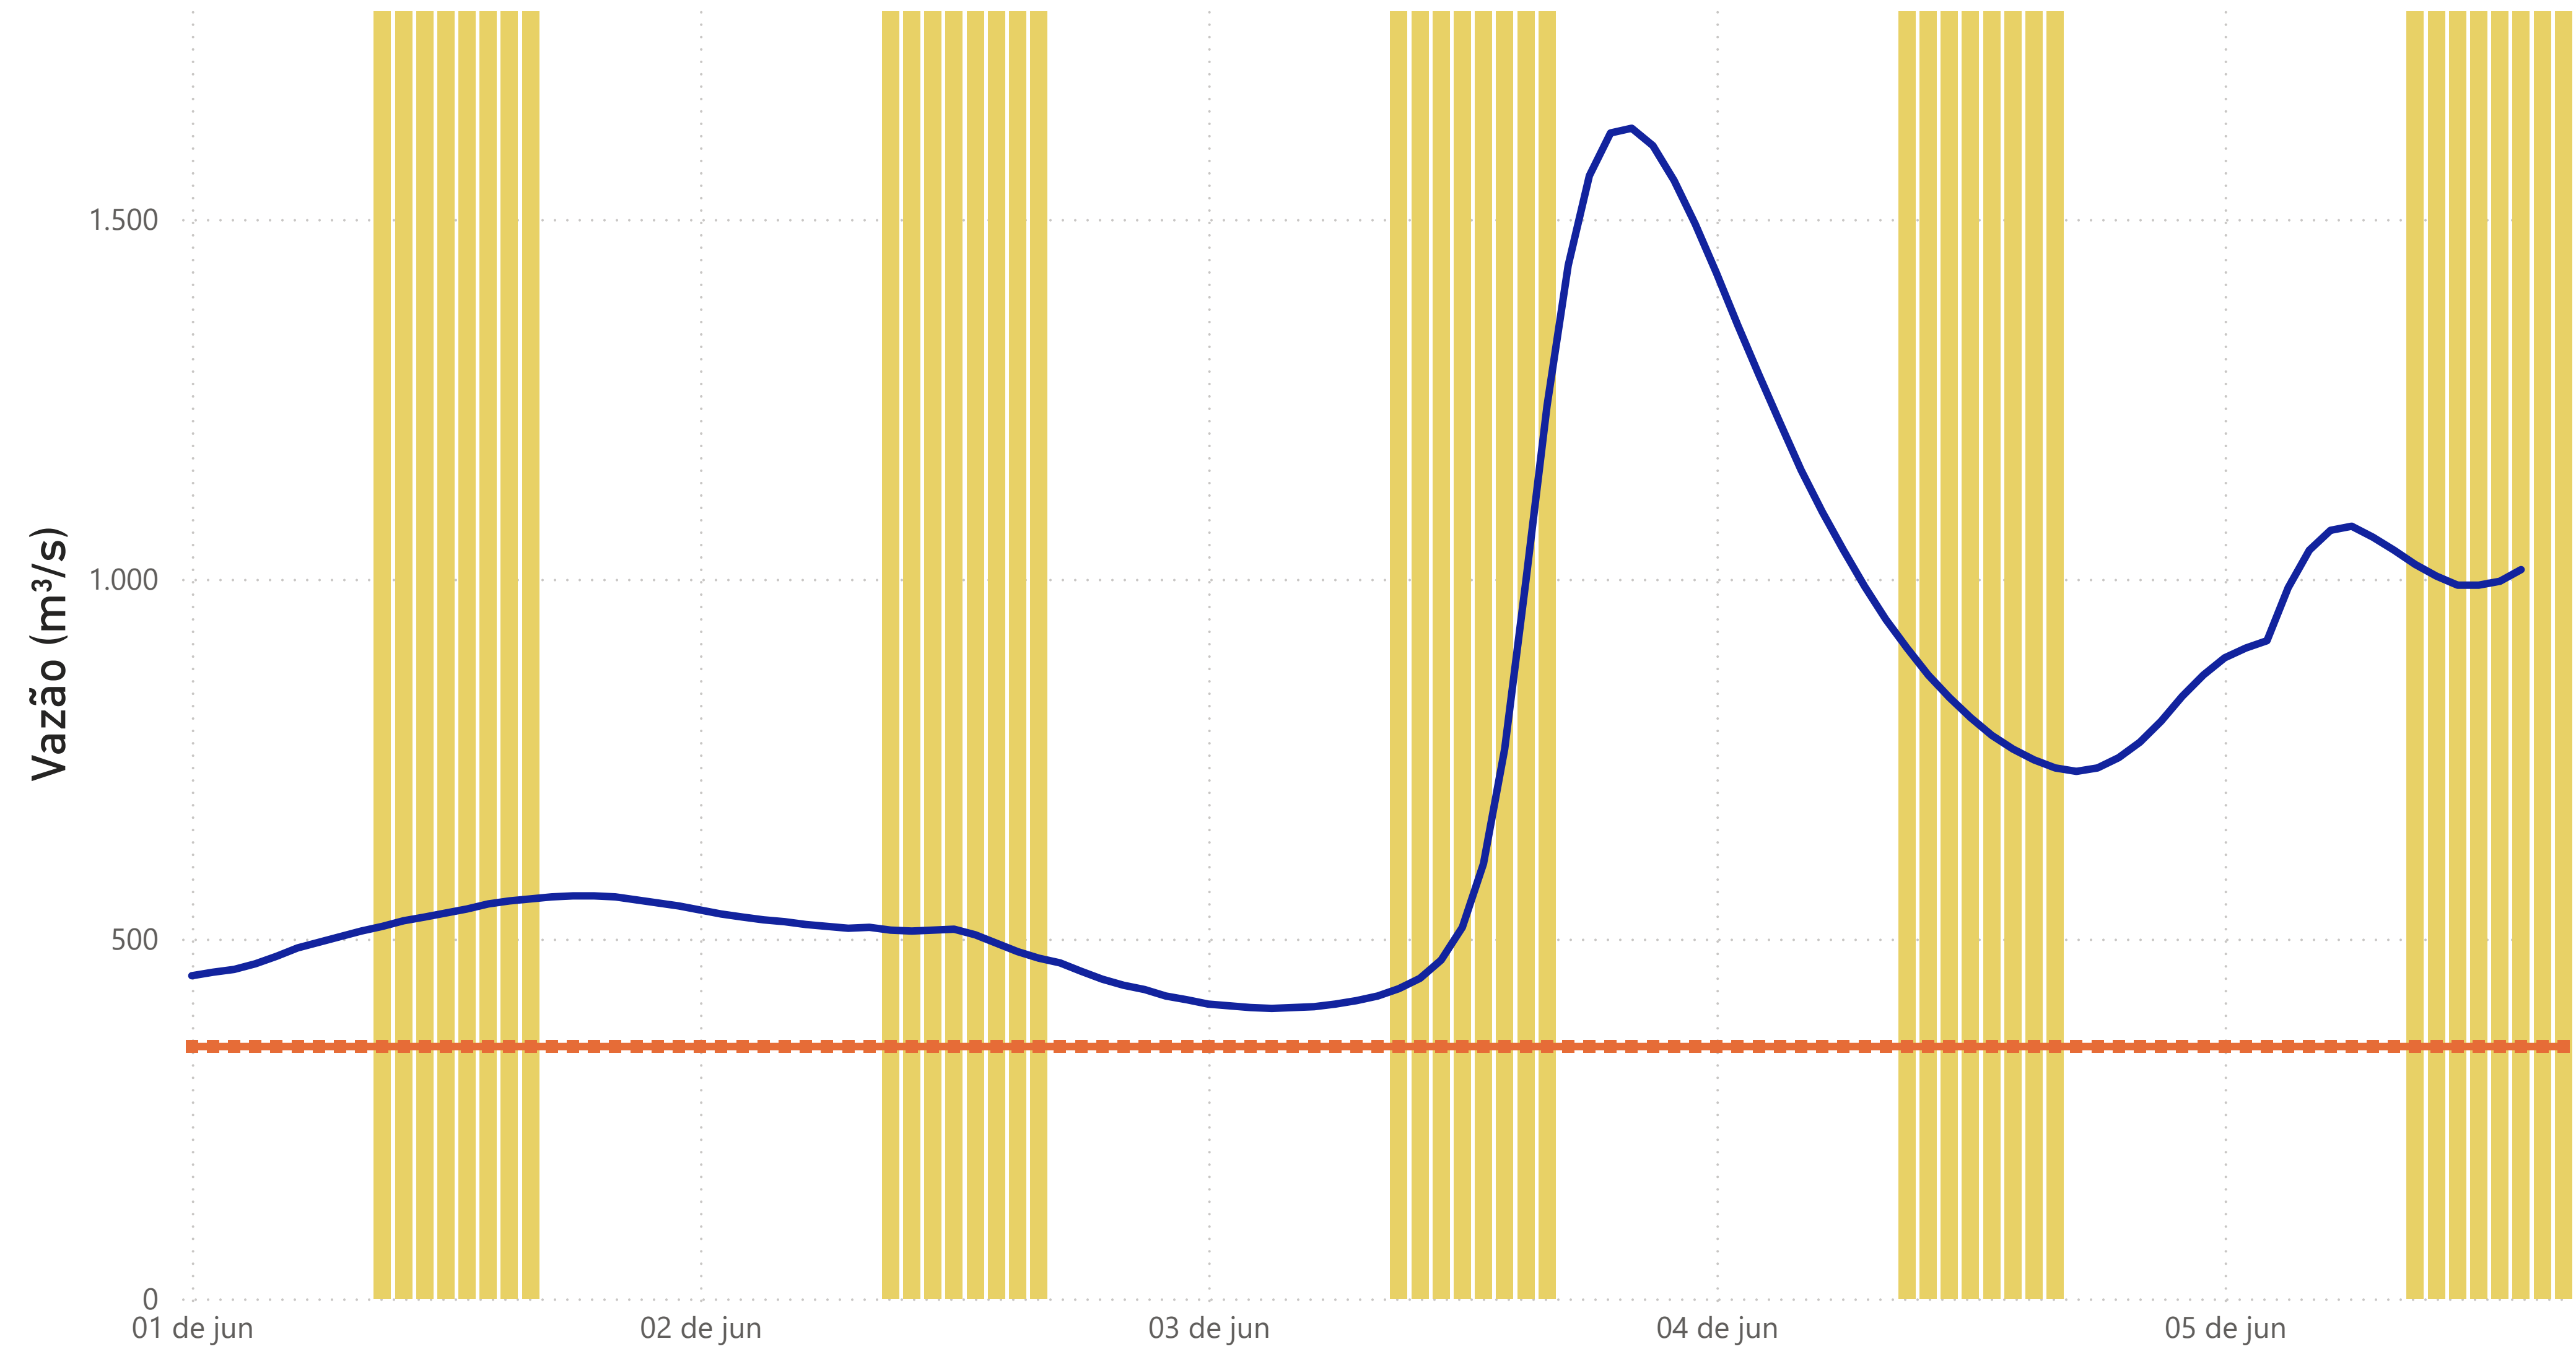

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

