

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
08/07/25	103,89	214	90
09/07/25	103,89	178	53
10/07/25	104,03	156	33

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
08/07/25	174	177
09/07/25	152	151
10/07/25	130	129

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
08/07/25	101,54	150	170
09/07/25	101,46	145	147
10/07/25	101,70	131	124

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
08/07/25	1.629
09/07/25	1.686
10/07/25	1.594
11/07/25	1.392
Atualizado em: 11/07/25 09:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
08/07/25	1.170	1.329
09/07/25	1.163	1.163
10/07/25	1.265	1.329

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
08/07/25	761	716
09/07/25	640	735
10/07/25	1.244	905

Data	Vazão Transferida (m³/s)
08/07/25	127
09/07/25	125
10/07/25	123


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
08/07/25	1.509	1.530
09/07/25	1.223	1.334
10/07/25	1.383	1.286

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
08/07/25	85,48	1.461	708
09/07/25	87,12	1.398	618
10/07/25	87,36	1.368	1.253

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
08/07/25	99,59	1.186	1.258
09/07/25	98,97	1.130	1.283
10/07/25	99,38	1.092	1.196

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
08/07/25	99,71	1.010	979
09/07/25	99,64	915	946
10/07/25	99,36	811	937

Estação Fluviométrica - Hotel Cataratas

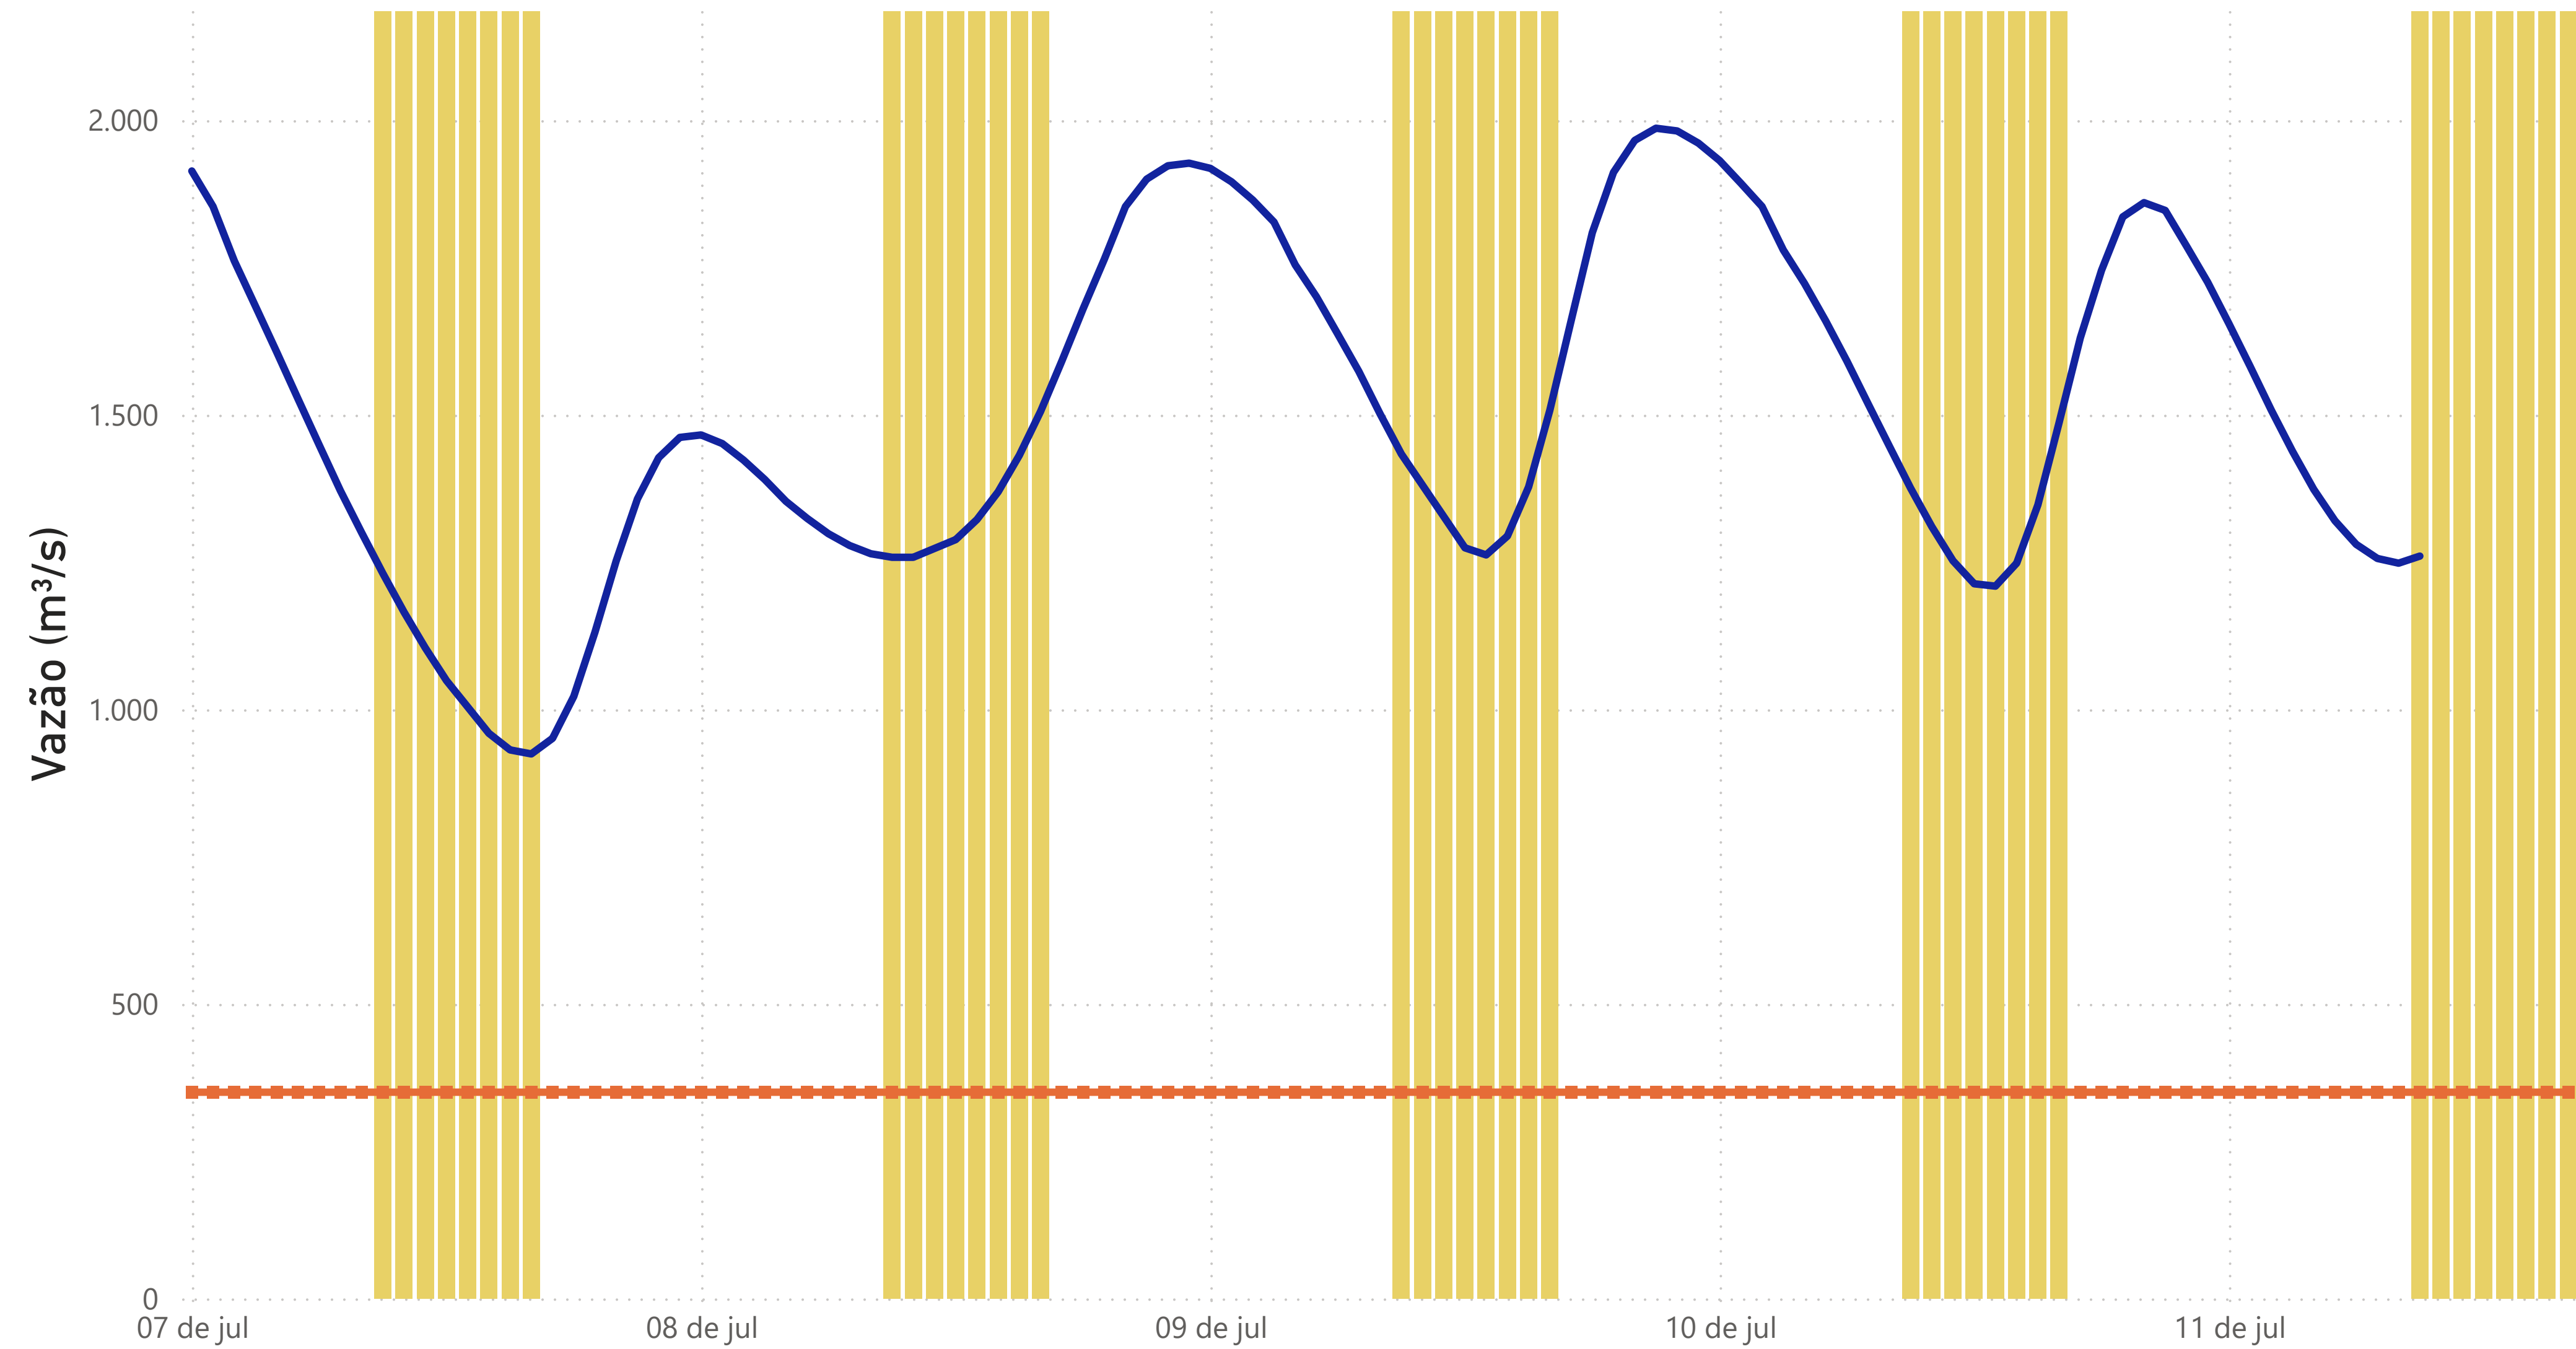

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

