

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
14/07/25	103,22	151	18
15/07/25	102,42	171	44
16/07/25	99,34	145	27

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
14/07/25	118	119
15/07/25	140	146
16/07/25	125	128

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
14/07/25	101,37	107	119
15/07/25	100,40	106	135
16/07/25	99,85	97	114

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
14/07/25	1.700
15/07/25	1.856
16/07/25	2.089
17/07/25	1.649
Atualizado em: 17/07/25 09:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
14/07/25	1.662	1.519
15/07/25	1.443	1.905
16/07/25	1.552	1.520

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
14/07/25	1.070	1.346
15/07/25	1.185	1.115
16/07/25	1.283	1.264

Data	Vazão Transferida (m³/s)
14/07/25	126
15/07/25	129
16/07/25	127


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
14/07/25	1.679	1.696
15/07/25	2.095	2.013
16/07/25	1.683	1.673

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
14/07/25	87,36	1.116	1.093
15/07/25	87,21	1.134	1.203
16/07/25	86,92	1.131	1.269

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
14/07/25	94,63	889	1.042
15/07/25	94,22	852	999
16/07/25	92,78	792	982

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
14/07/25	99,07	546	735
15/07/25	98,86	616	710
16/07/25	98,36	448	668

Estação Fluviométrica - Hotel Cataratas

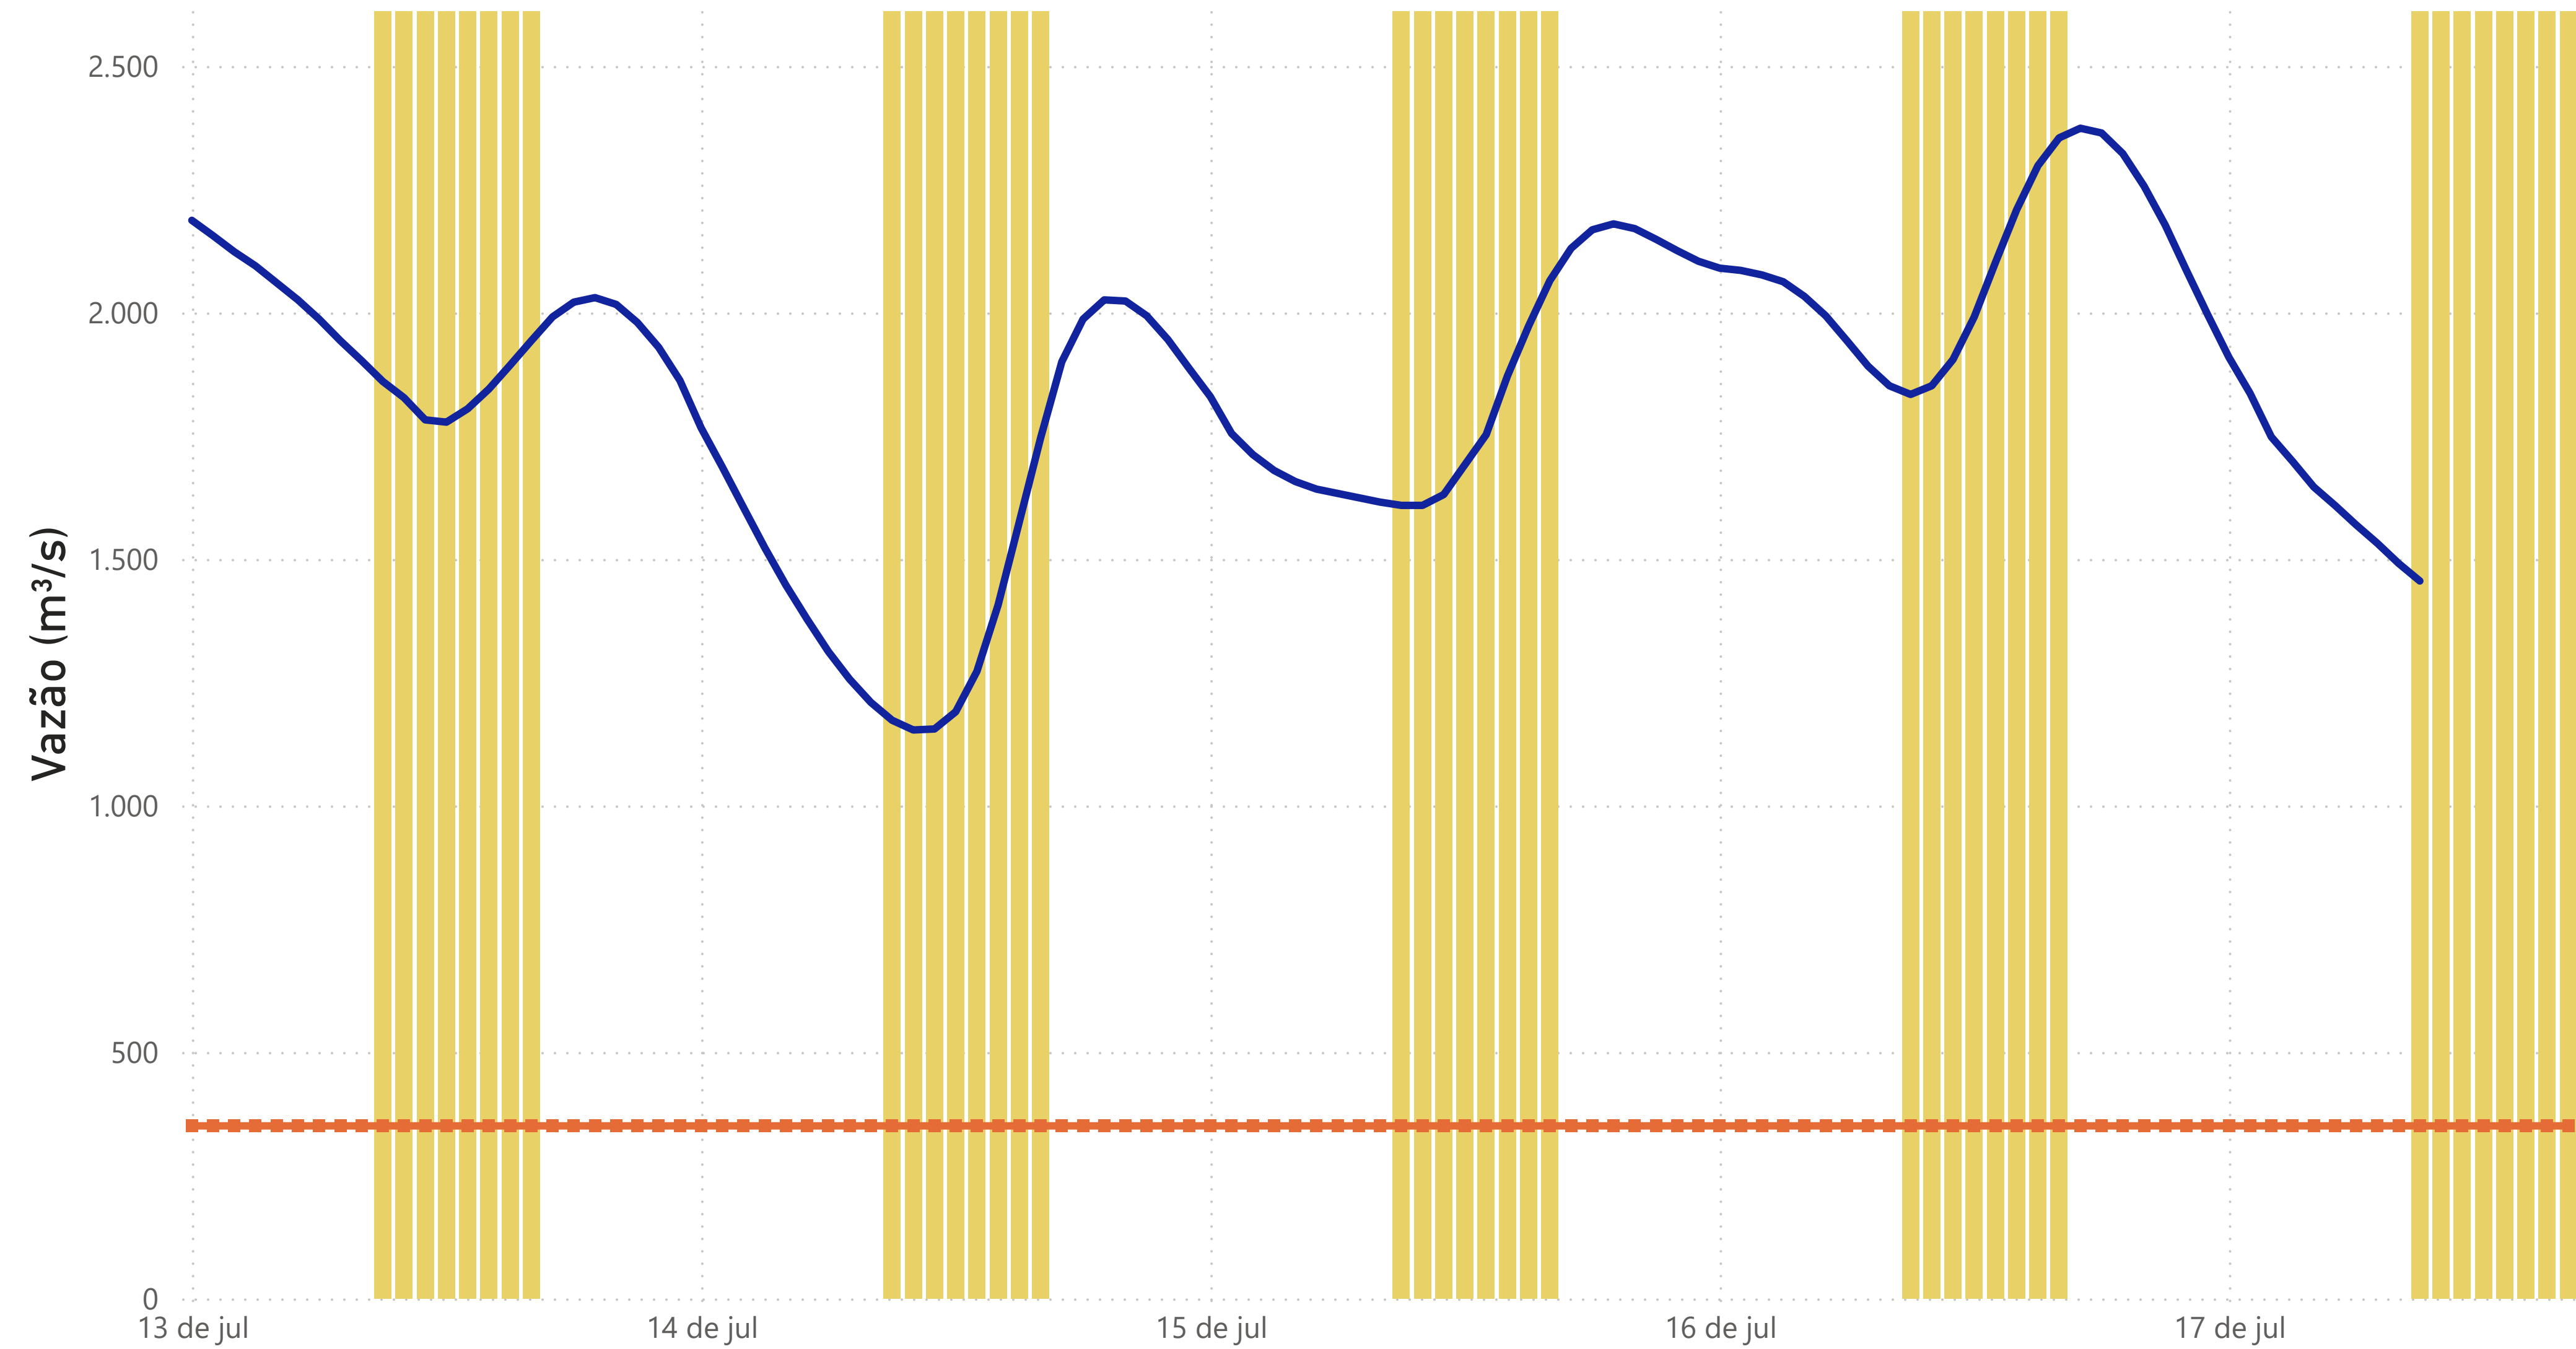

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

