

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
05/09/25	80,63	80	11
06/09/25	75,59	83	11
07/09/25	75,31	92	11

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
05/09/25	43	46
06/09/25	64	62
07/09/25	72	68

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
05/09/25	101,70	78	49
06/09/25	102,35	75	55
07/09/25	102,43	67	65

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
05/09/25	1.512
06/09/25	1.566
07/09/25	1.241
08/09/25	1.334
Atualizado em: 08/09/25 09:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
05/09/25	1.200	1.216
06/09/25	846	878
07/09/25	595	722

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
05/09/25	1.050	942
06/09/25	459	580
07/09/25	487	366

Data	Vazão Transferida (m³/s)
05/09/25	108
06/09/25	87
07/09/25	81


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
05/09/25	1.337	1.395
06/09/25	957	899
07/09/25	812	788

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
05/09/25	85,77	916	1.053
06/09/25	86,30	731	479
07/09/25	86,54	572	457

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
05/09/25	94,84	607	743
06/09/25	92,16	473	678
07/09/25	93,19	394	428

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
05/09/25	98,32	478	447
06/09/25	98,78	510	305
07/09/25	99,25	460	255

Estação Fluviométrica - Hotel Cataratas

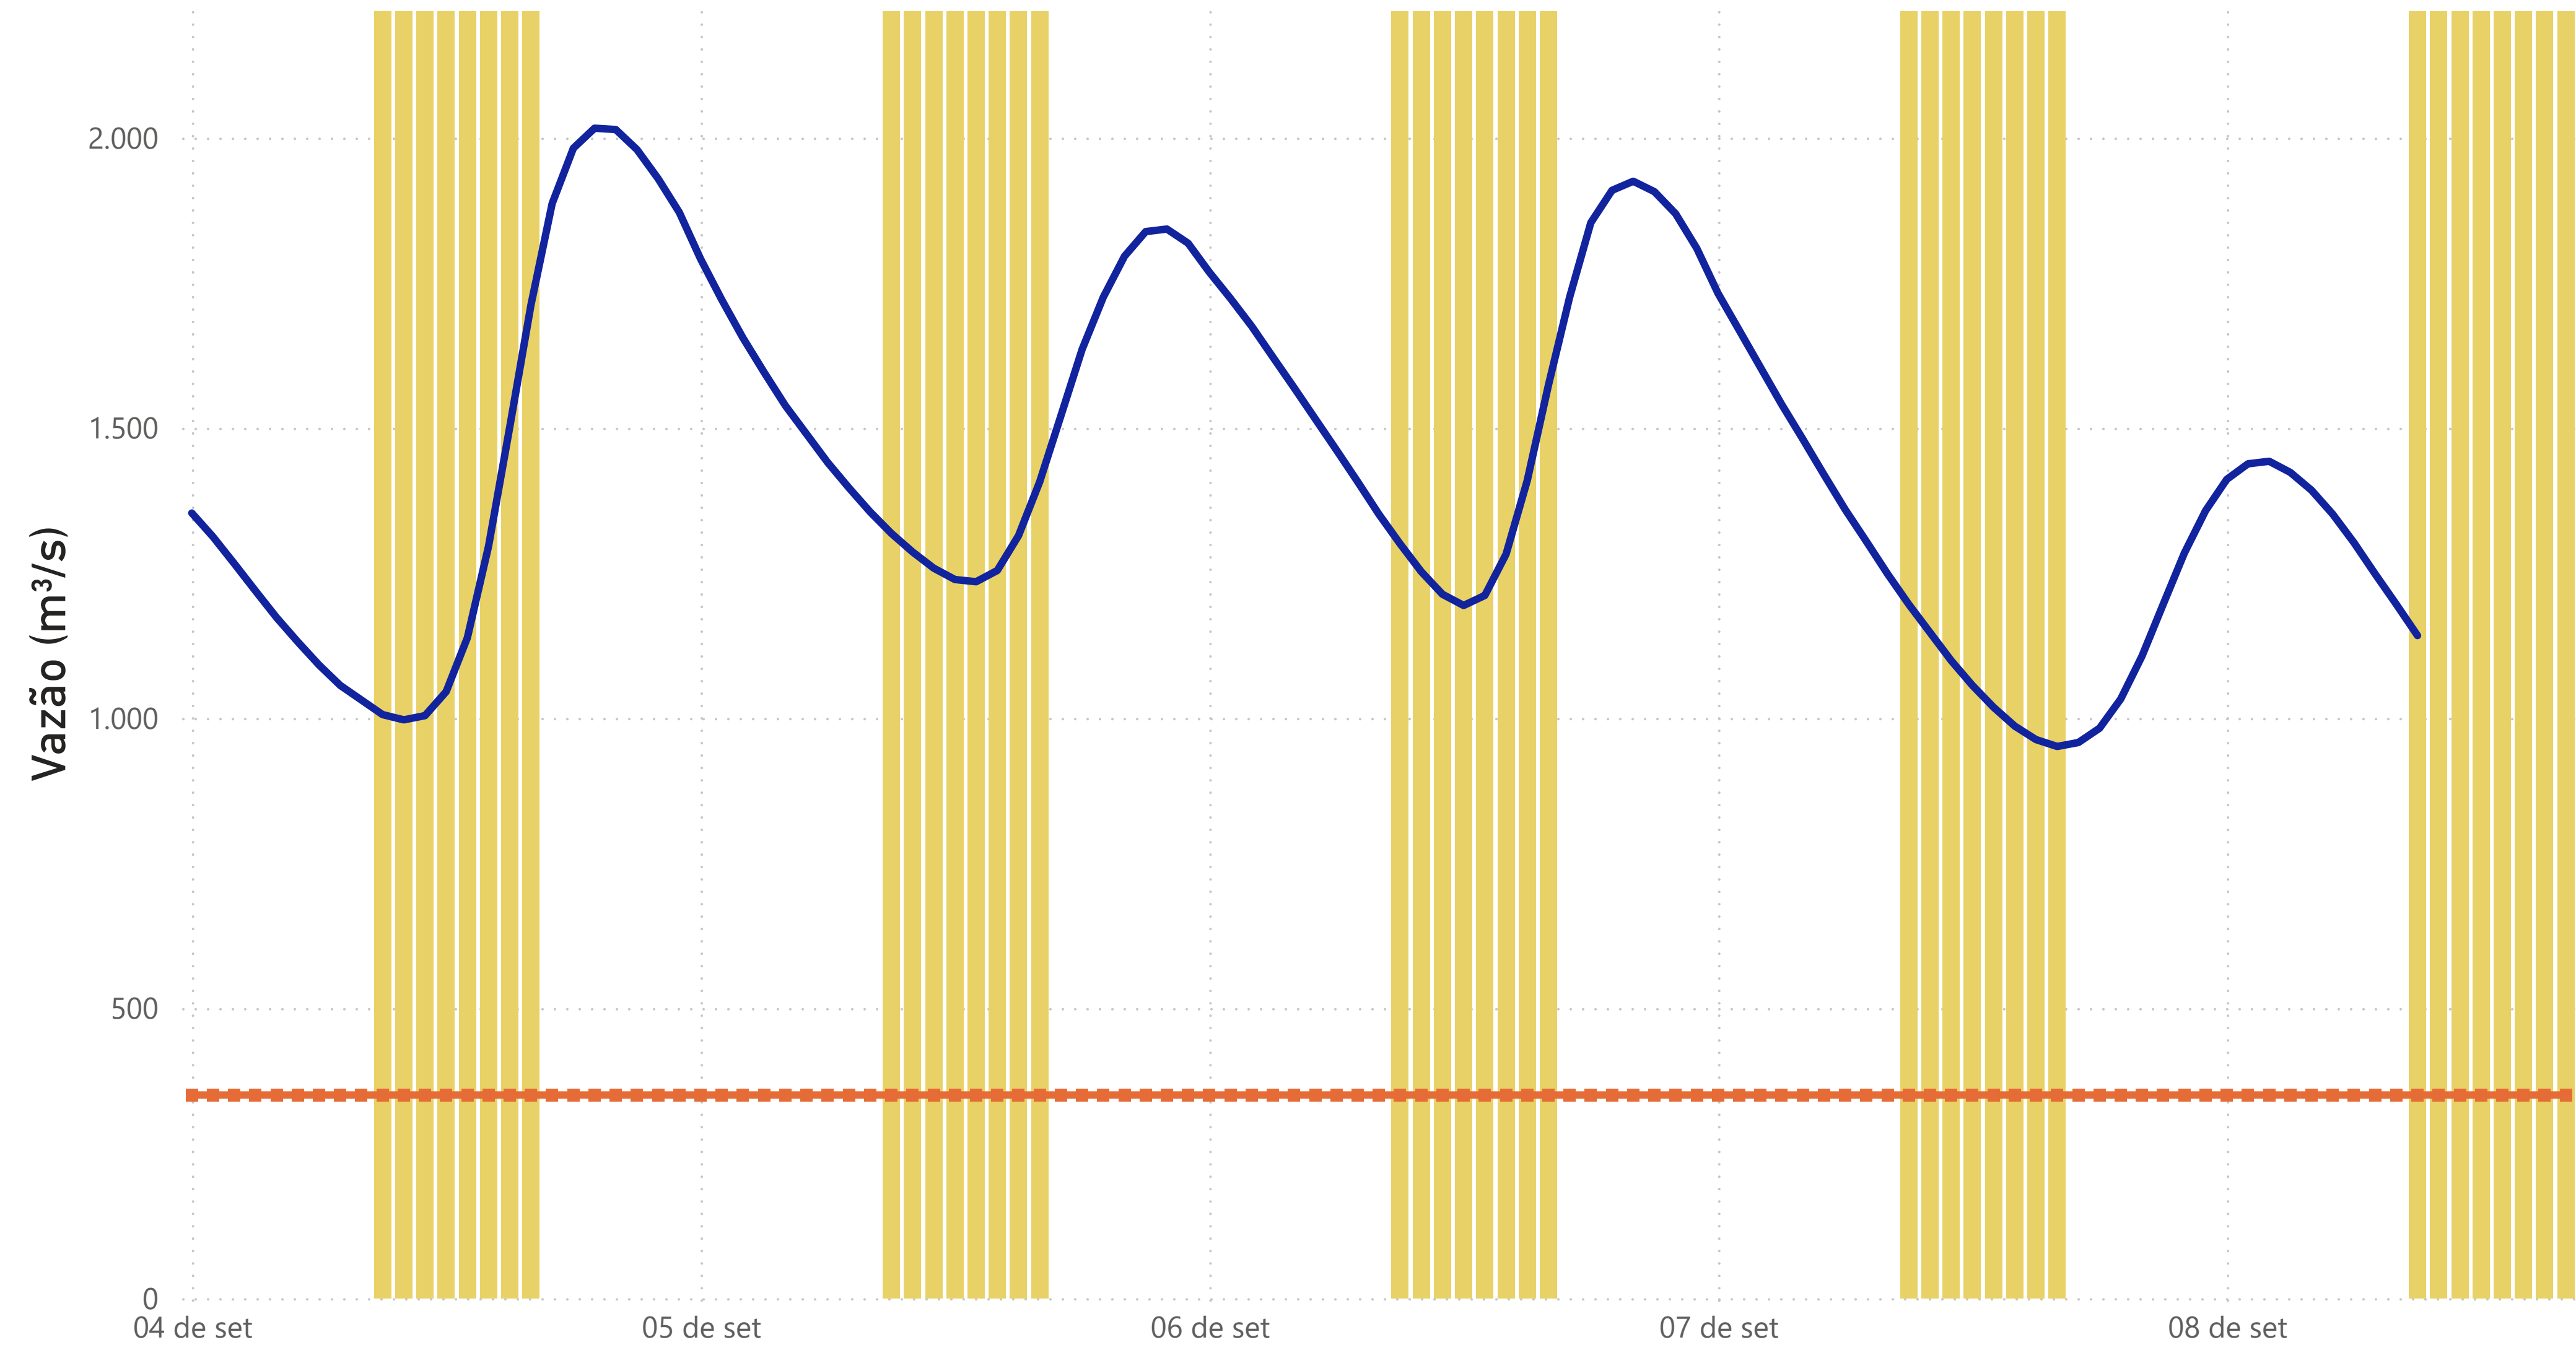

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

