

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/26	46,09	97	10
02/02/26	36,68	49	10
03/02/26	36,46	60	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
01/02/26	86	87
02/02/26	32	36
03/02/26	49	47

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/26	47,20	40	76
02/02/26	47,38	37	32
03/02/26	47,44	44	42

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
01/02/26	1.319
02/02/26	1.363
03/02/26	1.273
04/02/26	1.276
Atualizado em: 04/02/26 11:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
01/02/26	976	1.103
02/02/26	1.155	1.044
03/02/26	1.602	1.475

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
01/02/26	753	893
02/02/26	1.248	1.082
03/02/26	1.436	1.468

Data	Vazão Transferida (m³/s)
01/02/26	81
02/02/26	66
03/02/26	50


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
01/02/26	1.099	1.175
02/02/26	1.133	1.170
03/02/26	1.511	1.390

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/26	65,67	597	787
02/02/26	65,14	1.065	1.318
03/02/26	64,92	1.340	1.445

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/26	47,47	478	559
02/02/26	47,67	982	1.039
03/02/26	45,27	1.005	1.160

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
01/02/26	42,98	181	428
02/02/26	41,31	196	930
03/02/26	39,78	260	935

Estação Fluviométrica - Hotel Cataratas

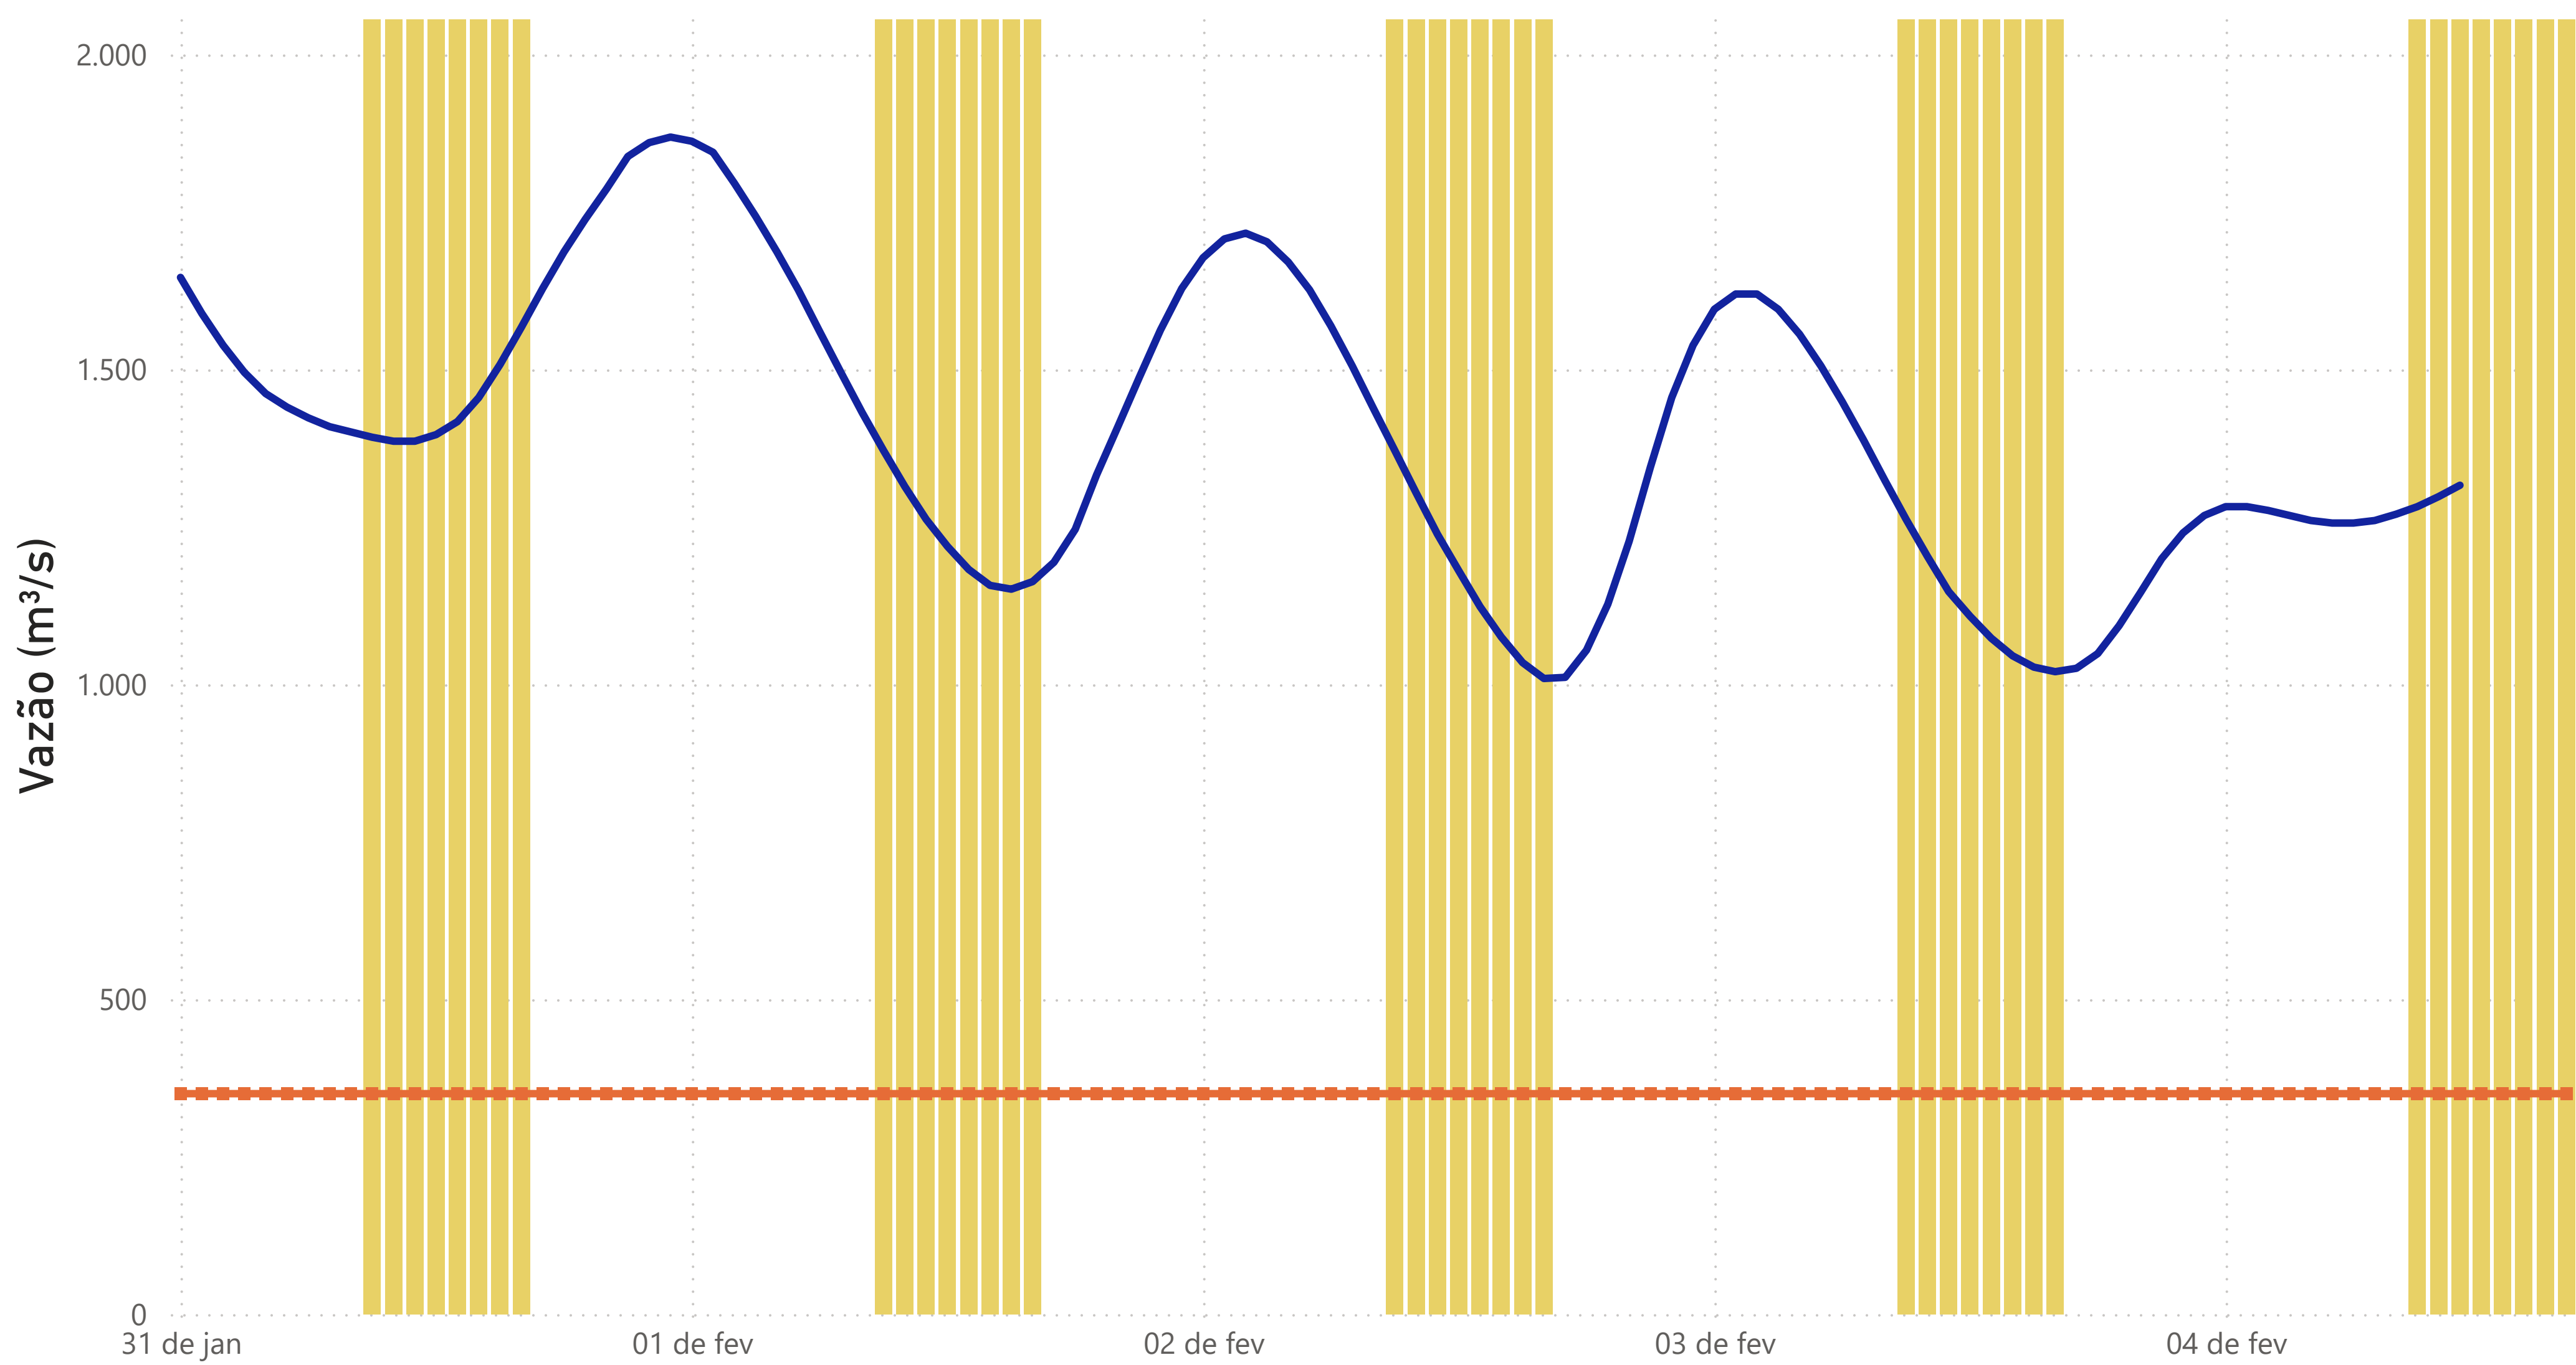

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

