

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
09/02/26	32,51	58	10
10/02/26	20,09	21	10
11/02/26	21,08	41	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
09/02/26	40	43
10/02/26	29	19
11/02/26	44	43

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
09/02/26	39,75	48	36
10/02/26	40,24	38	23
11/02/26	40,19	33	35

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
09/02/26	1.224
10/02/26	1.493
11/02/26	1.216
12/02/26	1.353
Atualizado em: 12/02/26 14:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
09/02/26	1.320	1.320
10/02/26	1.253	1.079
11/02/26	1.451	1.483

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
09/02/26	1.179	1.230
10/02/26	1.082	1.184
11/02/26	1.258	1.341

Data	Vazão Transferida (m³/s)
09/02/26	90
10/02/26	47
11/02/26	28


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
09/02/26	1.423	1.440
10/02/26	1.087	1.063
11/02/26	1.551	1.485

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
09/02/26	61,46	791	1.164
10/02/26	60,98	964	1.191
11/02/26	60,16	904	1.296

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
09/02/26	35,35	643	844
10/02/26	32,60	727	849
11/02/26	31,03	807	877

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
09/02/26	34,16	268	499
10/02/26	33,41	282	609
11/02/26	32,27	254	759

Estação Fluviométrica - Hotel Cataratas

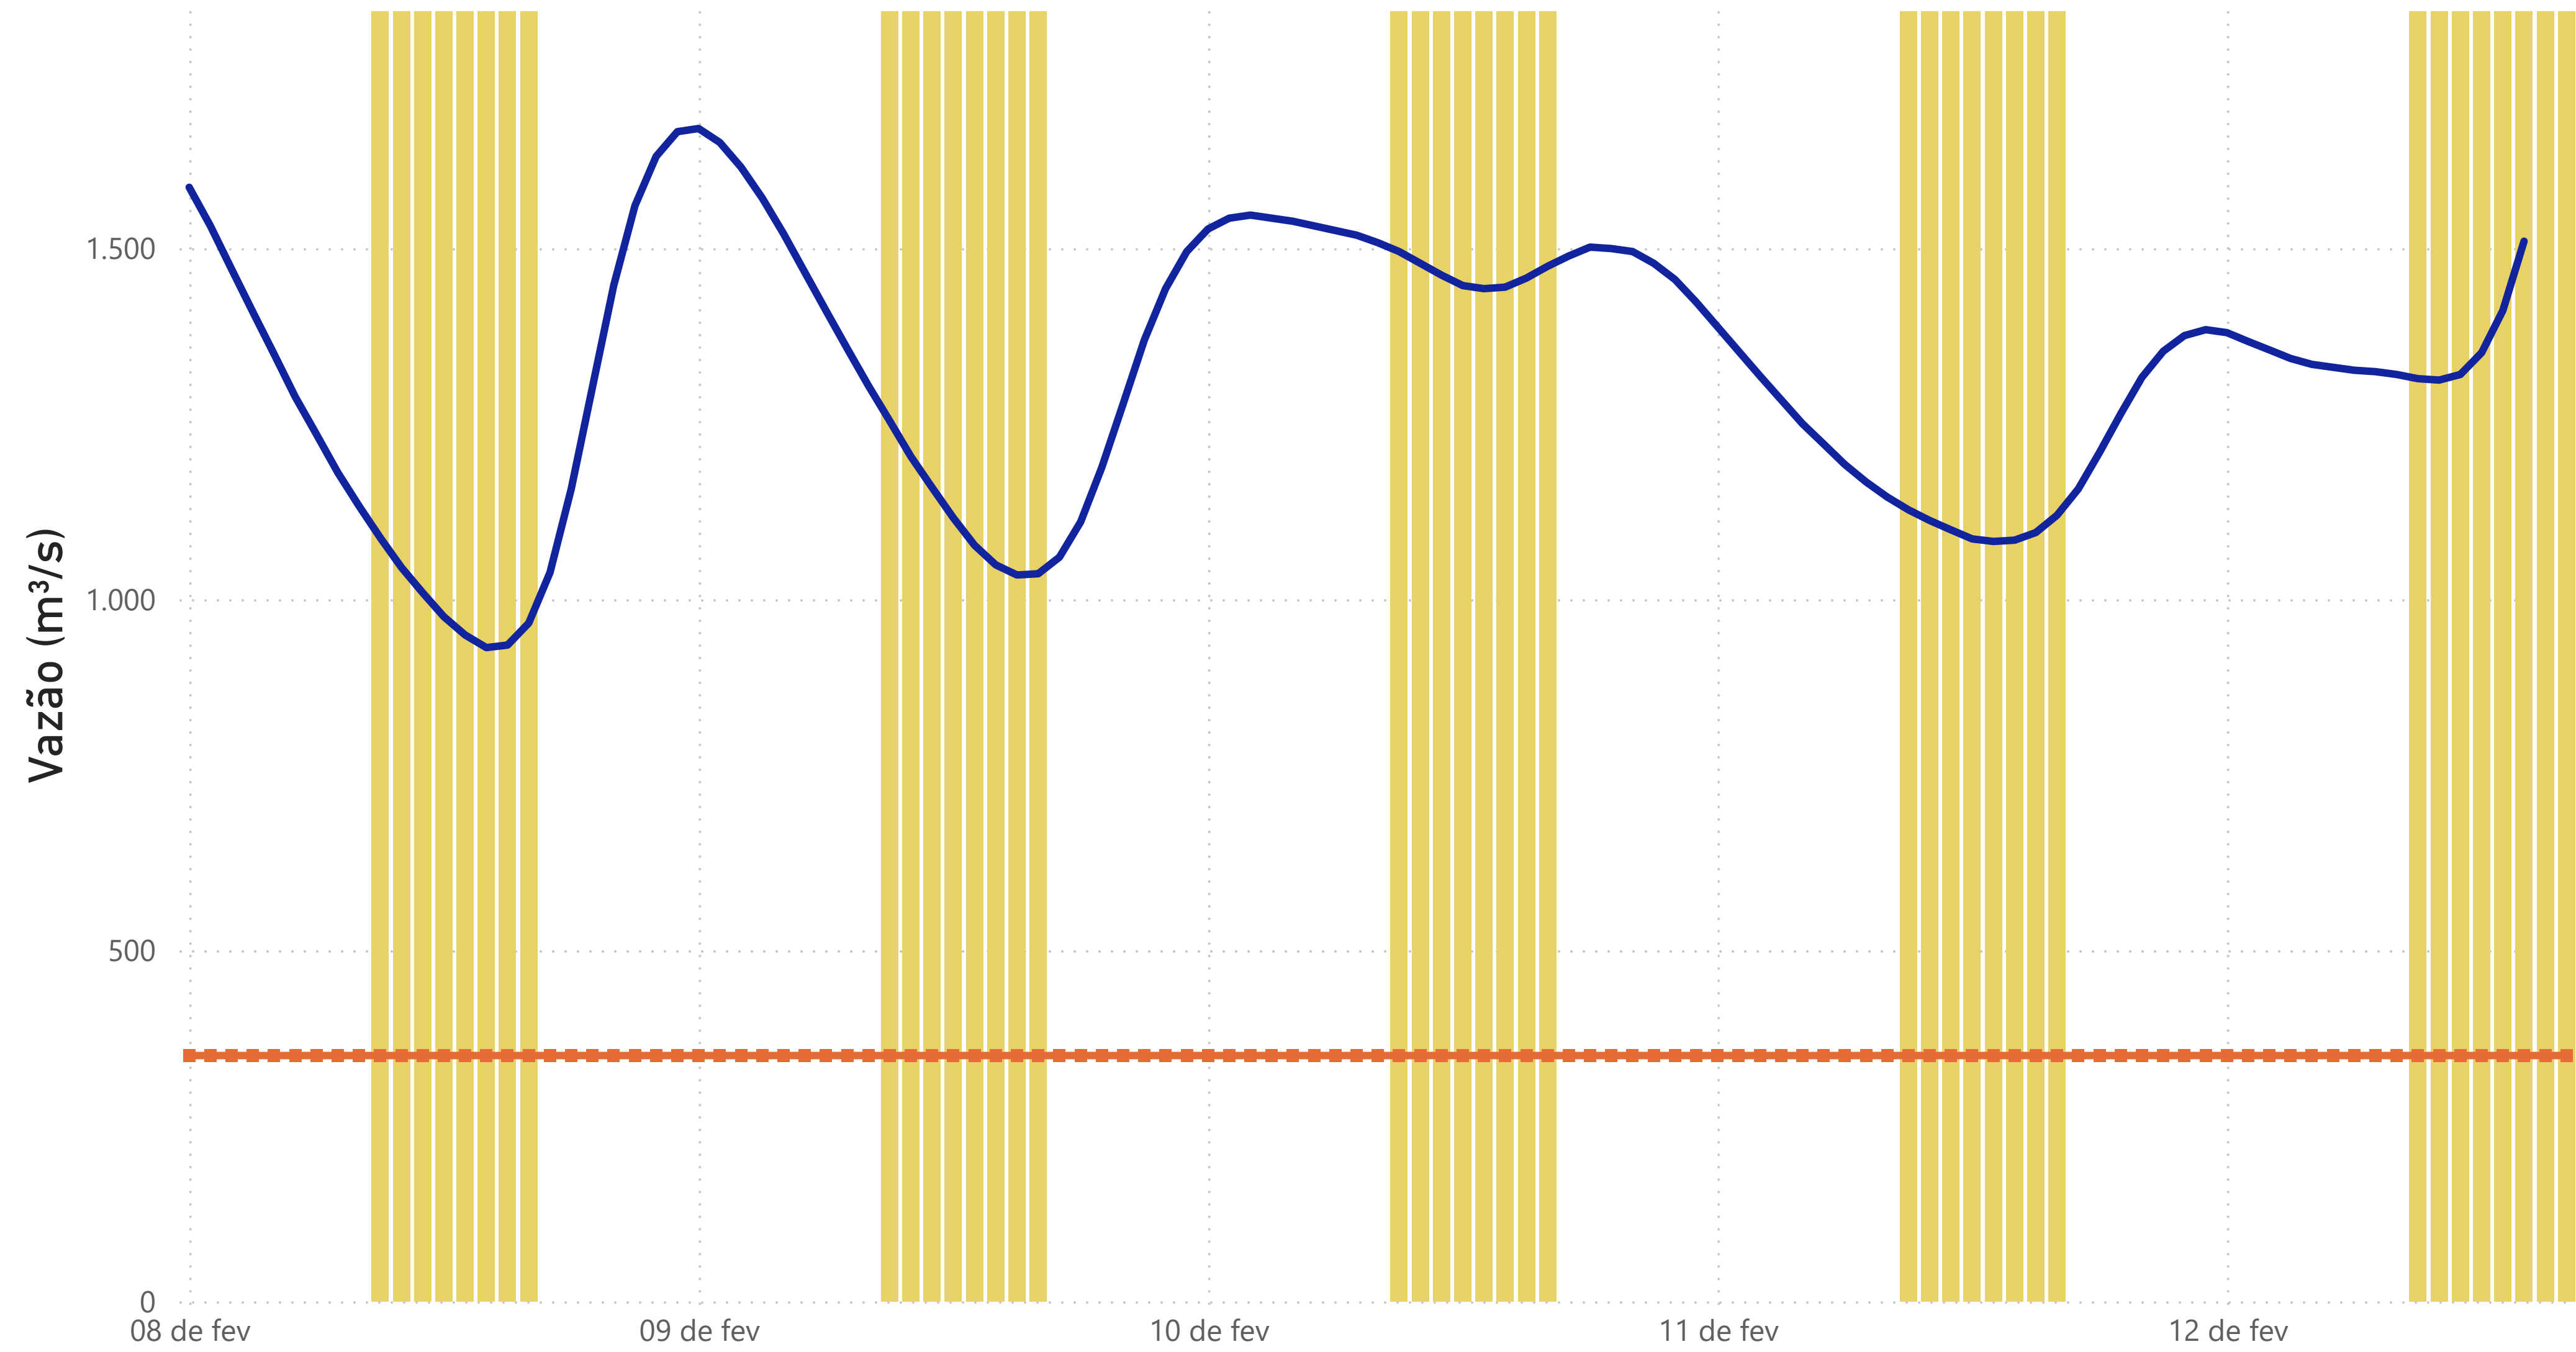

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

