

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/07/26	101,75	158	28
21/07/26	97,90	138	27
22/07/26	112,31	365	190

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
20/07/26	116	119
21/07/26	96	97
22/07/26	183	167

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/07/26	100,40	90	115
21/07/26	100,00	88	100
22/07/26	105,17	309	152

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
20/07/26	2.810
21/07/26	2.396
22/07/26	2.870
23/07/26	7.611
Atualizado em: 23/07/26 14:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
20/07/26	2.134	1.912
21/07/26	2.183	2.151
22/07/26	6.282	5.599

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
20/07/26	1.952	1.863
21/07/26	1.877	1.903
22/07/26	5.072	4.995

Data	Vazão Transferida (m³/s)
20/07/26	125
21/07/26	122
22/07/26	133


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
20/07/26	1.998	2.026
21/07/26	2.235	2.286
22/07/26	5.486	5.479

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/07/26	65,63	1.589	1.821
21/07/26	65,45	1.676	1.760
22/07/26	65,49	4.706	4.685

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/07/26	96,70	1.404	1.432
21/07/26	93,40	1.463	1.610
22/07/26	93,60	3.224	3.215

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/07/26	95,48	1.019	1.111
21/07/26	94,96	910	1.141
22/07/26	95,48	1.966	1.735

Estação Fluviométrica - Hotel Cataratas

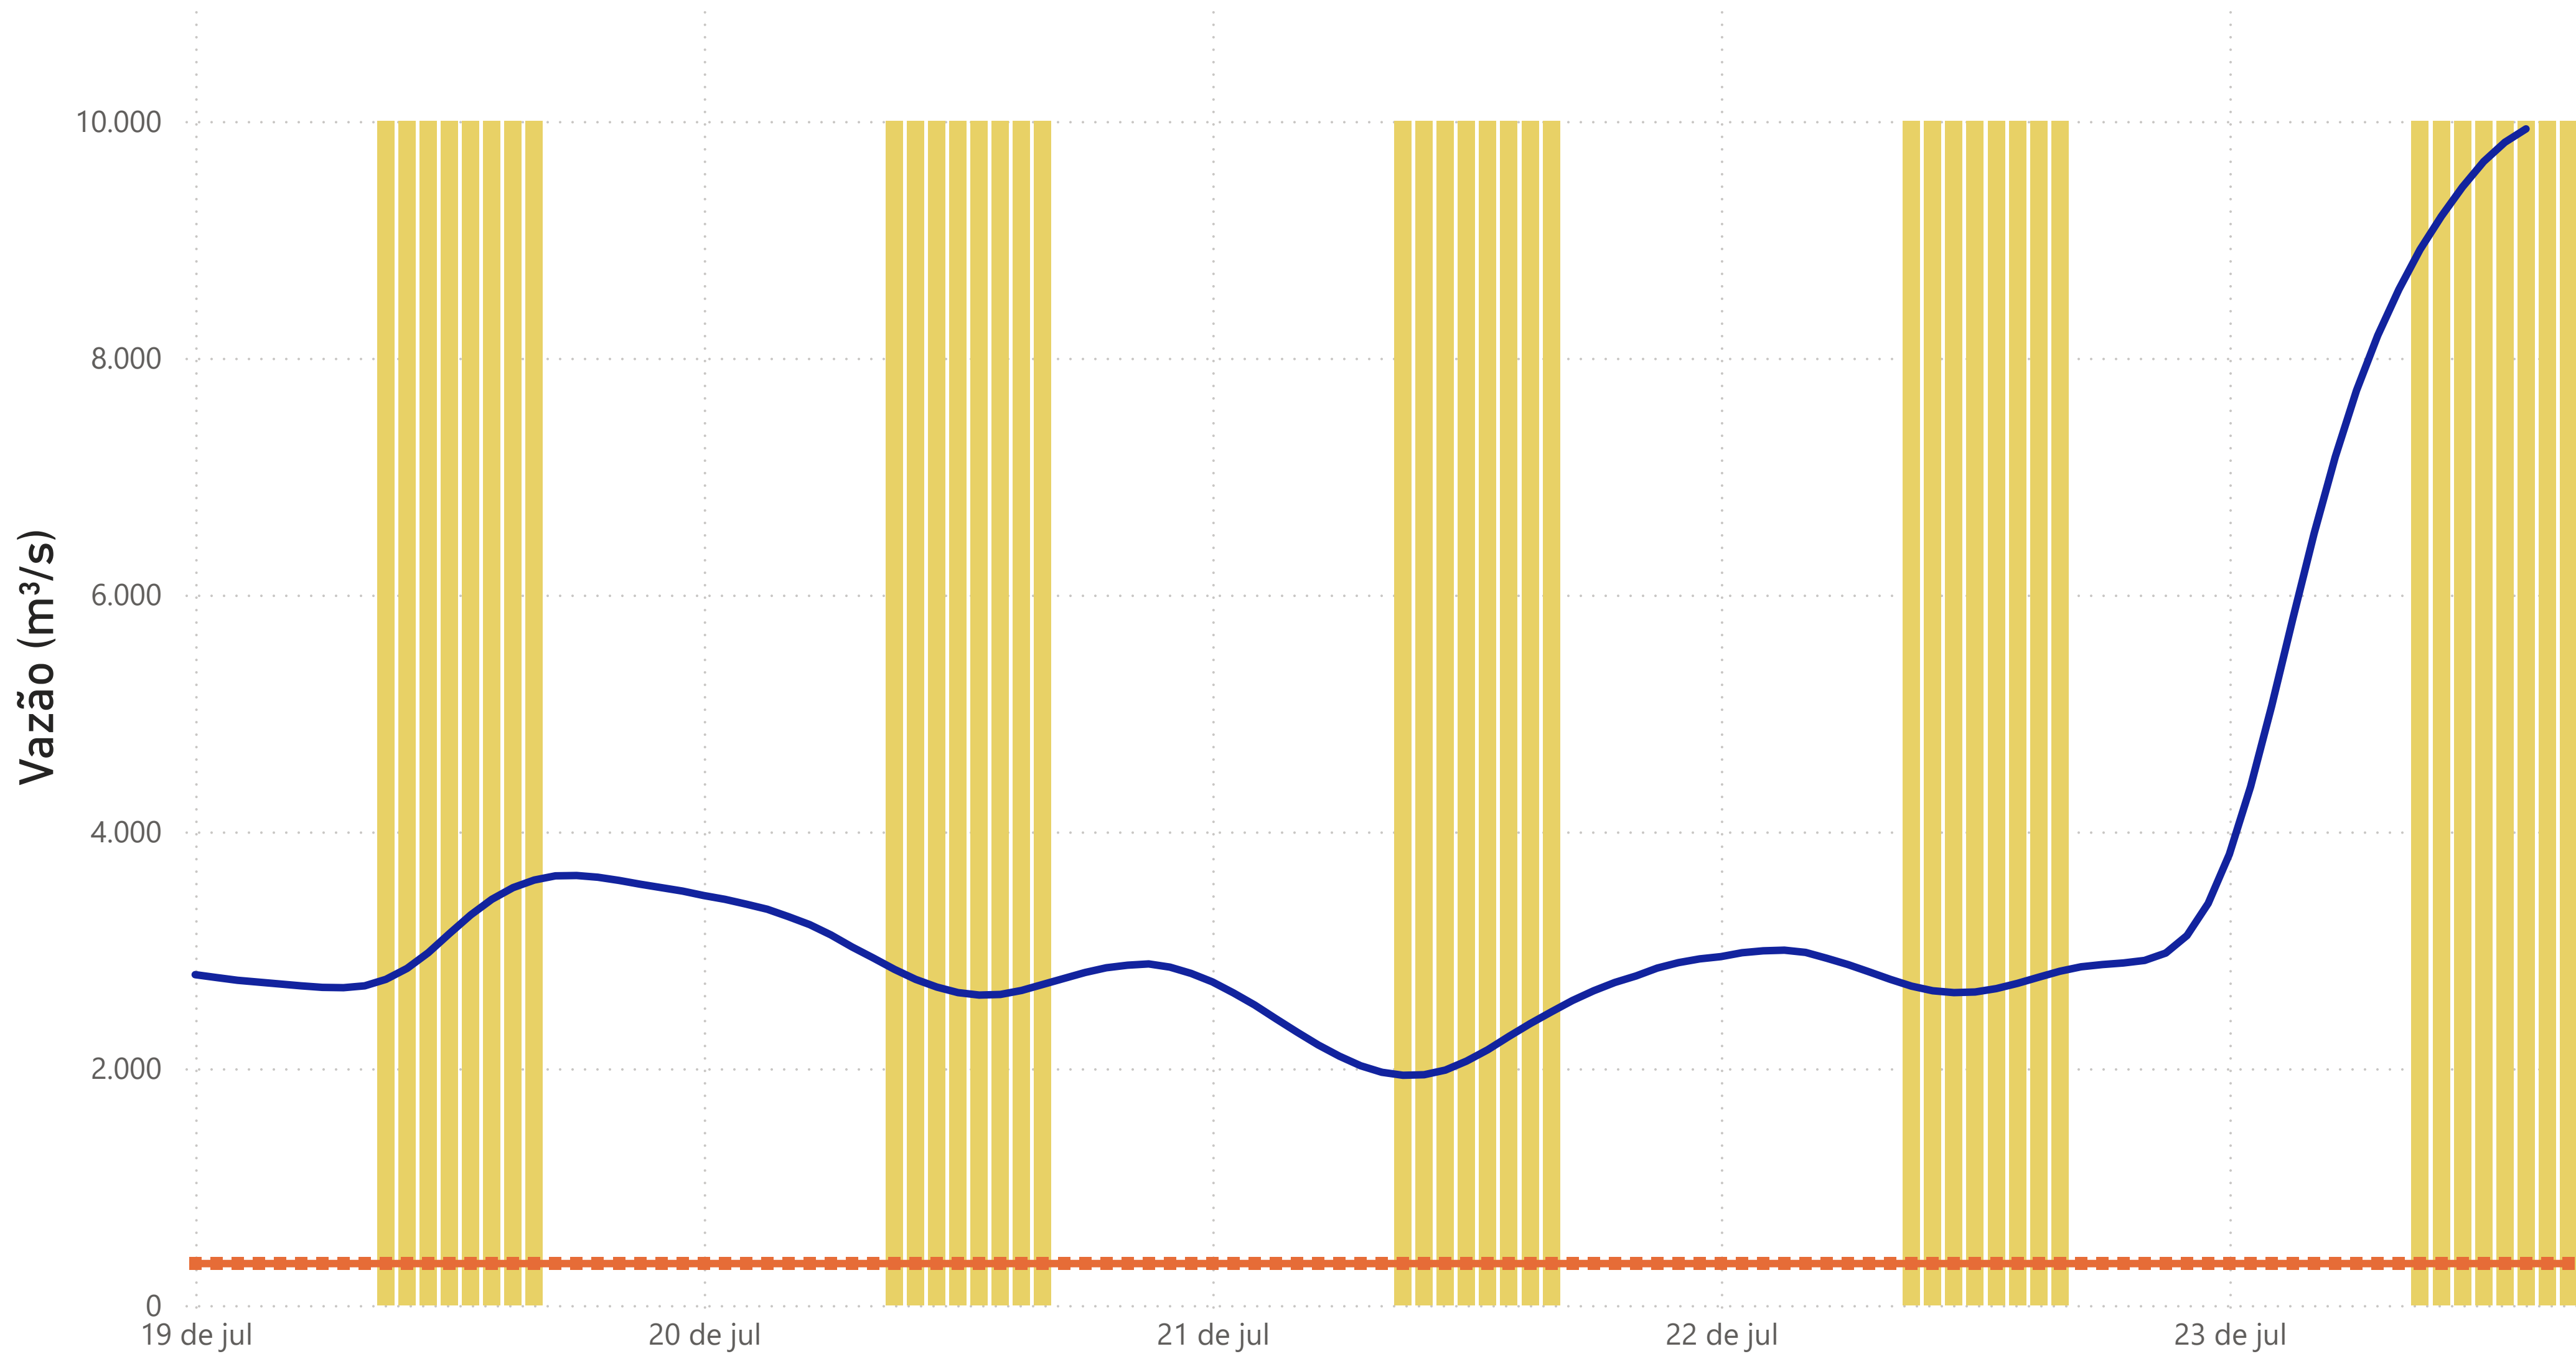

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

