

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/09/24	41,60	68	10
21/09/24	38,03	52	10
22/09/24	38,70	56	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
20/09/24	36	38
21/09/24	23	25
22/09/24	39	35

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/09/24	39,48	66	29
21/09/24	41,69	86	19
22/09/24	43,95	106	37

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
20/09/24	1.224
21/09/24	1.459
22/09/24	1.213
23/09/24	1.343
Atualizado em: 23/09/24 09:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
20/09/24	1.208	1.208
21/09/24	920	999
22/09/24	942	1.021

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
20/09/24	1.062	1.043
21/09/24	734	721
22/09/24	620	697

Data	Vazão Transferida (m³/s)
20/09/24	39
21/09/24	52
22/09/24	43


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
20/09/24	1.164	1.154
21/09/24	904	952
22/09/24	905	908

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/09/24	85,57	779	1.054
21/09/24	85,86	852	715
22/09/24	85,96	634	588

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/09/24	52,65	523	694
21/09/24	53,45	622	638
22/09/24	54,05	555	571

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
20/09/24	40,05	847	392
21/09/24	41,24	1.009	485
22/09/24	42,37	948	451

Estação Fluviométrica - Hotel Cataratas

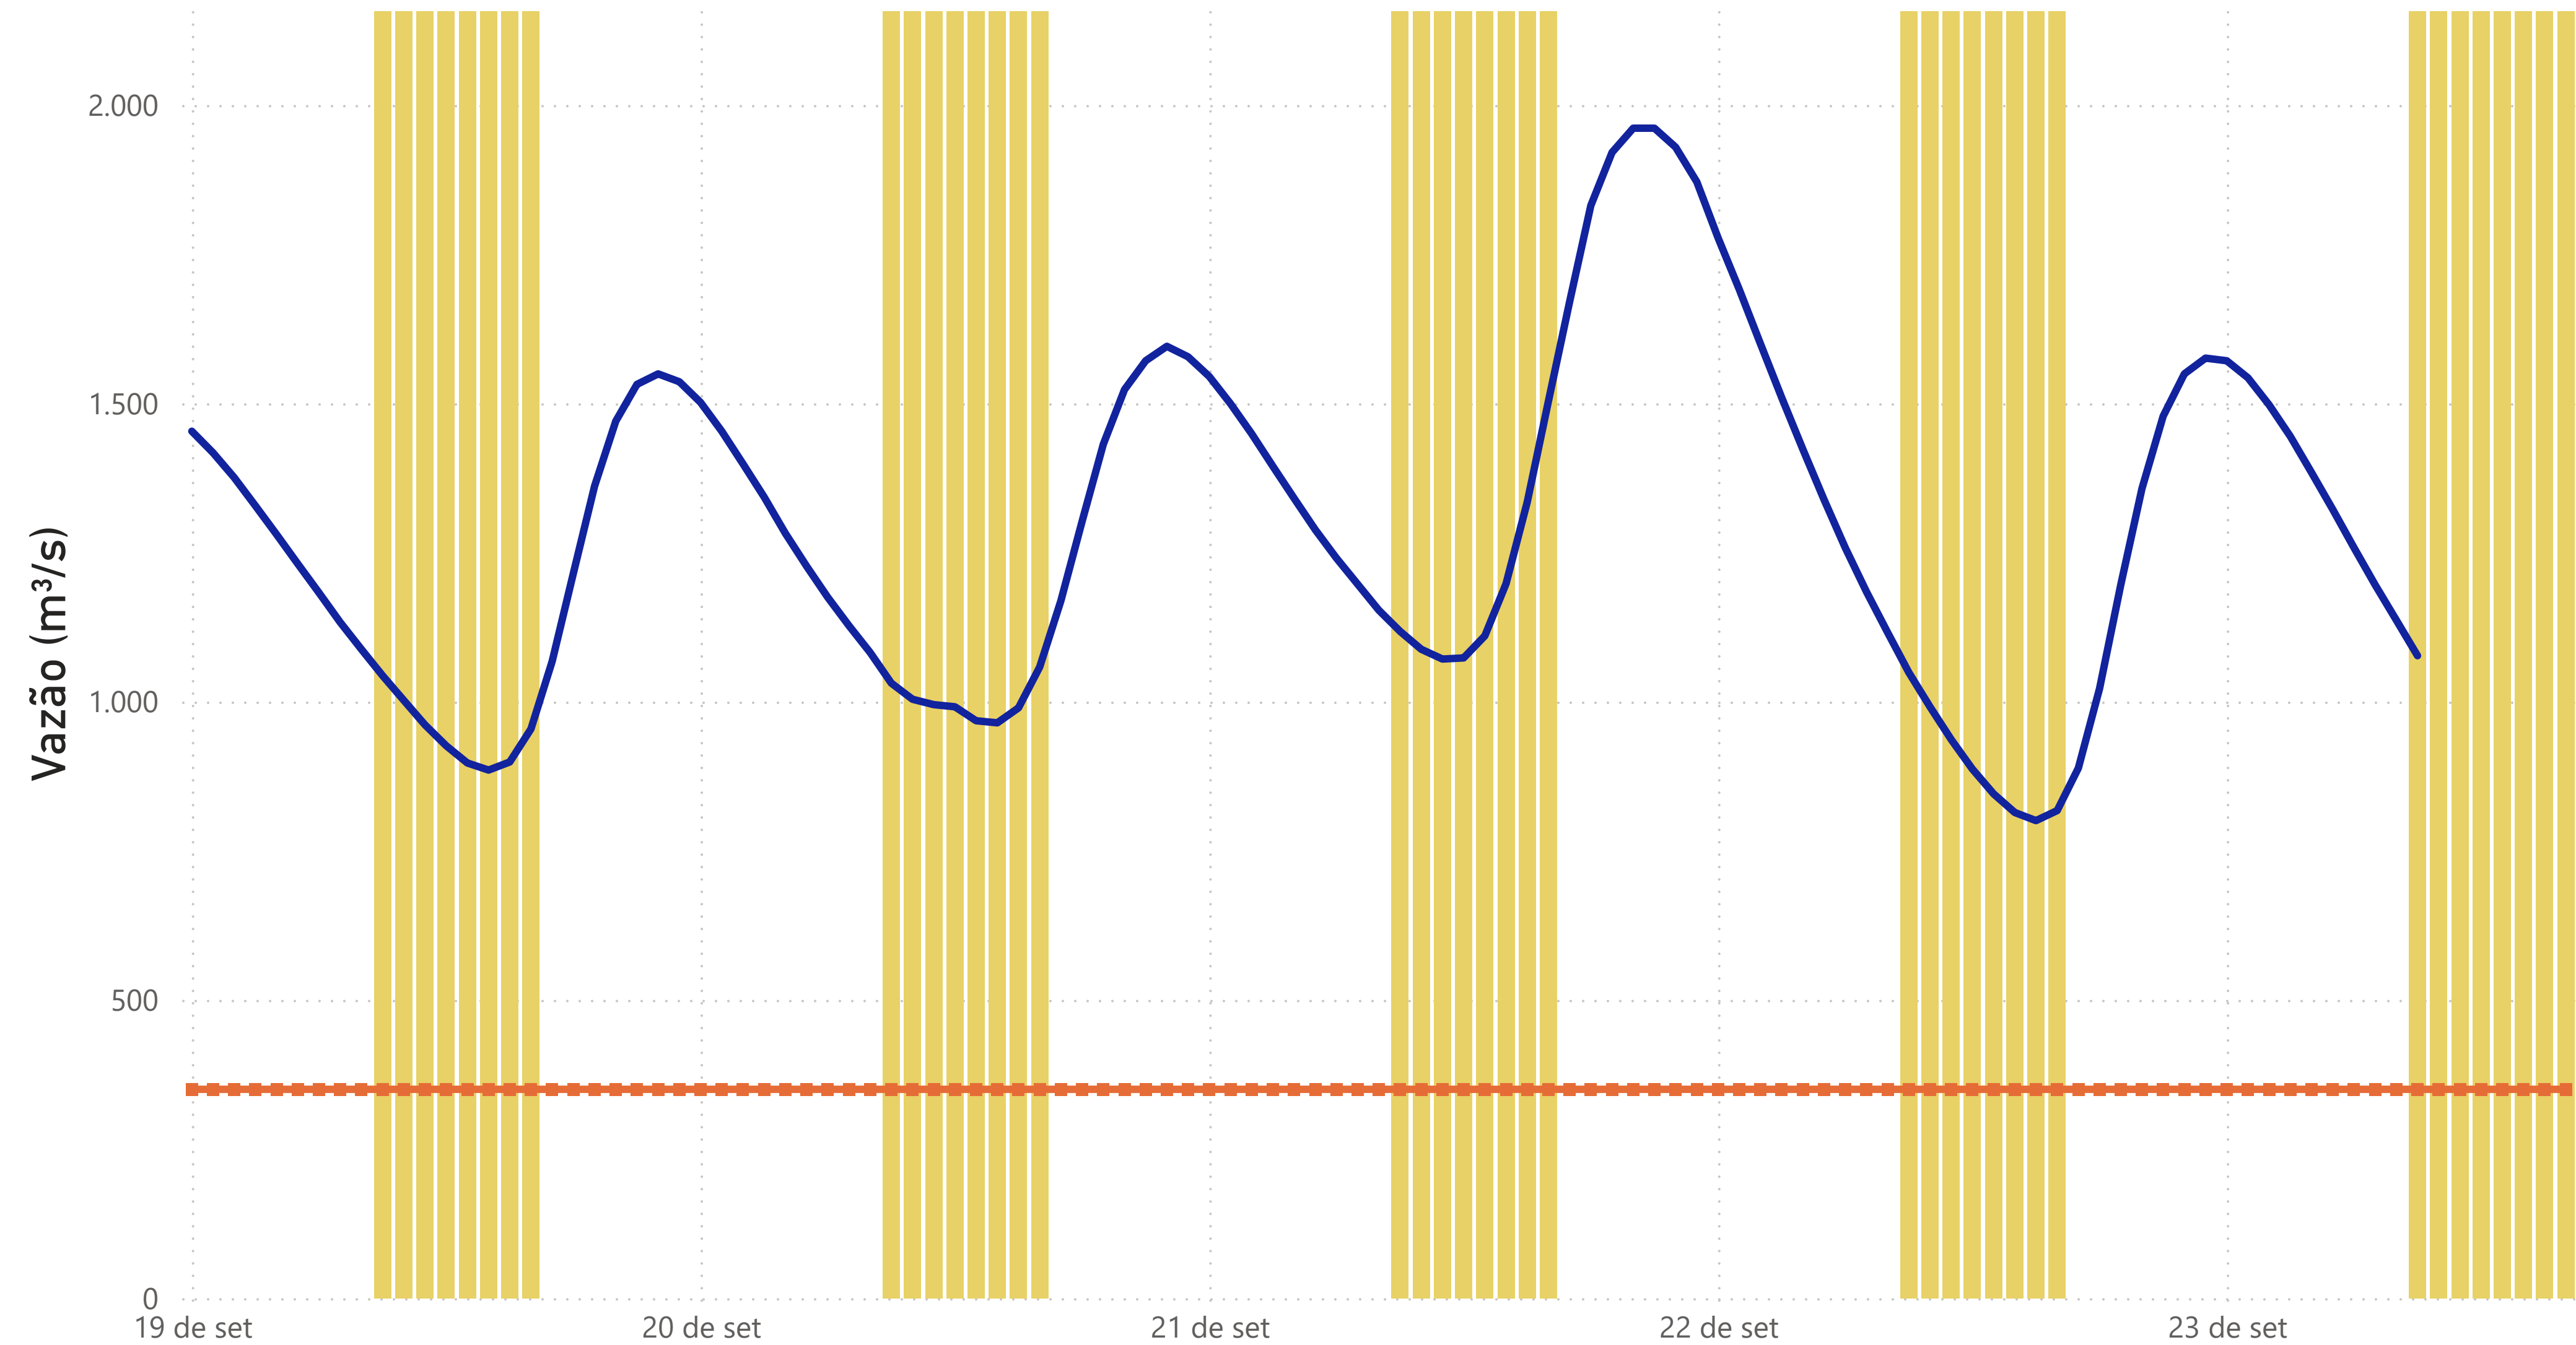

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

