

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
22/09/24	39,02	56	10
23/09/24	43,87	73	10
24/09/24	48,67	83	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
22/09/24	39	35
23/09/24	51	55
24/09/24	74	67

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
22/09/24	43,95	106	37
23/09/24	45,03	83	50
24/09/24	44,74	69	78

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
22/09/24	1.102
23/09/24	1.170
24/09/24	1.542
25/09/24	1.708
Atualizado em: 25/09/24 10:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
22/09/24	942	1.021
23/09/24	1.330	1.441
24/09/24	1.198	1.610

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
22/09/24	620	697
23/09/24	1.044	1.146
24/09/24	1.070	1.026

Data	Vazão Transferida (m³/s)
22/09/24	43
23/09/24	49
24/09/24	58


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
22/09/24	905	908
23/09/24	1.273	1.270
24/09/24	1.615	1.529

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
22/09/24	85,96	634	588
23/09/24	86,20	1.172	1.057
24/09/24	86,15	1.061	1.084

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
22/09/24	54,25	606	571
23/09/24	54,05	1.067	1.076
24/09/24	56,64	1.146	1.031

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
22/09/24	42,37	948	451
23/09/24	42,16	841	934
24/09/24	41,74	796	979

Estação Fluviométrica - Hotel Cataratas

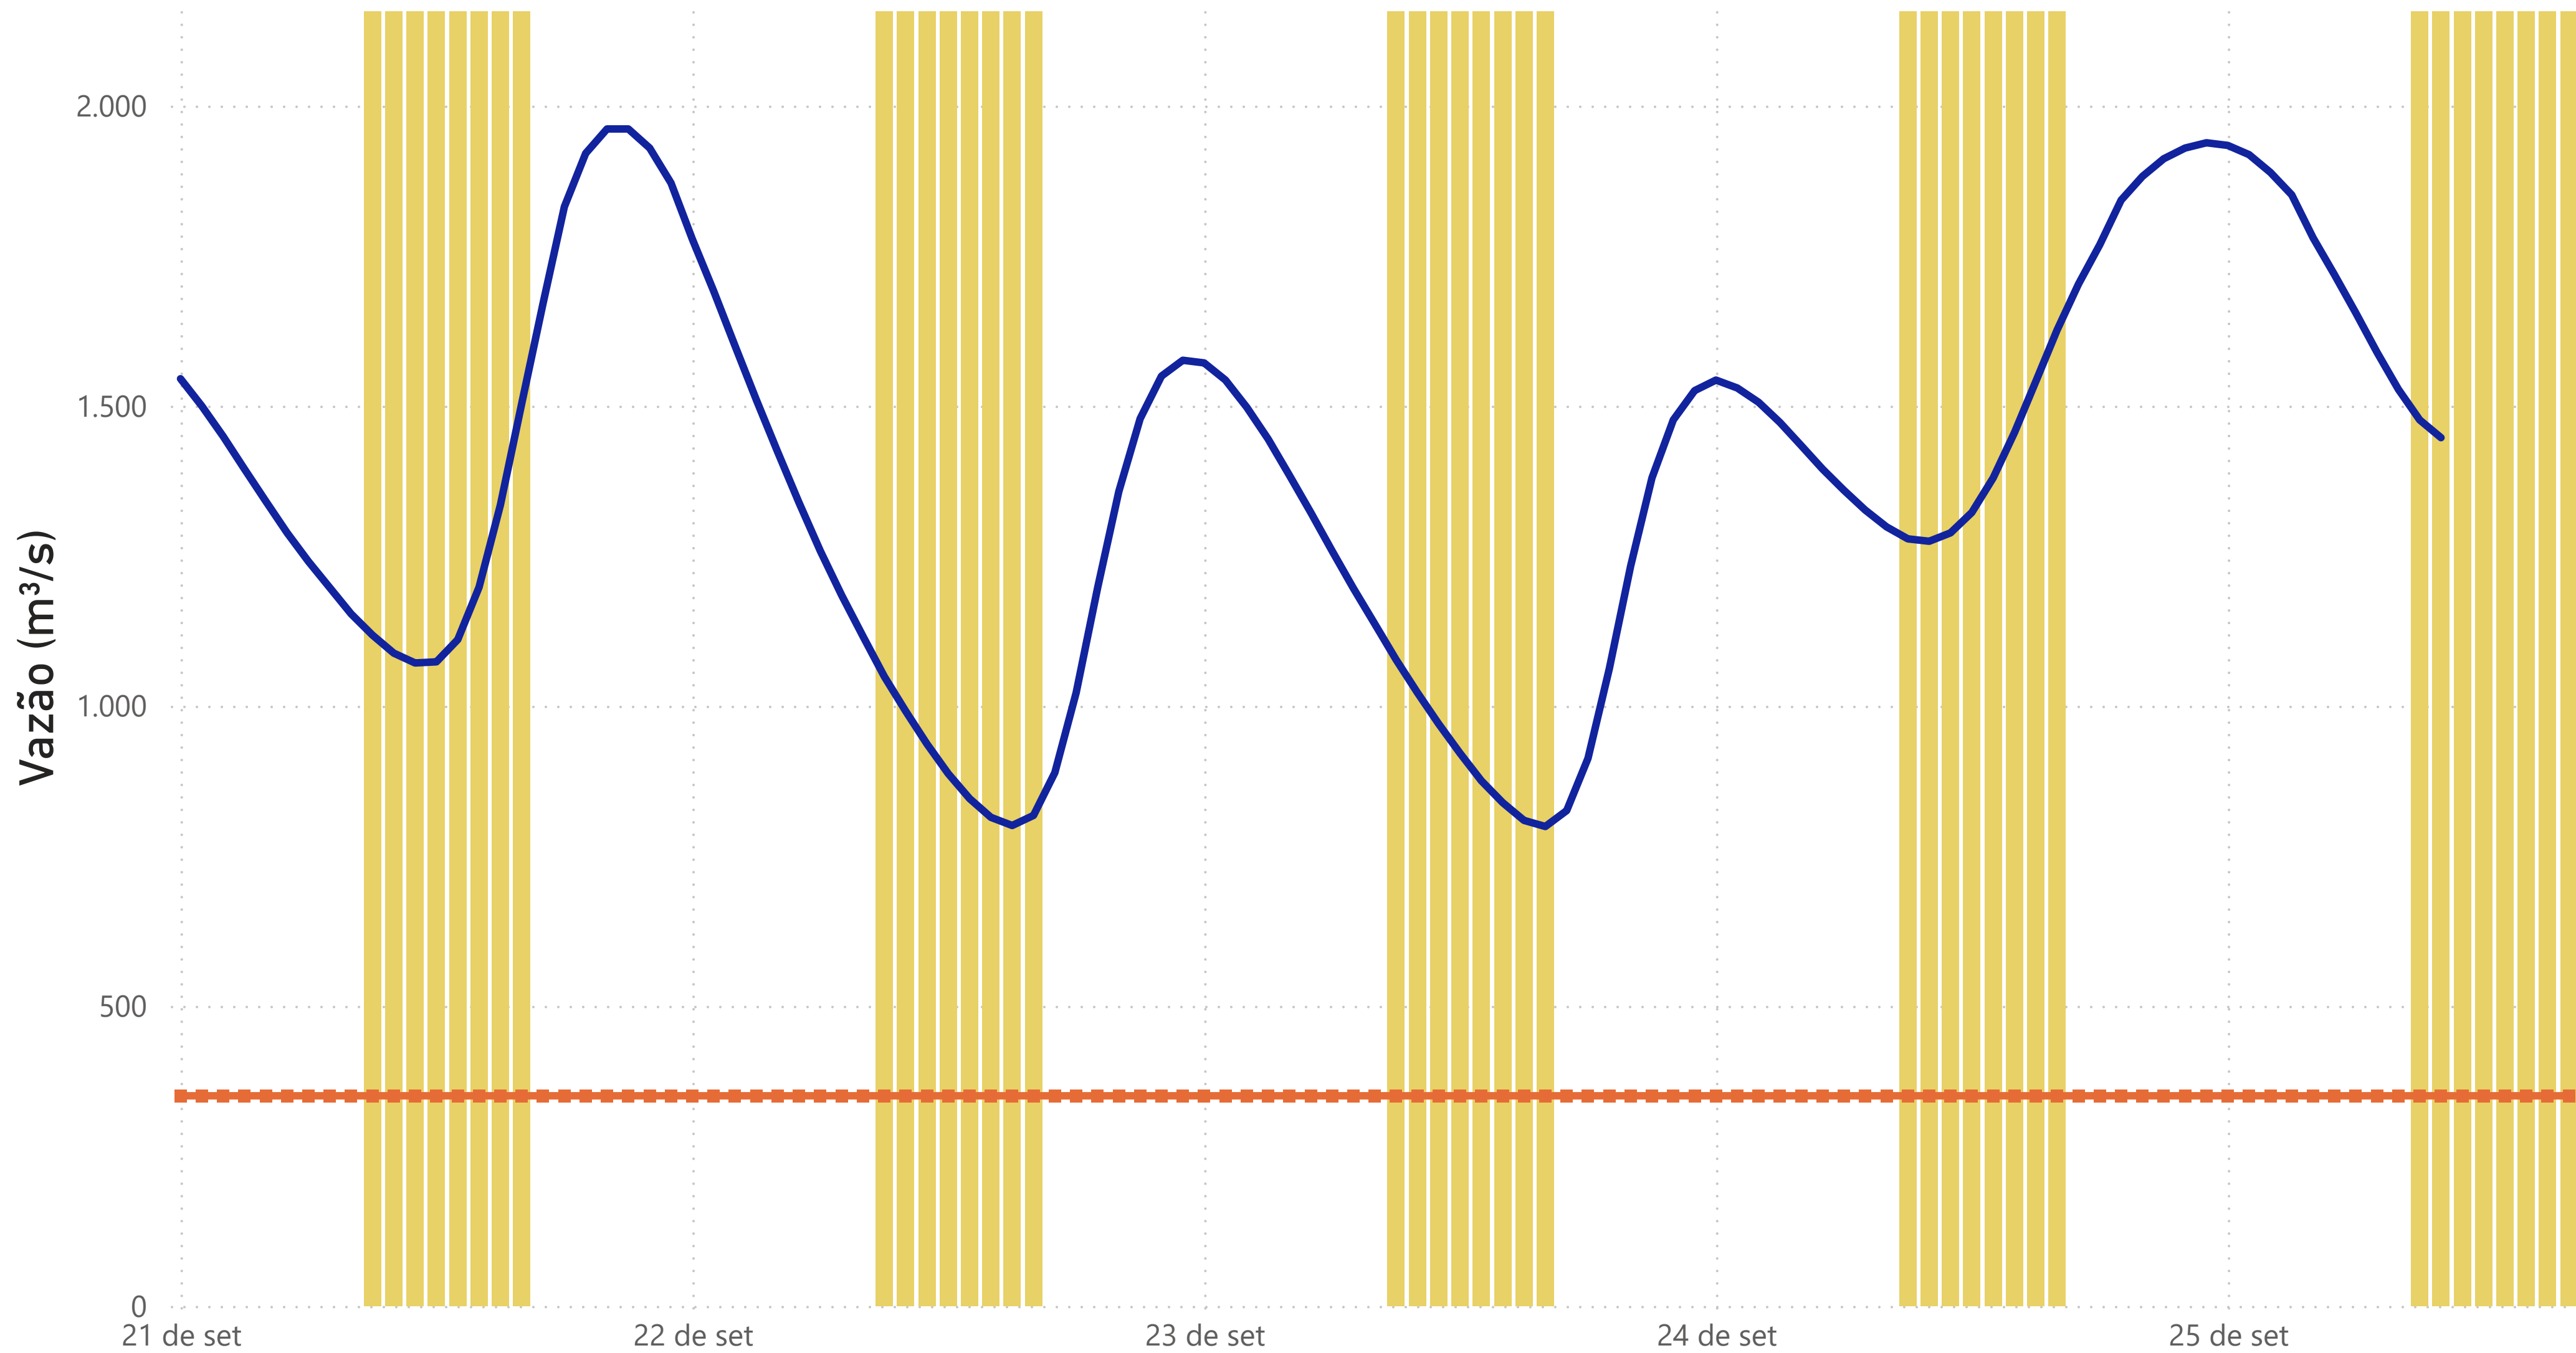

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m³/s) ■ Vazão mínima para beleza cênica (350 m³/s)

