

Legenda:

-  Usina com reservatório
-  Usina a fio d'água
-  Estação fluviométrica

Jordão			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
04/10/24	44,86	66	11
05/10/24	42,12	59	10
06/10/24	36,83	45	10

Fundão		
Data	Aflu (m³/s)	Deflu (m³/s)
04/10/24	56	51
05/10/24	41	46
06/10/24	25	27

Santa Clara			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
04/10/24	40,57	31	50
05/10/24	40,41	34	39
06/10/24	40,68	34	26

UHE Itaipu Hotel Cataratas	
Data	Q diária (m³/s)
04/10/24	1.059
05/10/24	1.088
06/10/24	1.025
07/10/24	1.056
Atualizado em: 07/10/24 08:00	

Salto Caxias		
Data	Aflu (m³/s)	Deflu (m³/s)
04/10/24	1.085	1.037
05/10/24	944	928
06/10/24	617	680

Salto Osório		
Data	Aflu (m³/s)	Deflu (m³/s)
04/10/24	940	966
05/10/24	674	846
06/10/24	592	528

Data	Vazão Transferida (m³/s)
04/10/24	52
05/10/24	57
06/10/24	49


Baixo Iguaçu		
Data	Aflu (m³/s)	Deflu (m³/s)
04/10/24	887	915
05/10/24	927	865
06/10/24	694	704

Salto Santiago			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
04/10/24	85,82	798	958
05/10/24	85,33	470	699
06/10/24	84,81	342	593

Segredo			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
04/10/24	54,65	494	696
05/10/24	53,65	367	468
06/10/24	50,86	135	308

Foz do Areia			
Data	V.U. (%)	Aflu (m³/s)	Deflu (m³/s)
04/10/24	34,68	417	427
05/10/24	34,83	382	315
06/10/24	35,58	389	60

Estação Fluviométrica - Hotel Cataratas

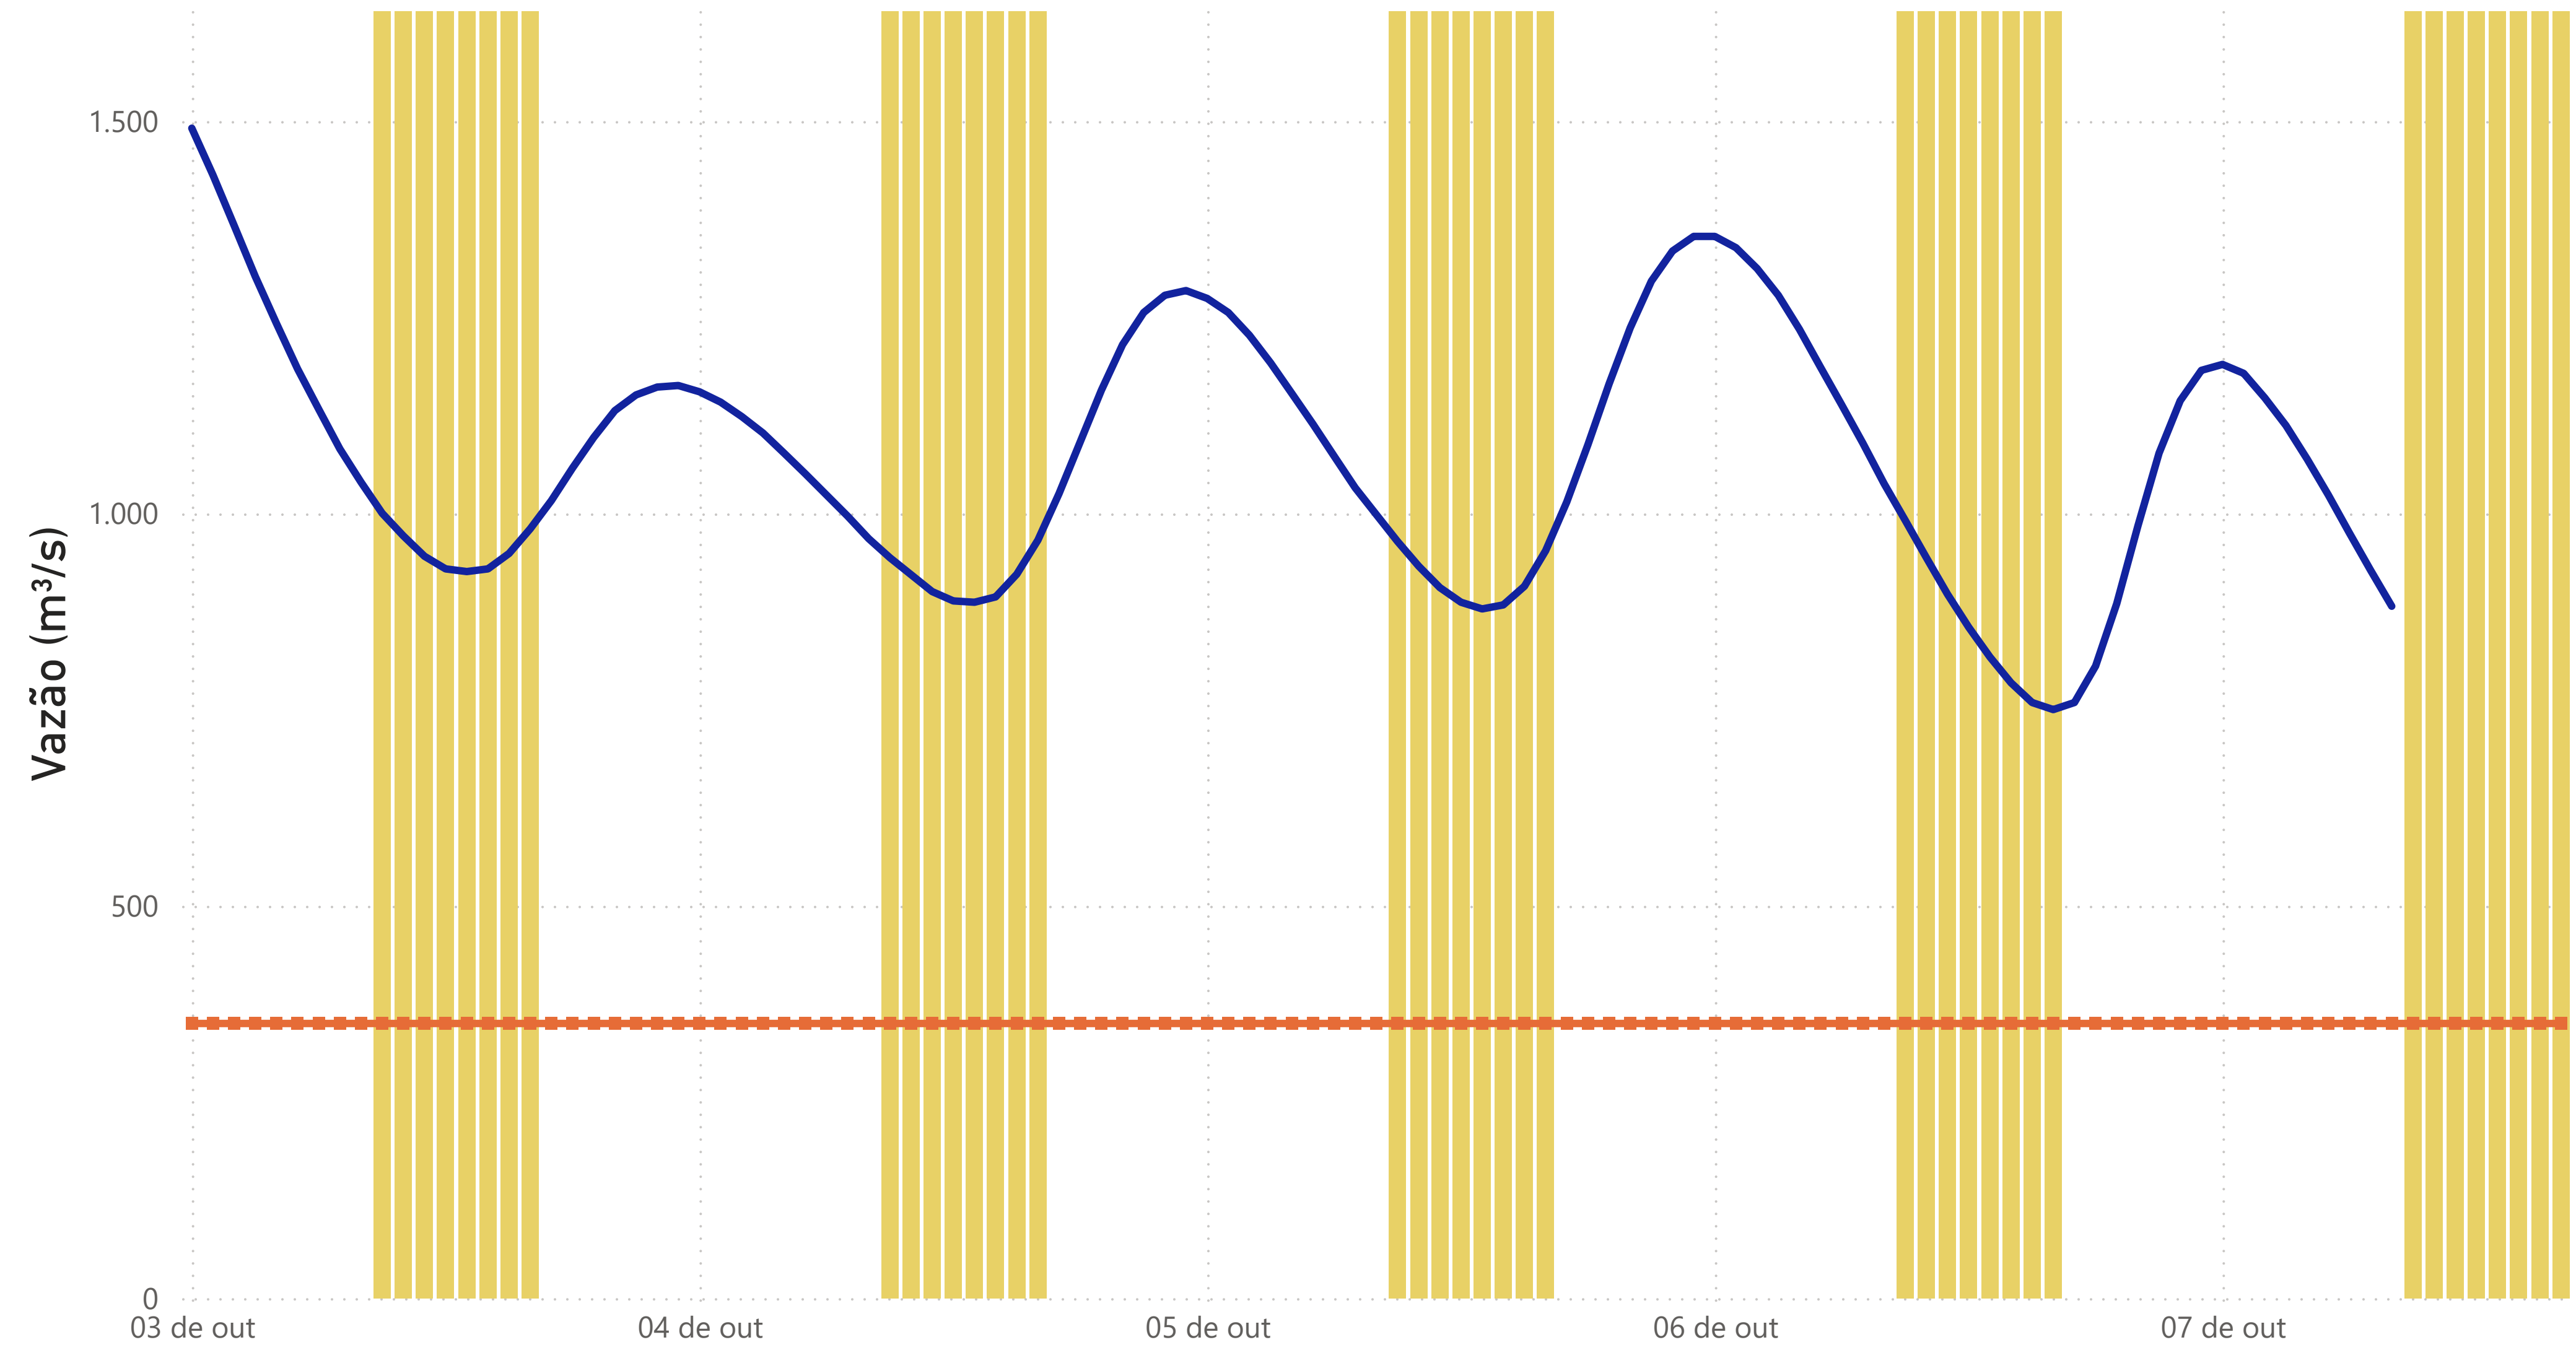

● Funcionamento do Parque Nacional do Iguaçu (das 9h às 16h) ● Vazão (m^3/s) ■ Vazão mínima para beleza cênica ($350 \text{ m}^3/\text{s}$)

