

Legenda:



Usina com reservatório



Usina a fio d'água

Saiba mais sobre [as condições de operação do Sistema Hídrico do Rio Paranapanema](#)

Rosana

Data	Aflu (m³/s)	Deflu (m³/s)
13/09	4.312	4.459
14/09	4.585	4.609
15/09	4.809	4.687
16/09	4.770	4.647

Capivara

Data	Aflu (m³/s)	Deflu (m³/s)	V.U. (%)
13/09	4.452	3.931	95,13
14/09	5.055	4.271	96,31
15/09	4.365	4.365	96,31
16/09	3.528	4.442	94,93

Canoas I

Data	Aflu (m³/s)	Deflu (m³/s)
13/09	341	311
14/09	469	486
15/09	393	390
16/09	345	345

Canoas II

Data	Aflu (m³/s)	Deflu (m³/s)
13/09	307	291
14/09	413	416
15/09	350	355
16/09	335	319

Ourinhos

Data	Aflu (m³/s)	Deflu (m³/s)
13/09	129	124
14/09	142	140
15/09	120	124
16/09	182	179

Piraju

Data	Aflu (m³/s)	Deflu (m³/s)
13/09	110	108
14/09	110	110
15/09	110	110
16/09	102	108

Taquaruçu

Data	Aflu (m³/s)	Deflu (m³/s)
13/09	4.126	3.879
14/09	4.394	4.377
15/09	4.428	4.470
16/09	4.435	4.443

Mauá

Data	Aflu (m³/s)	Deflu (m³/s)	V.U. (%)
13/09	2.299	2.280	97,76
14/09	1.911	1.959	97,14
15/09	1.659	1.640	97,39
16/09	1.519	1.461	98,13

Salto Grande



Data	Aflu (m³/s)	Deflu (m³/s)
13/09	328	296
14/09	355	392
15/09	343	341
16/09	385	314

Chavantes

Data	Aflu (m³/s)	Deflu (m³/s)	V.U. (%)
13/09	930	124	67,05
14/09	856	130	69,11
15/09	765	121	70,94
16/09	615	227	72,04

Jurumirim

Data	Aflu (m³/s)	Deflu (m³/s)	V.U. (%)
13/09	544	91	56,13
14/09	683	92	57,74
15/09	641	92	59,24
16/09	559	100	60,49

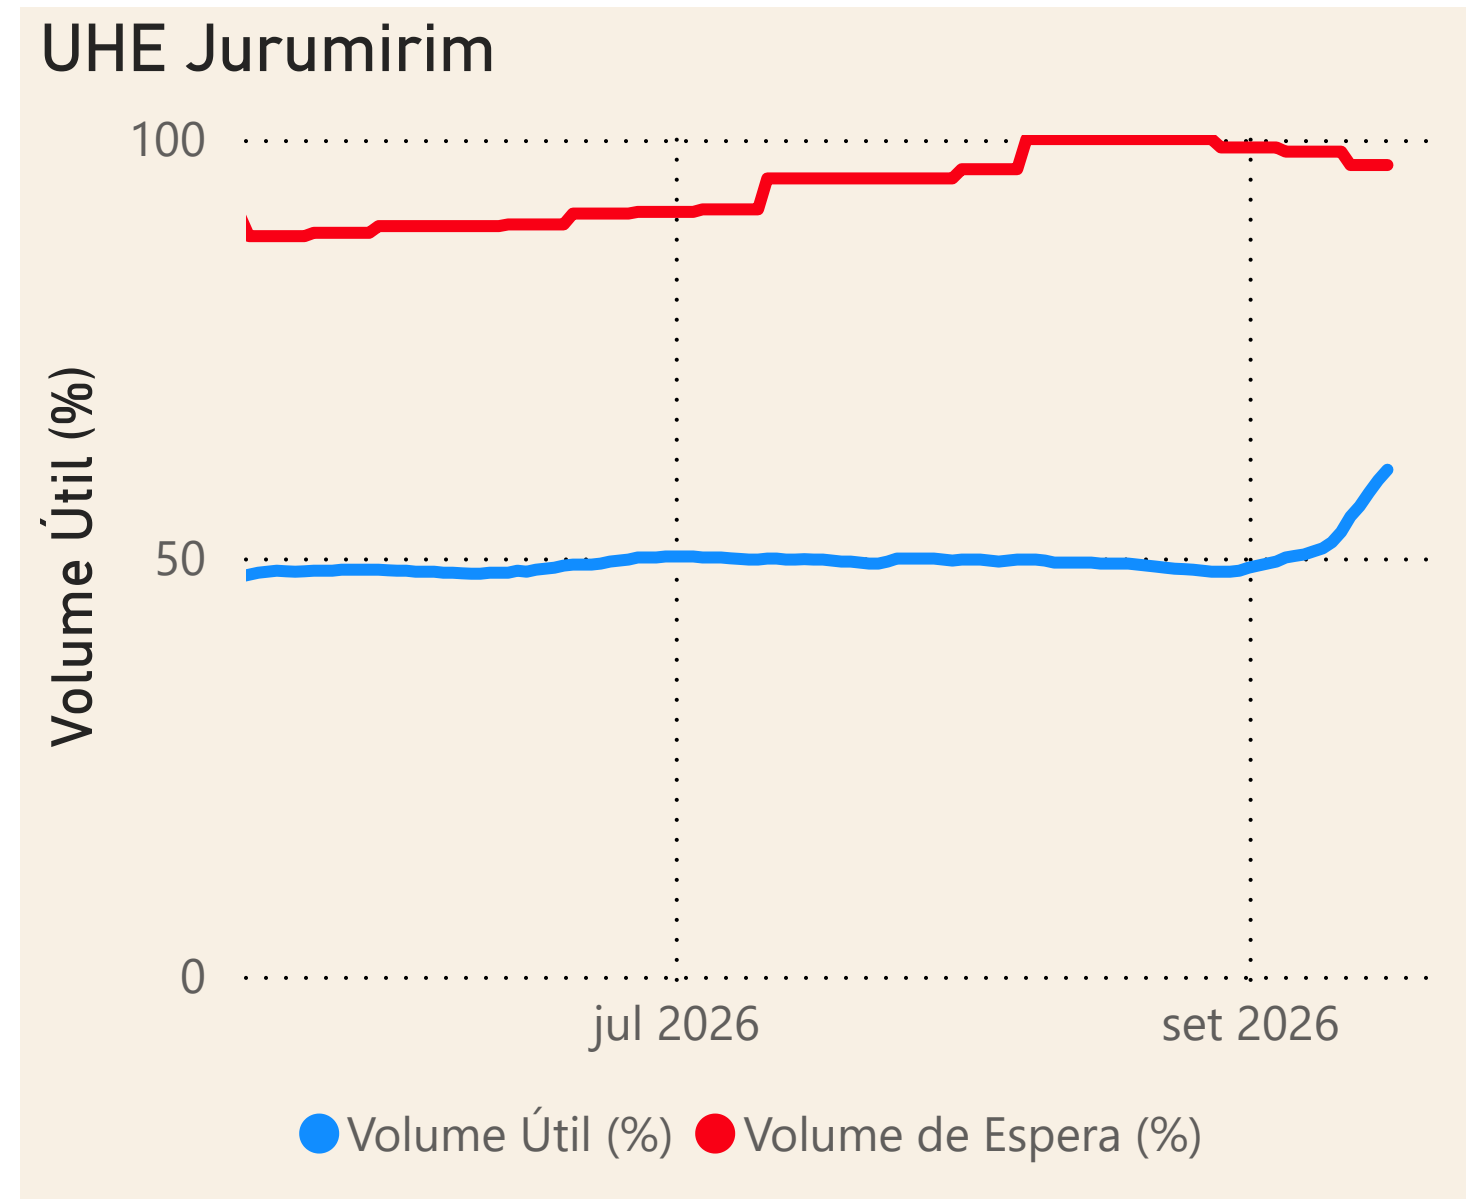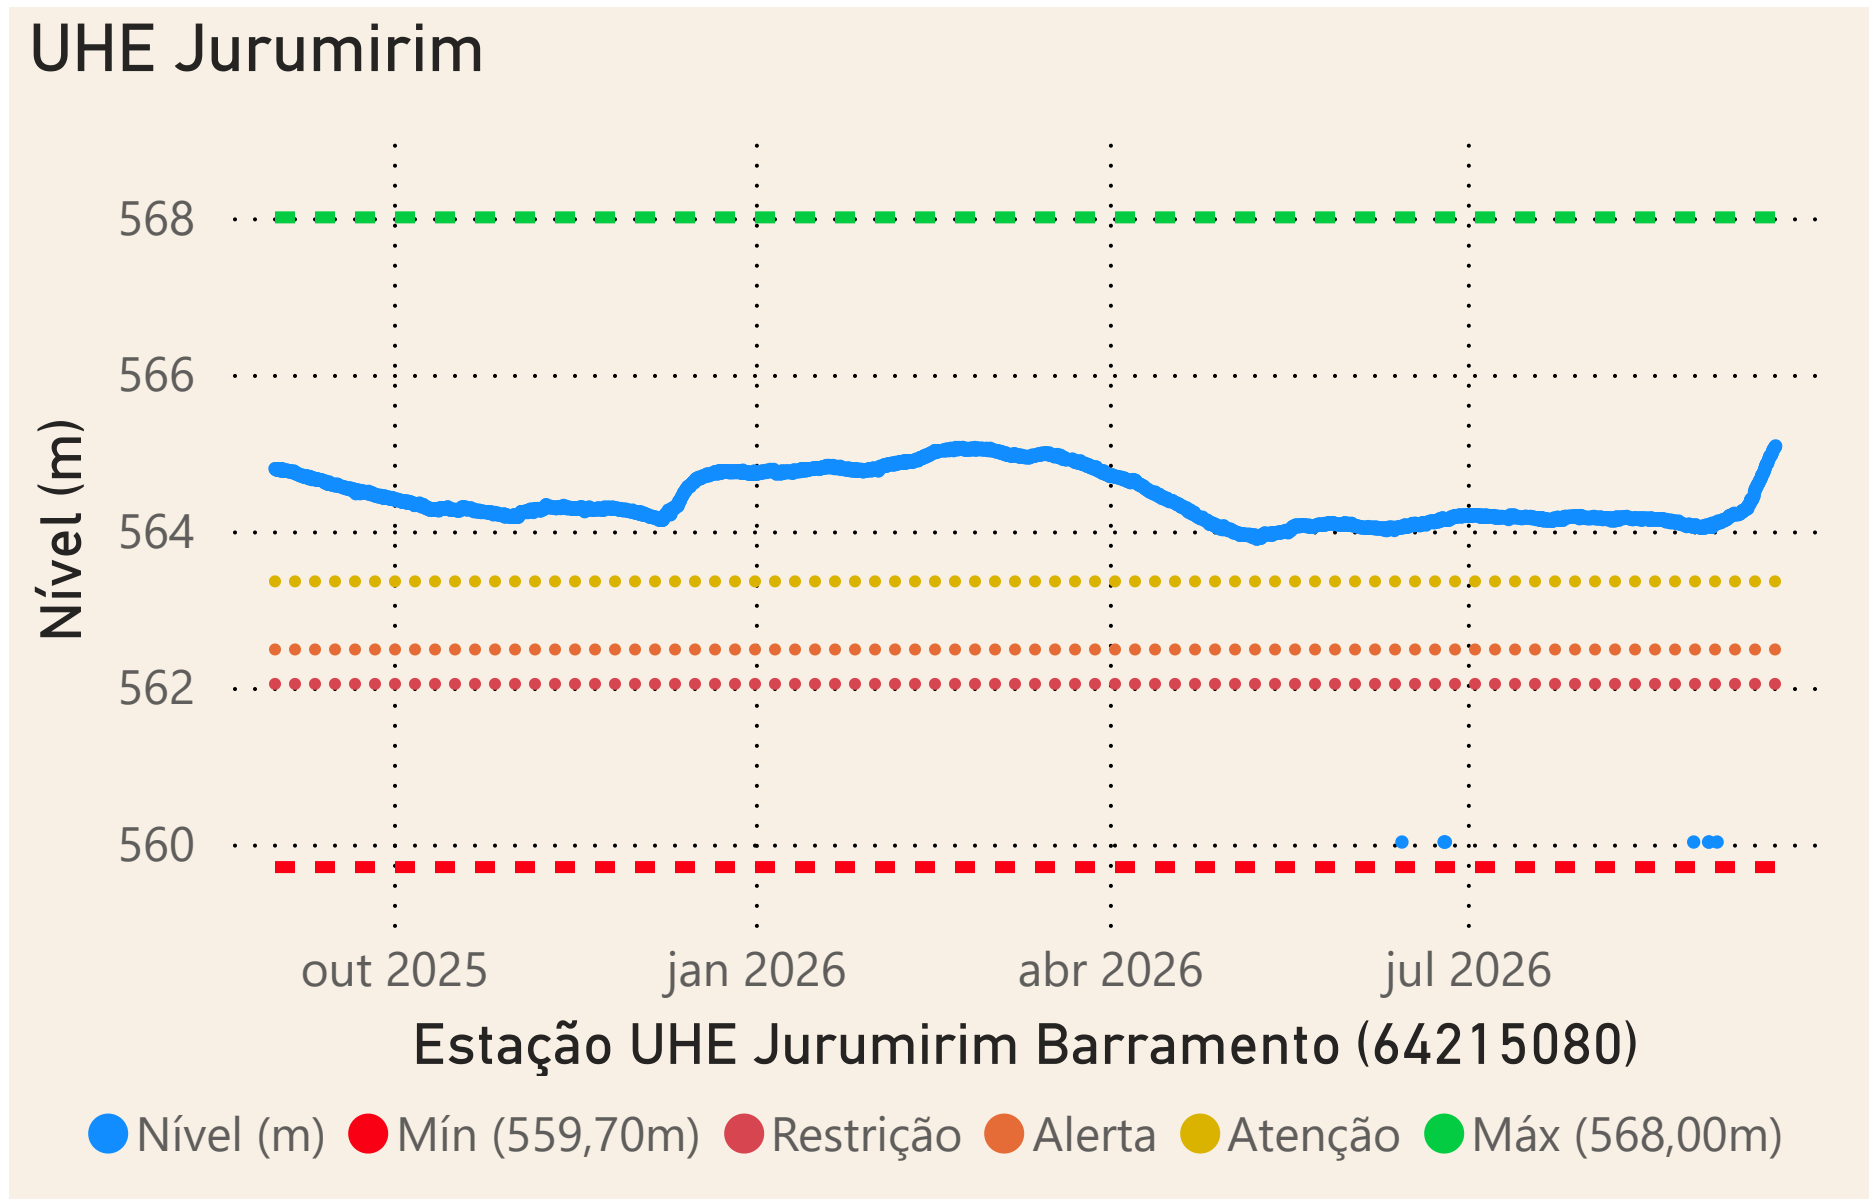



Faixa de Operação

Normal


Vazão defluente máxima média semanal

Sem restrição

Localização do reservatório

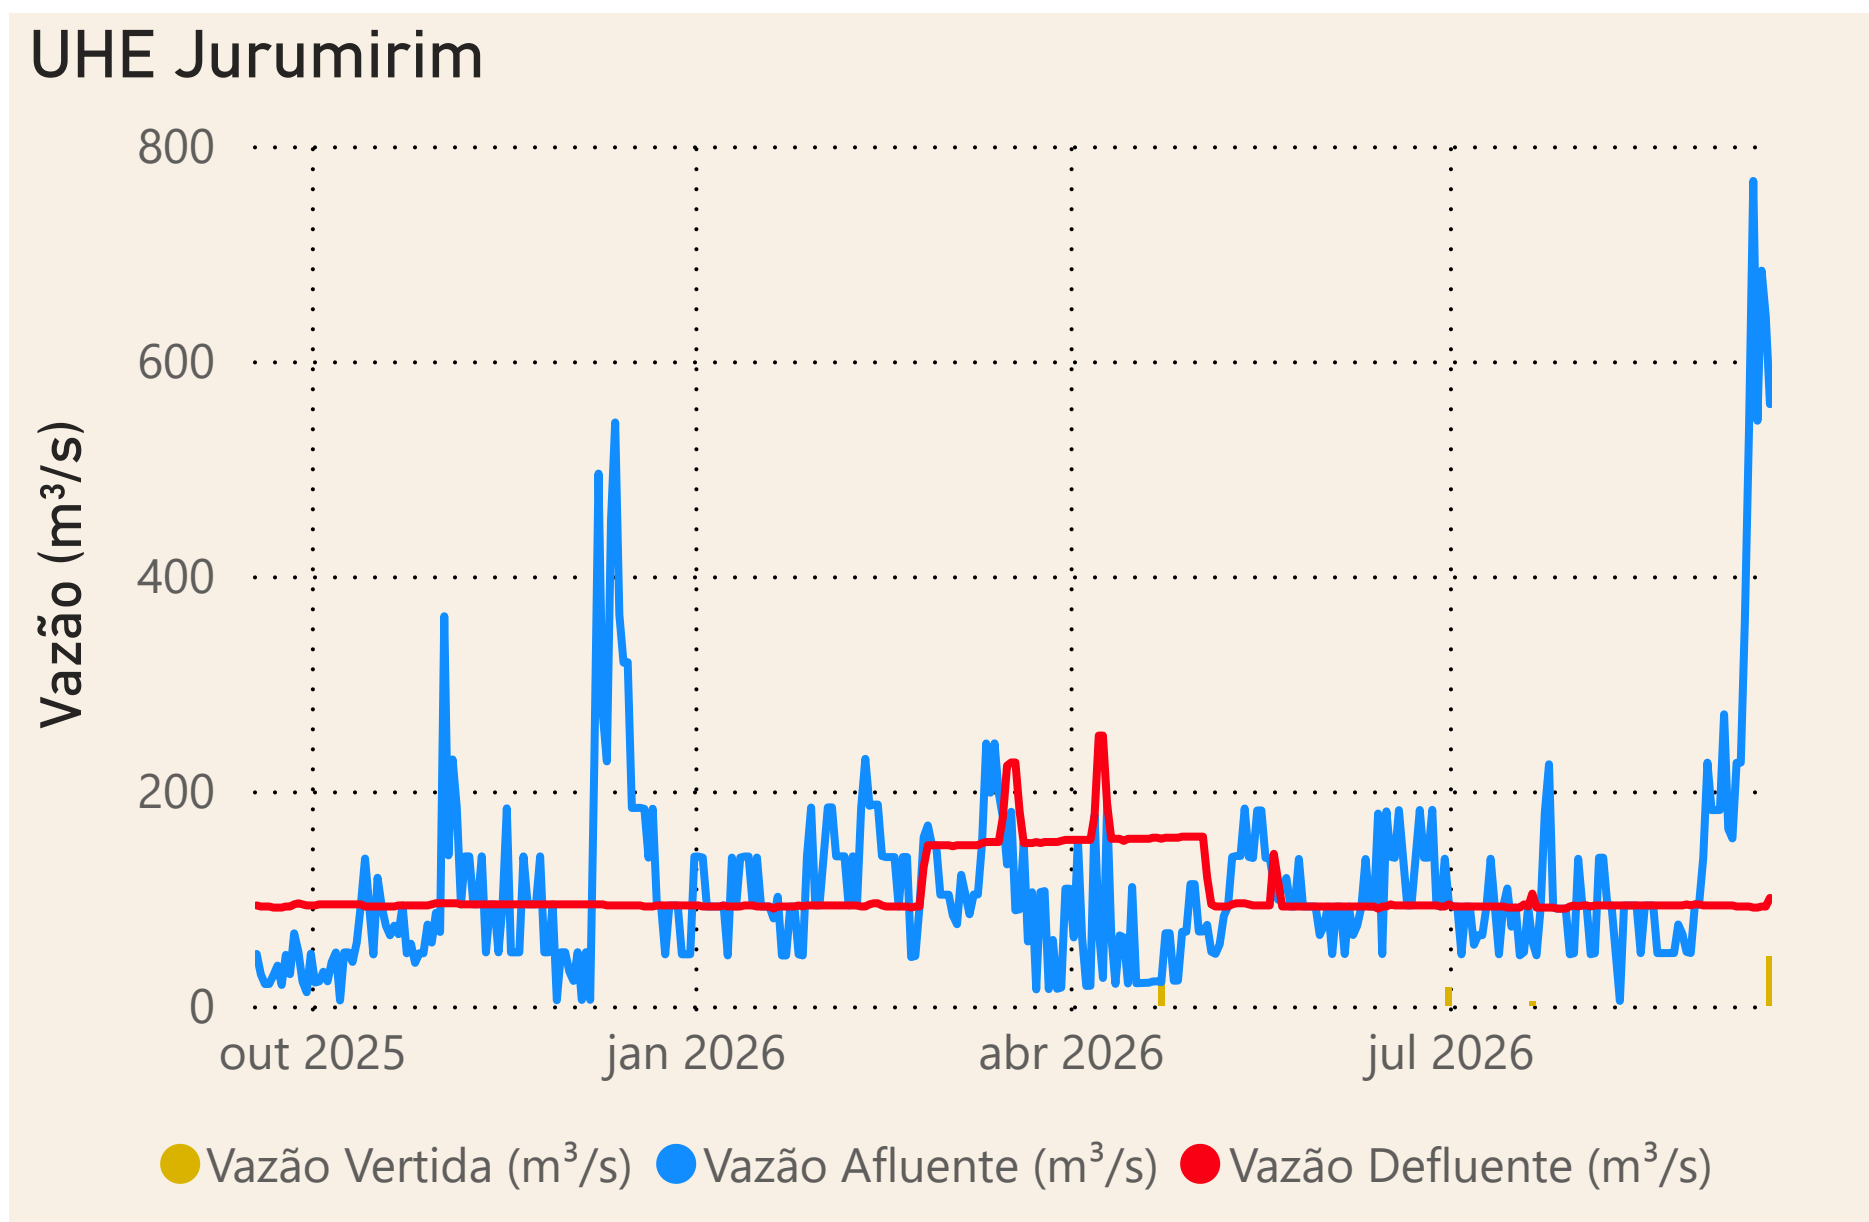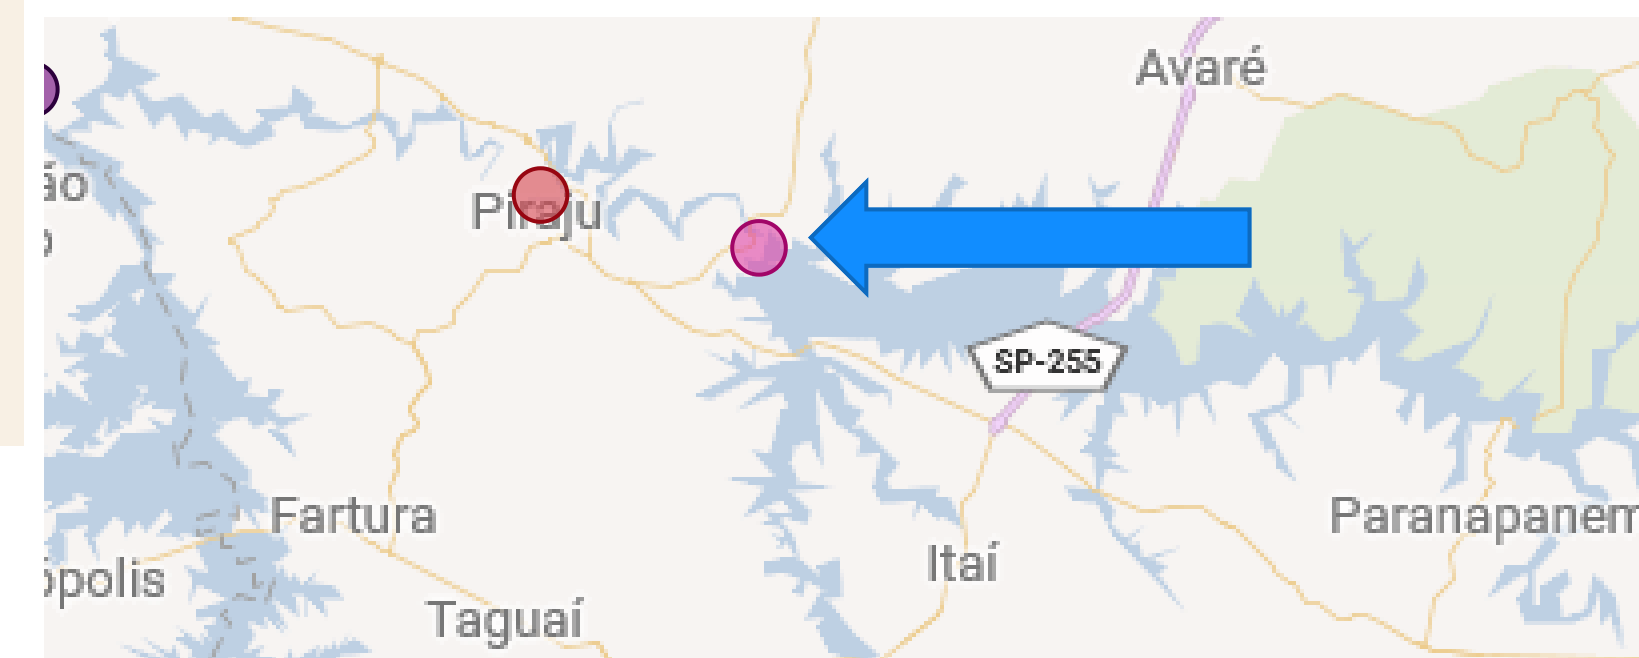

Data	Qnatural mensal (m³/s)	MLT 1931-2024 (m³/s)	% MLT
set/2025	49	156	32%
out/2025	65	187	35%
nov/2025	110	183	60%
dez/2025	178	230	78%
jan/2026	108	324	33%
fev/2026	144	357	40%
mar/2026	125	303	41%
abr/2026	67	214	31%
mai/2026	125	188	67%
jun/2026	128	201	64%
jul/2026	104	172	61%
ago/2026	96	144	67%
set/2026	392	156	251%

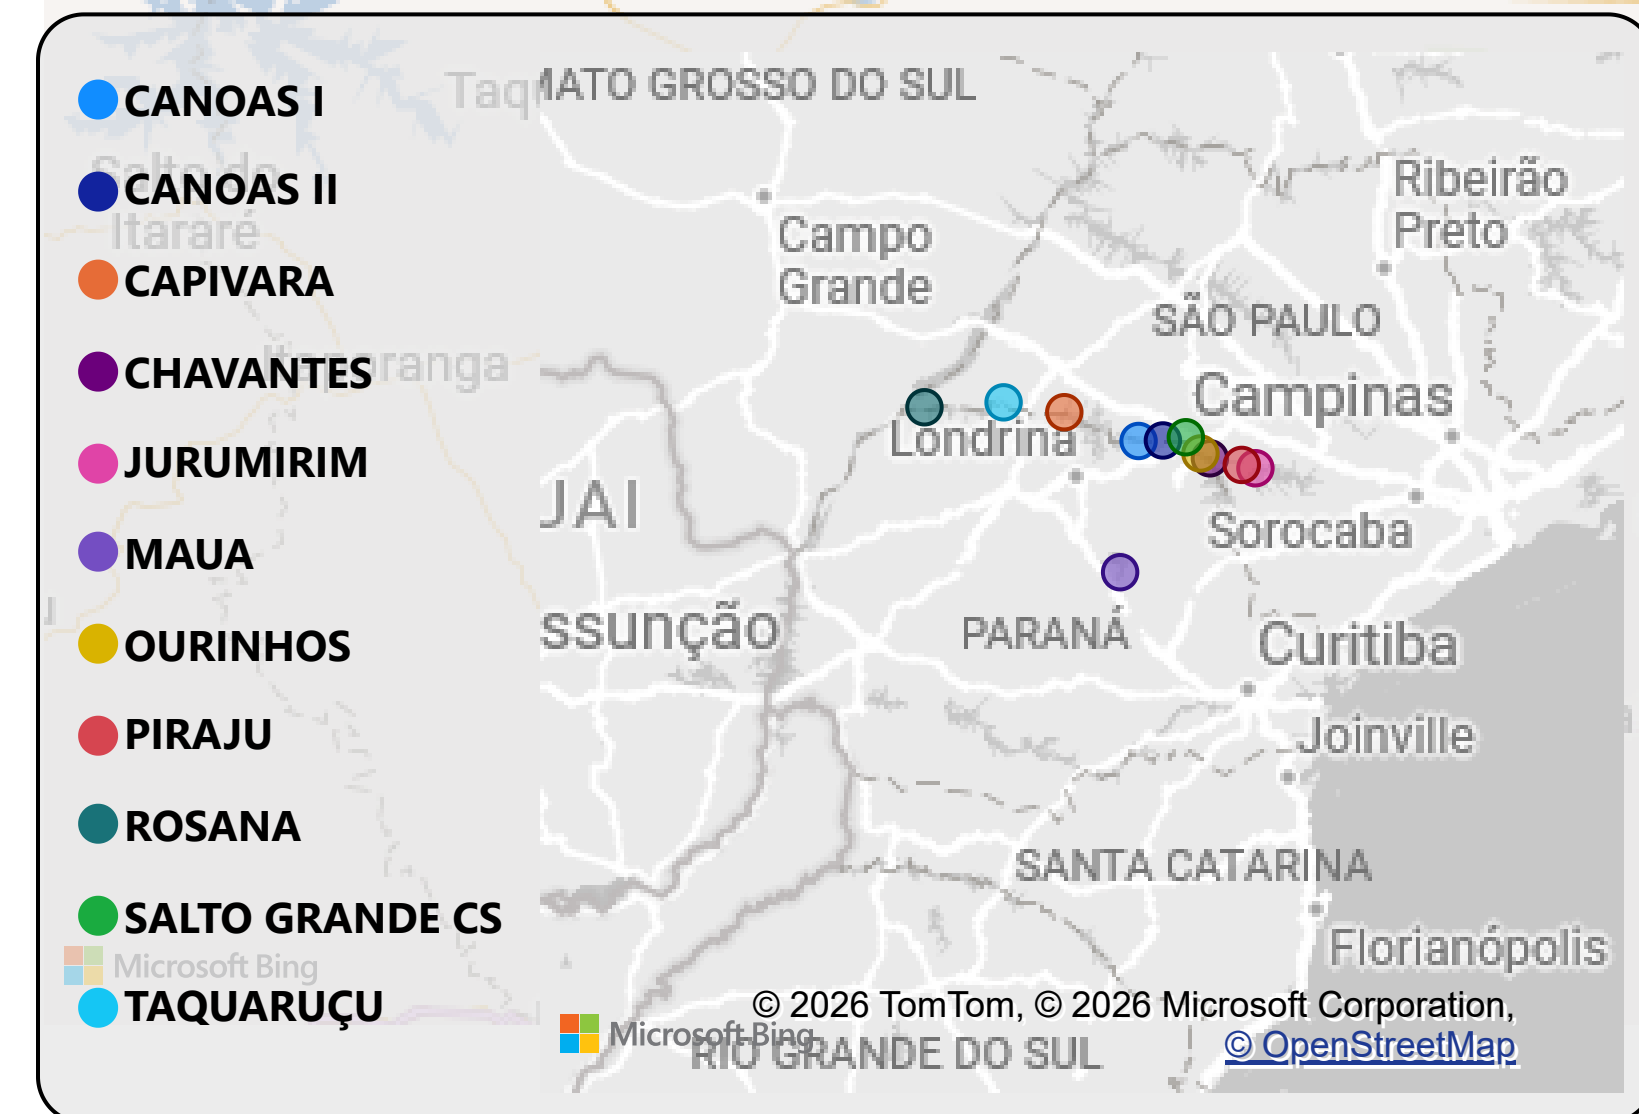


Saiba mais sobre as condições de operação do Sistema Hídrico do Rio Paranapanema

Fonte: ONS e
Hidro-Telemetria


Superintendência de Operações e Eventos Críticos
Coordenação de Operação de Reservatórios e Sistemas Hídricos

*Dados consistidos sujeitos a novas revisões

UHE Chavantes

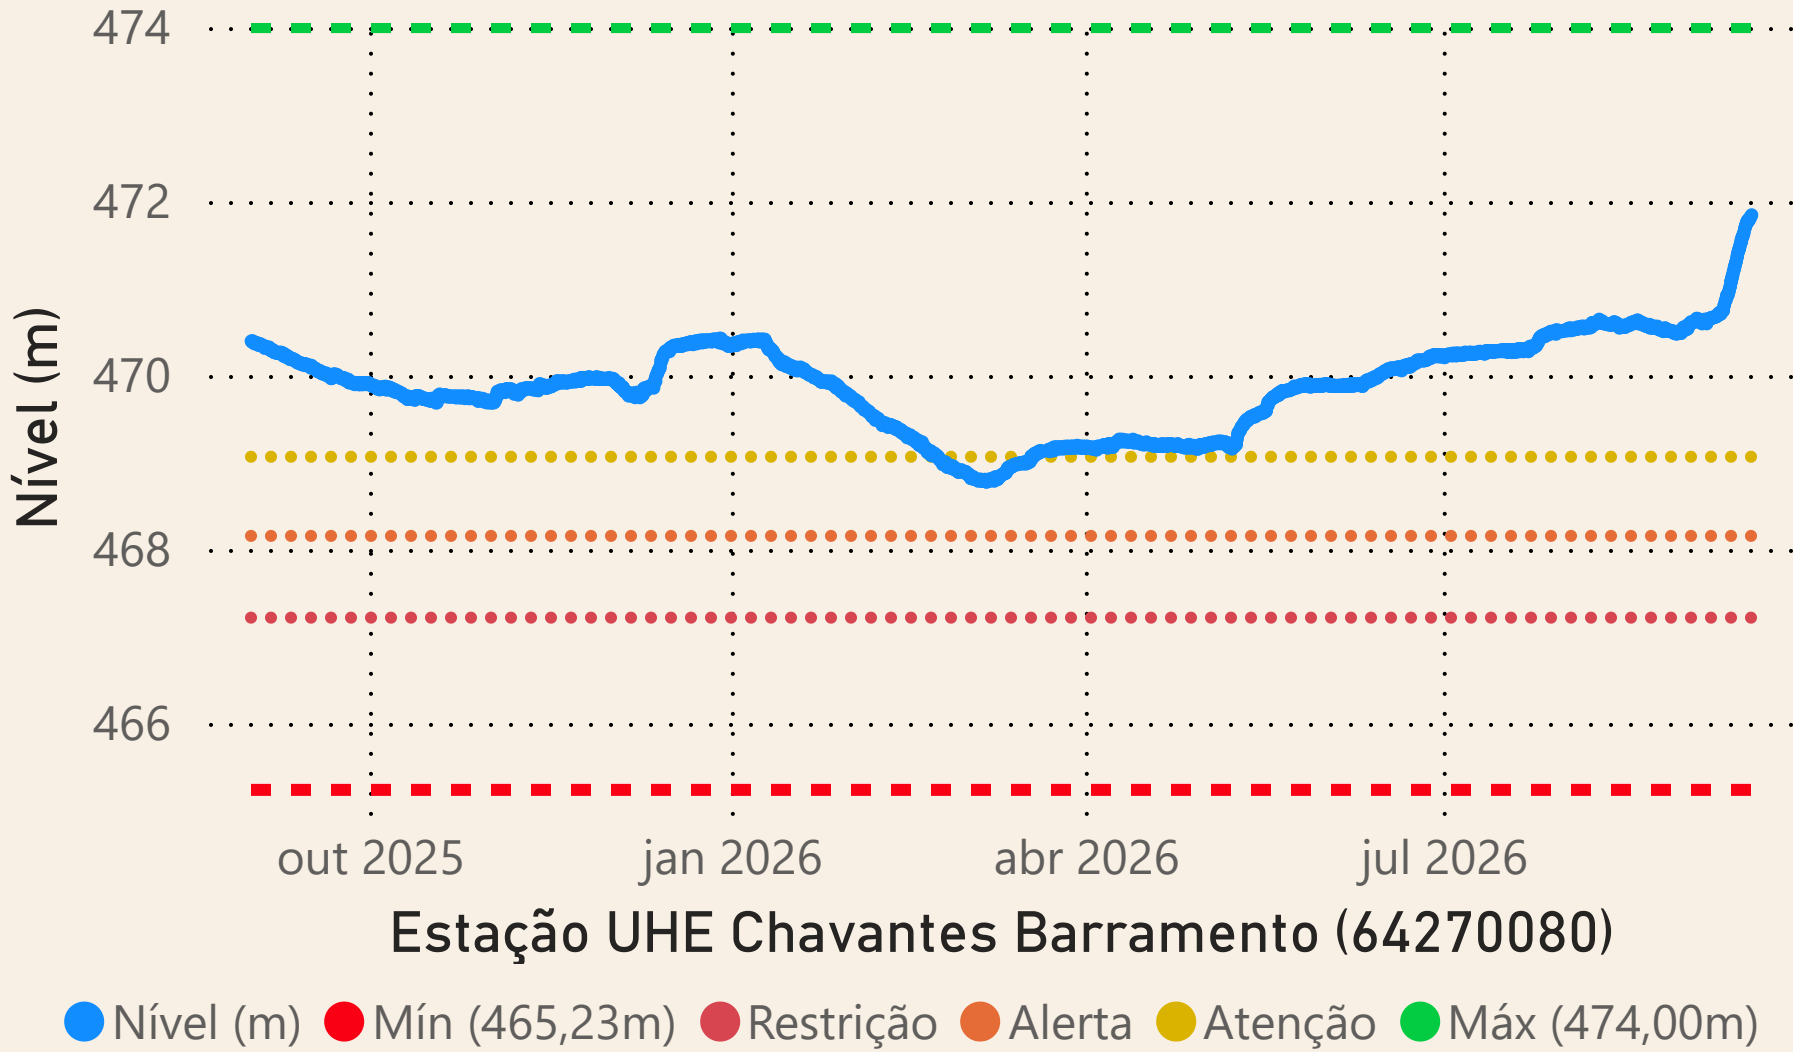

UHE Chavantes

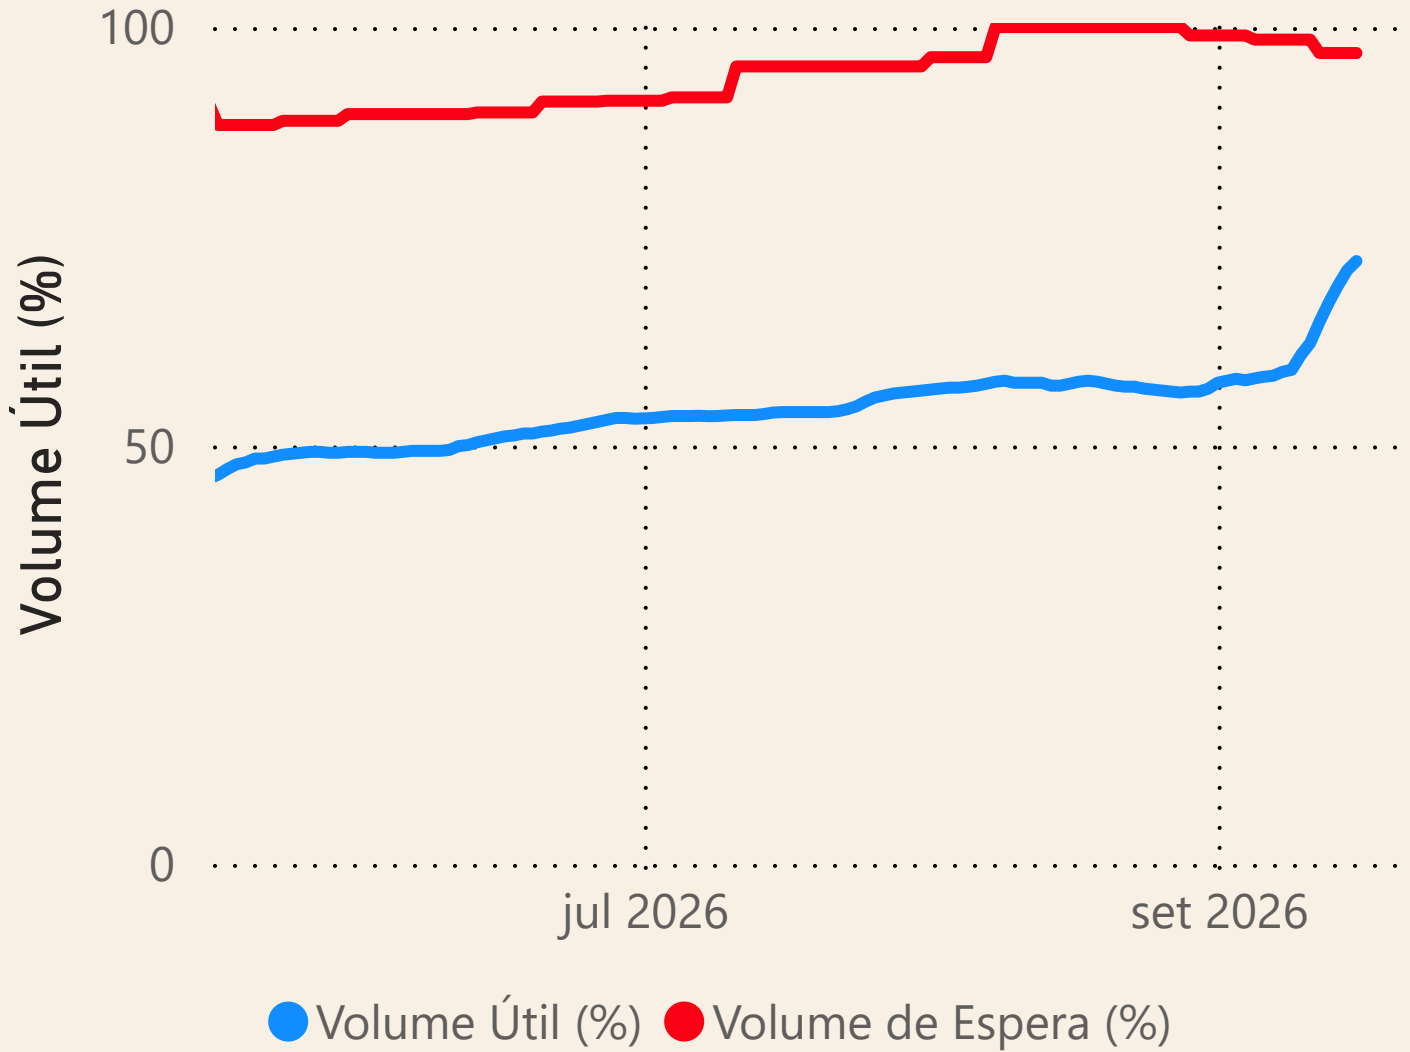


Faixa de Operação

Normal


Vazão defluente máxima média semanal

Sem restrição


Localização do reservatório

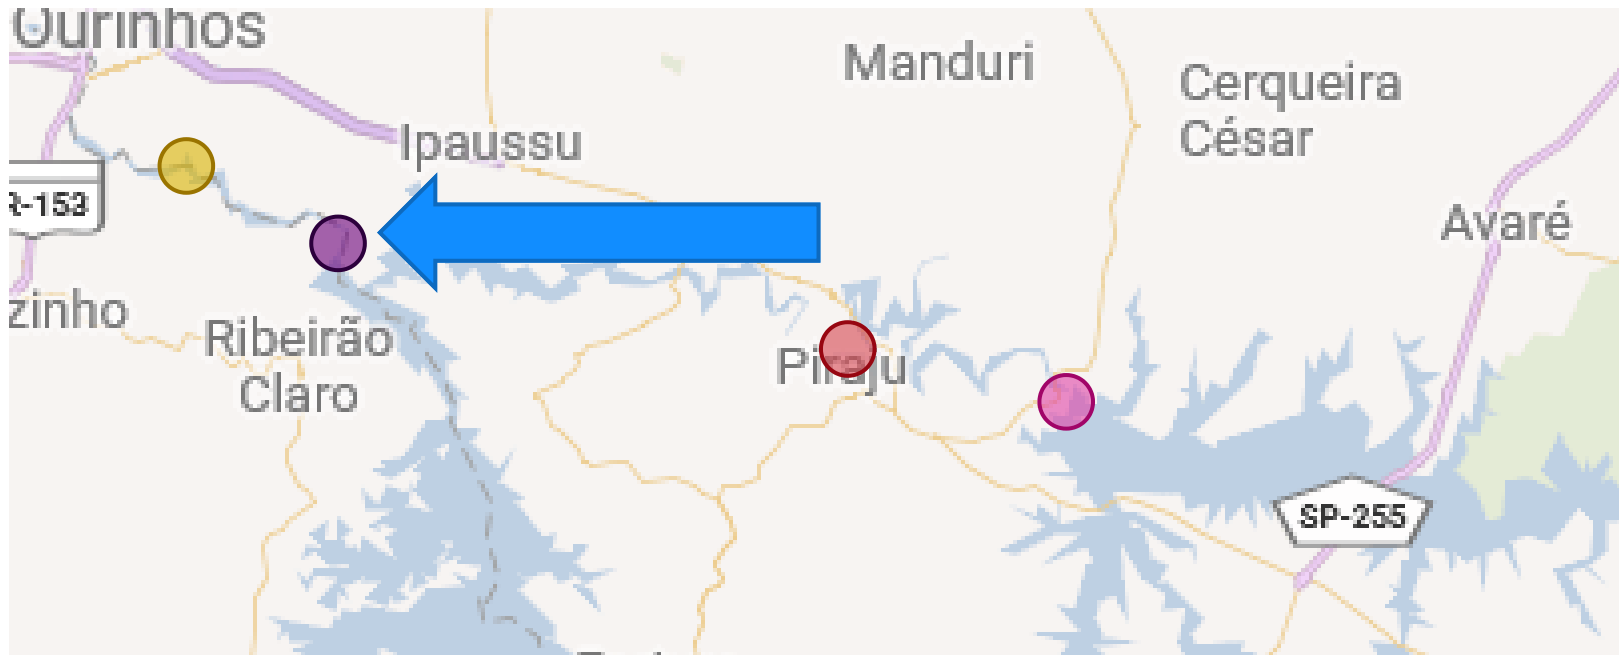


UHE Chavantes

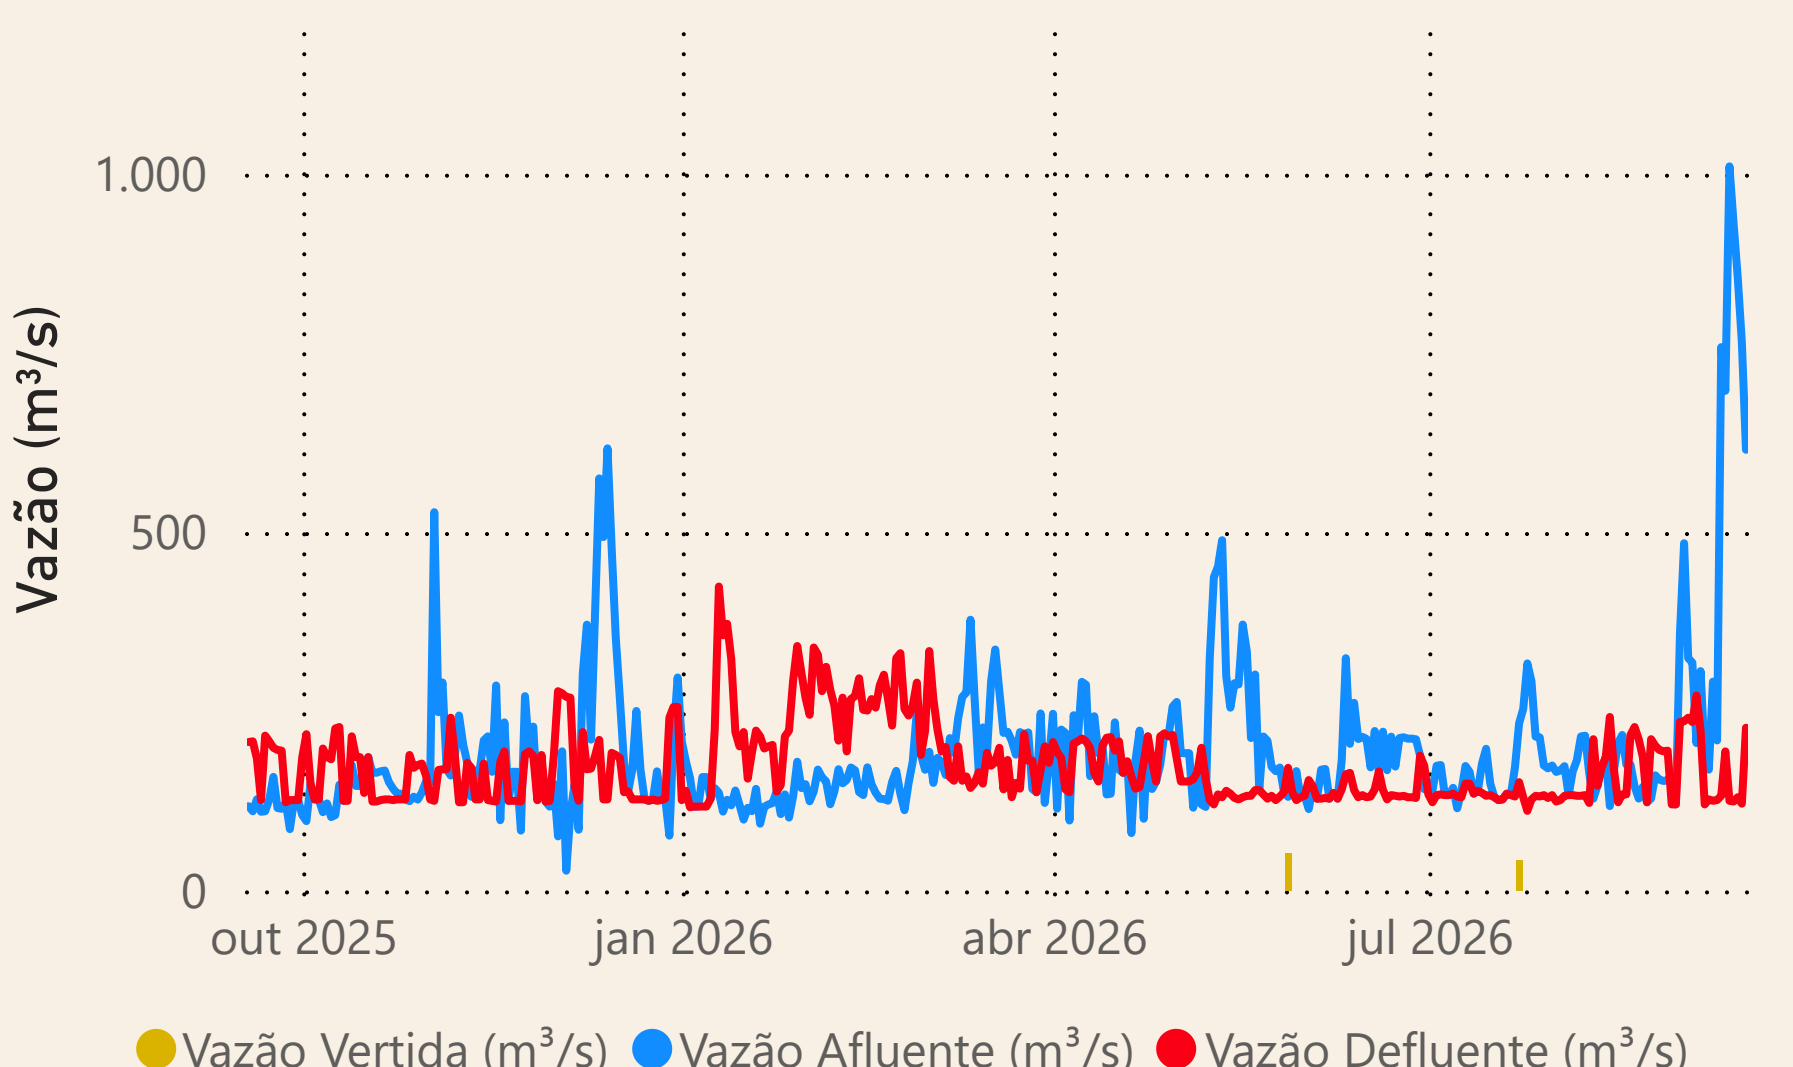


Data	Qnatural Mensal (m³/s)	MLT 1931-2024 (m³/s)	% MLT
set/2025	80	251	32%
out/2025	109	304	36%
nov/2025	197	288	68%
dez/2025	313	350	90%
jan/2026	152	503	30%
fev/2026	198	532	37%
mar/2026	187	443	42%
abr/2026	98	318	31%
mai/2026	263	295	89%
jun/2026	221	315	70%
jul/2026	182	272	67%
ago/2026	175	225	78%
set/2026	809	251	322%

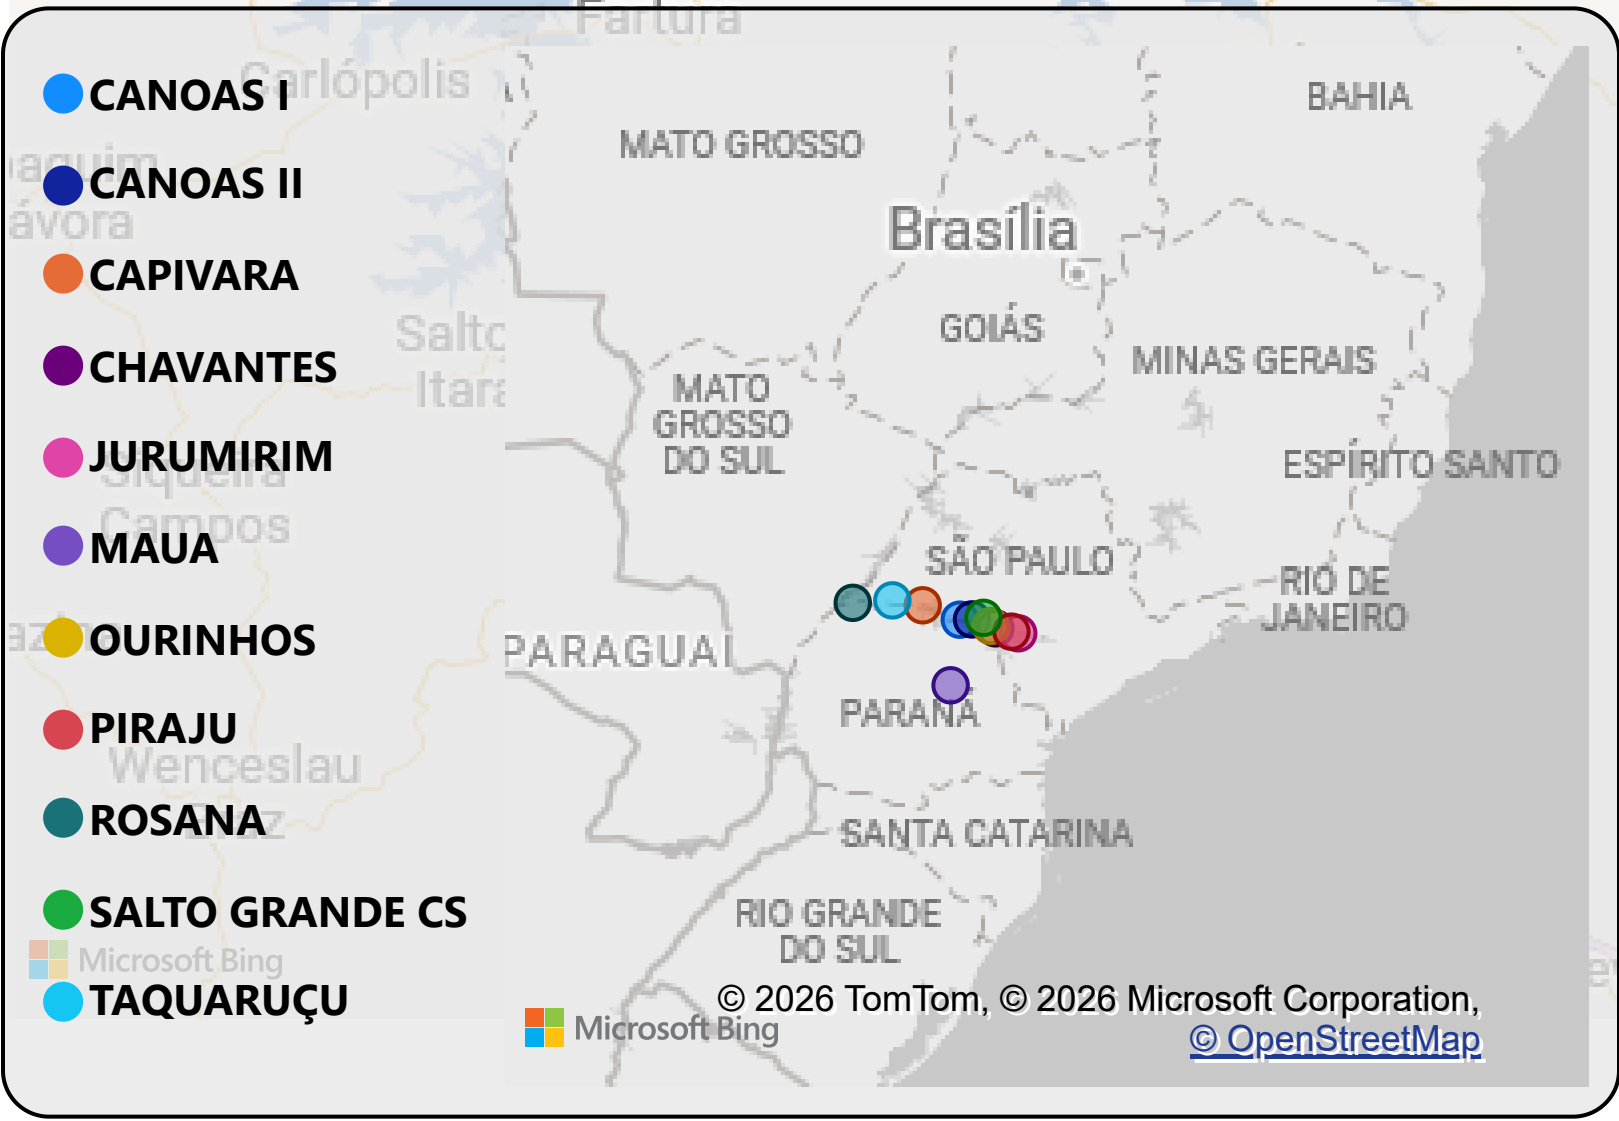

UHE Capivara

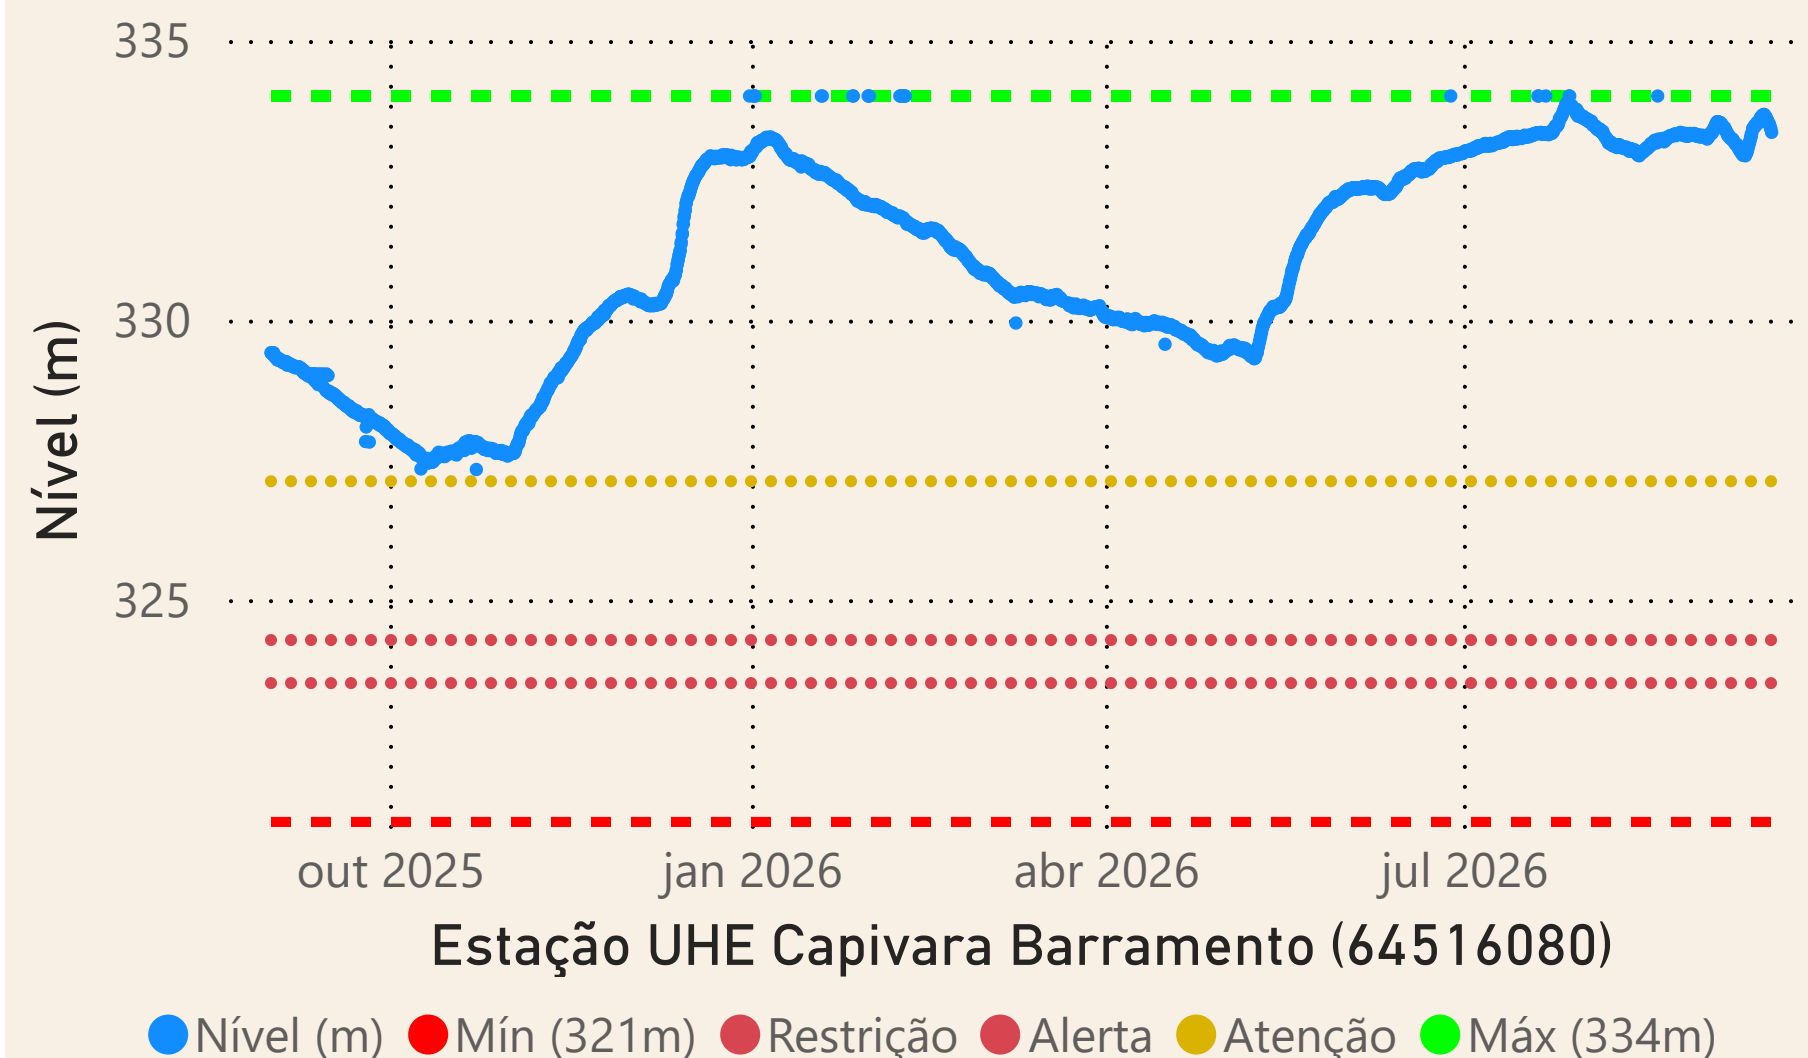

UHE Capivara

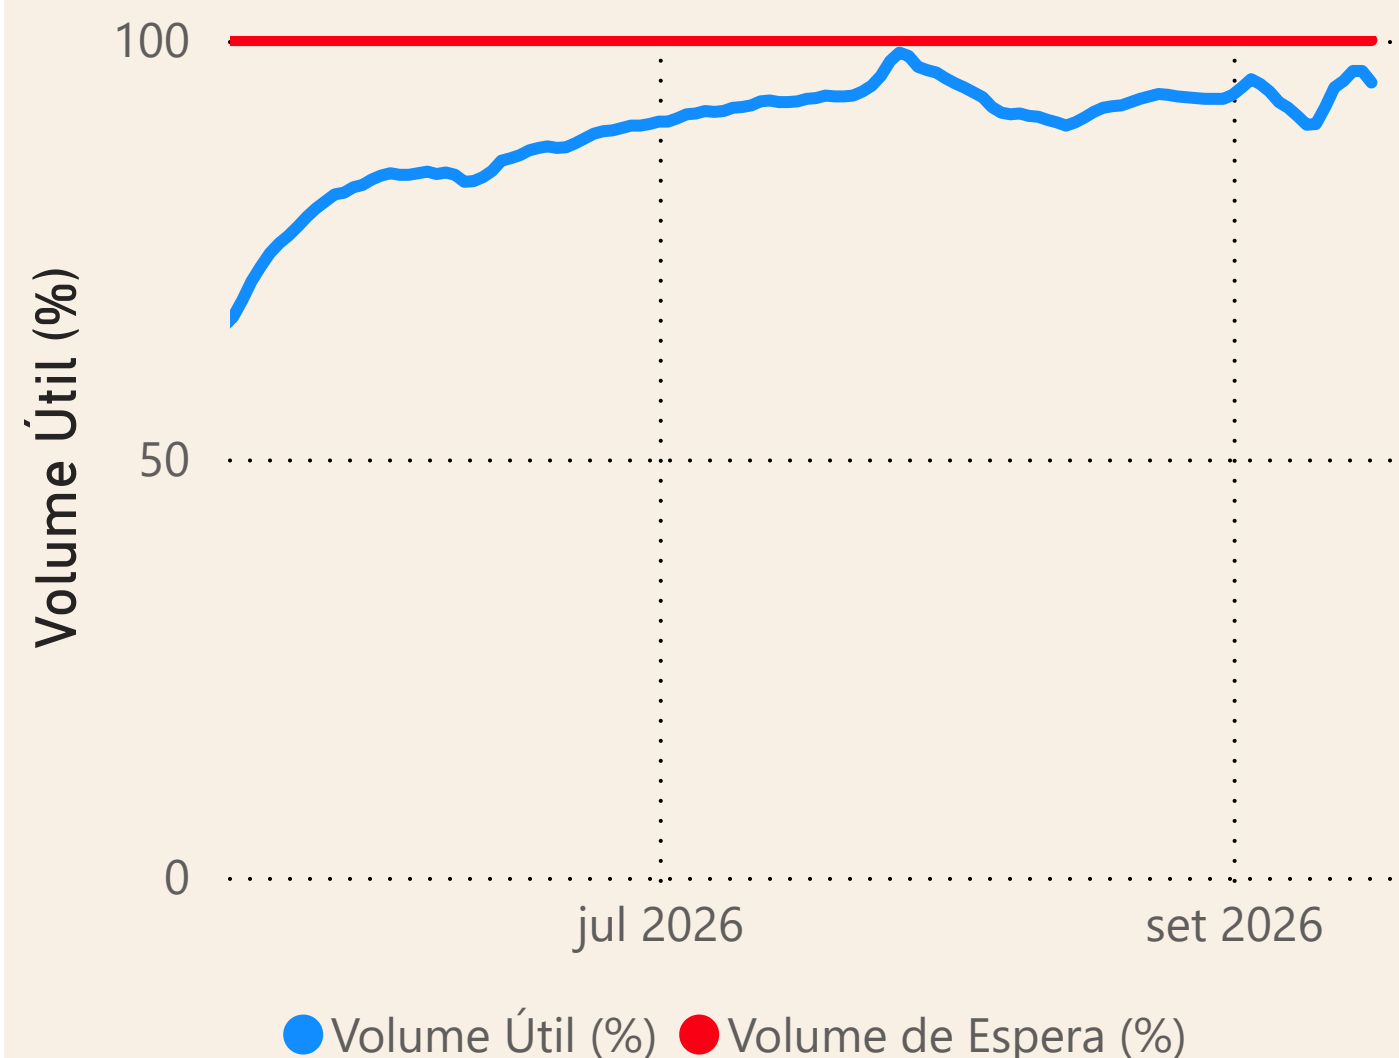

Faixa de Operação

Normal


Vazão defluente máxima média semanal

Sem restrição

Localização do reservatório



UHE Capivara

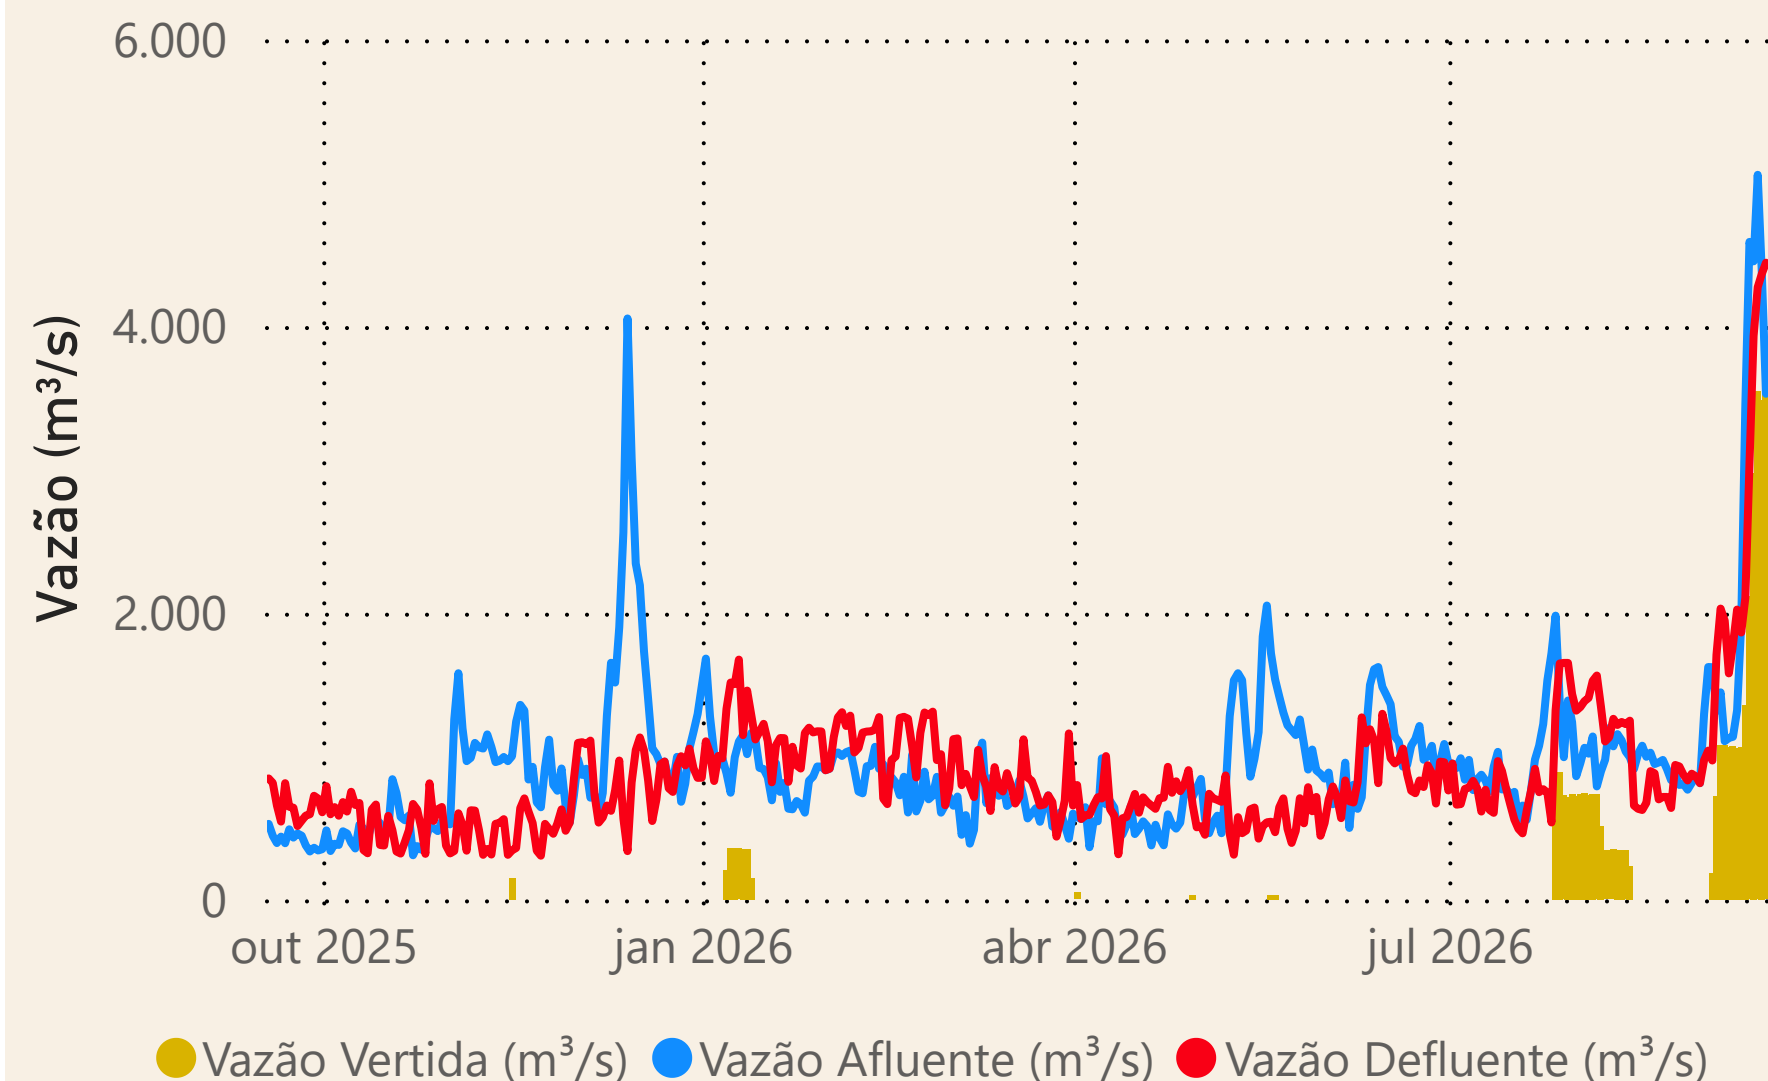

Data	Qnatural Mensal (m³/s)	MLT 1931-2024 (m³/s)	% MLT
set/2025	357	872	41%
out/2025	509	1.101	46%
nov/2025	1.120	1.026	109%
dez/2025	1.413	1.110	127%
jan/2026	780	1.503	52%
fev/2026	726	1.546	47%
mar/2026	688	1.286	54%
abr/2026	476	970	49%
mai/2026	1.477	971	152%
jun/2026	1.156	1.091	106%
jul/2026	1.041	962	108%
ago/2026	1.001	793	126%
set/2026	2.983	872	342%

